

PF3000 CONTROLLER

for the

AQUARIUS[®] DEIONIZED WATER HEATING SYSTEM

Heateflex by White Knight
405 E. Santa Clara St.
Arcadia, CA 91006-7218
TEL: (626)599-8566; FAX: (626)599-9567

PF3000-USER REV.0 2020-01-27, (PF3000)

TABLE OF CONTENTS

1. INTRODUCTION	4
2. BASIC TOUCH SCREEN FUNCTIONS.....	6
2.1. UTILIZING THE TEN KEY	6
2.2. UTILIZING THE KEYBOARD	7
2.3. UTILIZING THE SYSTEM SCREEN KEYS	8
2.4. UTILIZING THE FUNCTION KEYS.....	9
3. SECURITY.....	10
3.1. LOG IN.....	10
3.2. ADD USER	12
3.3. DELETE USER	14
4. DATE/TIME SET UP	15
5. OPERATION	16
5.1. SYSTEM STATUS SCREEN	19
5.2. MODE INDICATING LAMPS/LABELS.....	21
5.3. SYSTEM STATUS DISPLAY	23
5.4. UNIT CHANGE KEY	24
5.5. SYSTEM SCREEN KEYS	24
5.6. SYSTEM OPERATION KEYS	25
6. SYSTEM SET UP	26
6.1. SYSTEM SET UP MENU	28
6.2. CONTROL SETTINGS SCREEN	29
6.3. ALARM SET POINTS SCREEN.....	31
6.4. OPTIONS SCREEN.....	33
6.5. SYSTEM CALIBRATION SCREEN	34
7. ALARM MENU	36
8. ALARM HISTORY	50
9. SYSTEM INFORMATION	51
9.1. SYSTEM INFORMATION MENU SCREEN	51
9.2. SYSTEM INFORMATION SCREEN	52
9.3. SYSTEM SPECIFICATIONS SCREEN	53
9.4. SYSTEM MAINTENANCE SCREEN.....	55
9.5. CONTACT INFORMATION SCREEN.....	56
10. TREND GRAPH.....	57
11. ETHERNET COMMUNICATIONS	59
11.1. ETHERNET CONNECTIVITY	60
11.2. ETHERNET DATA	62
11.3. ETHERNET INTERFACE MENU.....	66
11.4. ETHERNET COMMUNICATIONS MENUS	67
11.5. ETHERNET ALARM AND STATUS SIGNALS.....	71
11.6. ETHERNET WRITABLE MENUS.....	73
11.7. CHANGE ETHERNET IP ADDRESS.....	75

12. AUTO PURGE	76
13. RECIRCULATION	78
13.1. ACTIVATING RECIRCULATION.....	81
13.2. DEACTIVATING RECIRCULATION.....	81
13.3. PUMP AIR COOLING SYSTEM CALIBRATION	82
14. TEMPERATURE READY DEAD BAND (DB) SIGNAL.....	84
14.1. TEMPERATURE READY DEAD BAND SETUP.....	84
14.2. TEMPERATURE READY DEAD BAND SIGNAL WIRING	86
15. TEMPERATURE SETPOINT OPTIONS	87
15.1. SECONDARY PROCESS TEMPERATURE SET POINT	88
16. ANALOG INTERFACE	90
16.1. ANALOG INTERFACE WIRING CONFIGURATION	90
16.2. ANALOG INTERFACE VALUES.....	91
16.3. ANALOG INTERFACE SETUP.....	92
17. DISCRETE INTERFACE	93
17.1. DISCRETE INTERFACE SET UP	94
17.2. DISCRETE INTERFACE WIRING CONFIGURATION	96
18. DRY CONTACT INTERFACE.....	97
18.1. DRY CONTACT INTERFACE WIRING CONFIGURATION	101
19. CONTROLLER TROUBLESHOOTER	102
20. SPECIFICATIONS.....	106
21. LIST OF FIGURES	108
22. LIST OF TABLES	110
23. MANUAL REVISIONS	111

PF3000 CONTROLLER for the AQUARIUS® DEIONIZED WATER HEATING SYSTEM

1. INTRODUCTION

The Model **PF3000** is a Programmable Logic Controller (Safety PLC) for the Heateflex Corporation® Aquarius® Deionized (**D.I.**) Water Heating Systems. It monitors and controls all functions of the Aquarius® D.I. Water Heating Systems. Although its primary function is to accurately control the temperature of the discharged D.I. water, it also provides monitoring for incoming or input fluid temperature, output fluid temperature, fluid flow rate, input voltage, input pressure, system alarms, and (optional) water resistivity.

The **PF3000** receives data from various sensors in the Aquarius® Systems. Temperature inputs are direct thermocouple connections. Separate individual thermocouples are used for the input temperature of the ambient D.I. water, output temperature of the heated D.I. water, and a thermocouple for each heating module in the Aquarius® D.I. Water Heating Systems, serving as independent over-temperature safety interlock (**HIGH LIMIT**). A liquid level sensor checks for the proper liquid level at the top of the final heating module. A flow sensor checks the flow rate at the input of the first heating module (all heater modules are configured in series). Pressure sensing is done with a pressure transducer at the ambient D.I. water input. Incoming line voltage monitoring is done with a voltage transducer at the step-down transformer at the power line. If the resistivity option is present a resistivity sensor after the output module is also connected to the **PF3000**.

The **PF3000** also includes a Safety PLC which monitors the high limit thermocouples values and status (all of which are Type J thermocouples), status of thermal cut-off sensors and status of ground fault circuit interrupter (GFCI). The Safety PLC logic determines if there is an output on the **Heater Master Relay** and/or the **Heater Safety Relay** which sets the system into **STANDBY** mode if there is an unsafe condition.

A Human Machine Interface (HMI) Touch Screen is utilized to operate the system, display the status of the unit and display various alarm conditions. Once the Aquarius® System is powered ON the **Main Menu** screen will appear, which is illustrated by Figure 1-1. The touch screen allows the user to set up and adjust the system parameters and set points. The screen also allows the user to monitor the flow rate, system pressure, voltage, incoming and process temperatures through the **System Status** screen (See Section 5.1) and displays the various system alarms on the **Alarm Menu** screen (See Section 7).

Figure 1-1: Main Menu Screen




The **System Set Up Menu** (See Section 6.1) is used to access system settings and troubleshooting. These settings include **Control Settings**, **Alarm Set Points**, **System Calibration**, **Factory Setup**, **Ethernet Interface**, and **Option Settings**. Note: A factory password is required to access the **Trouble Shoot Menu** and **Factory Set Up Menu**.

2. BASIC TOUCH SCREEN FUNCTIONS

2.1. UTILIZING THE TEN KEY

The **Ten Key** is a keypad used to enter numeric data such as temperature set points and parameters throughout the **PF3000** screens. Once the **Ten Key** window is accessed, type in the desired value ensuring that the value is within the maximum and minimum values that are indicated at the top of the **Ten Key** keypad. If a wrong entry is made, use either the **Back Arrow** key to backspace or the **Clear** key to clear the entire entry. Once the desired value is entered correctly, select the **Enter** key to submit the value into the controller as shown in Figure 2-1. If a change is not desired select the **Cancel** key to cancel the operation.

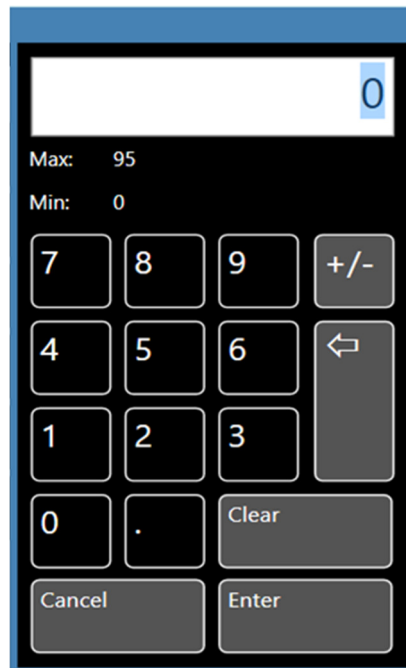Figure 2-1: Ten Key Window



2.2. UTILIZING THE KEYBOARD

The **Keyboard** is a keypad (shown in Figure 2-2 and Figure 2-3) used to enter alphanumeric data such as passwords or text. Once this **Keyboard** window is accessed, type in the value or characters desired. The **Shift** key is used to enter capital letters and special characters, as shown in Figure 2-3. If a wrong entry is made, use either the **Back-Arrow** key to backspace or the **Clear** key to clear the entire entry. Once the desired value or characters are entered correctly, select the **Return** key to submit the value into the controller as shown in Figure 2-2. If a change is not desired select the **Cancel** key to cancel the operation.

Figure 2-2: Full Keyboard

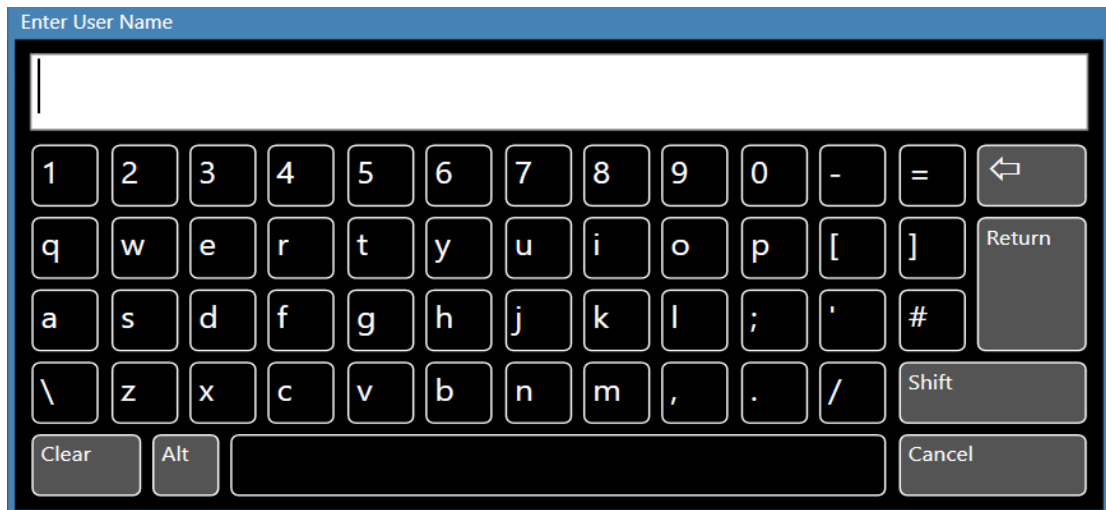
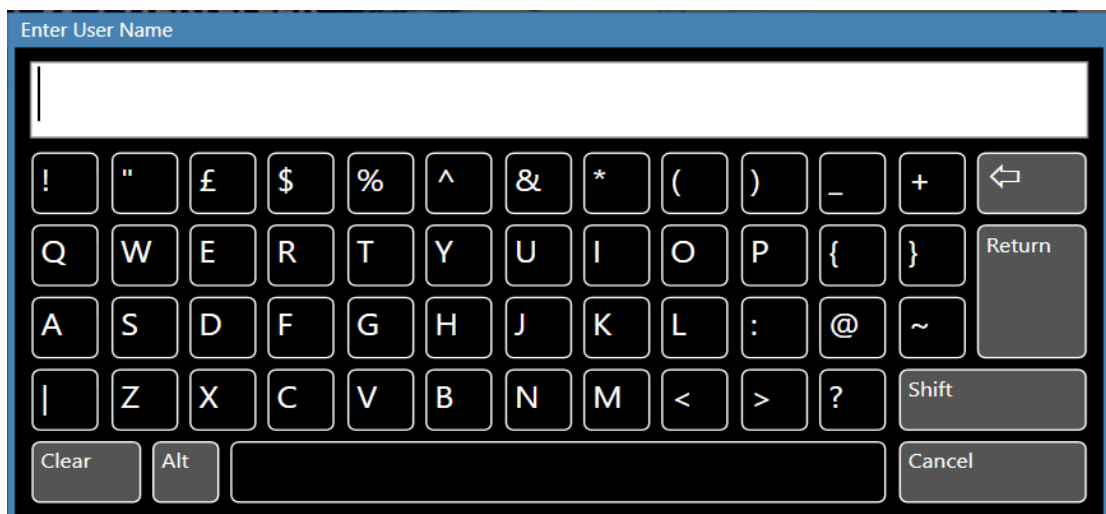















Figure 2-3: Full Keyboard (Shift)



2.3. UTILIZING THE SYSTEM SCREEN KEYS

The system screen keys are used to allow the user to easily navigate the touch screen. These keys are shown on the upper right hand corner, lower right hand corner and lower left hand corner. The keys that are shown are dependent on the current screen and may vary from screen to screen.


Table 2-1: System Screen Keys

KEY	DESCRIPTION	COMMENTS
	Login Window	This key is always visible and located on the upper right hand corner of the screen. See Section 3 for more details.
	Main Menu	The first screen that appears when the unit is powered on.
	System Setup Menu	Navigates to System Setup Menu screen
	Alarm Menu No Alarm	Indicates a No Alarm condition when green and navigates to the Alarm Menu screen when selected.
	Alarm Menu Critical Alarm	Indicates a Critical Alarm condition when red and navigates to the Alarm Menu screen when selected.
	Alarm Menu Non-Critical Alarm	Indicates a Non-Critical Alarm condition when yellow and navigates to the Alarm Menu screen when selected.
	System Status	Navigates to the System Status screen.
	Alarm History	Navigates to the Alarm History screen.
	Trend Graph	Navigates to the Trend Graph screen.
	Previous Screen	Navigates to the screen that was previous to the current screen. Can be pressed multiple times to navigate through multiple previous screens.
	Next Screen	Navigates to the “Next” screen of a series.
	Silence Alarm	The Silence Alarm key is used to silence the buzzer only. It does not clear the alarm.
	Alarm Reset	The Reset Alarm key is used to clear an alarm condition when the alarm condition has been resolved. If the alarm condition is not resolved, the alarm does not clear.

2.4. UTILIZING THE FUNCTION KEYS

The Function keys allow the user to easily navigate the touch screen. They are the three circular keys located on the bottom bezel of the touch screen. The leftmost function key with one dot will navigate to the Main Menu screen. The middle function key with two dots will navigate to the System Status screen. The rightmost function key with the three dots will navigate to the screen previous to the current screen. These keys will always be available and will not change function.

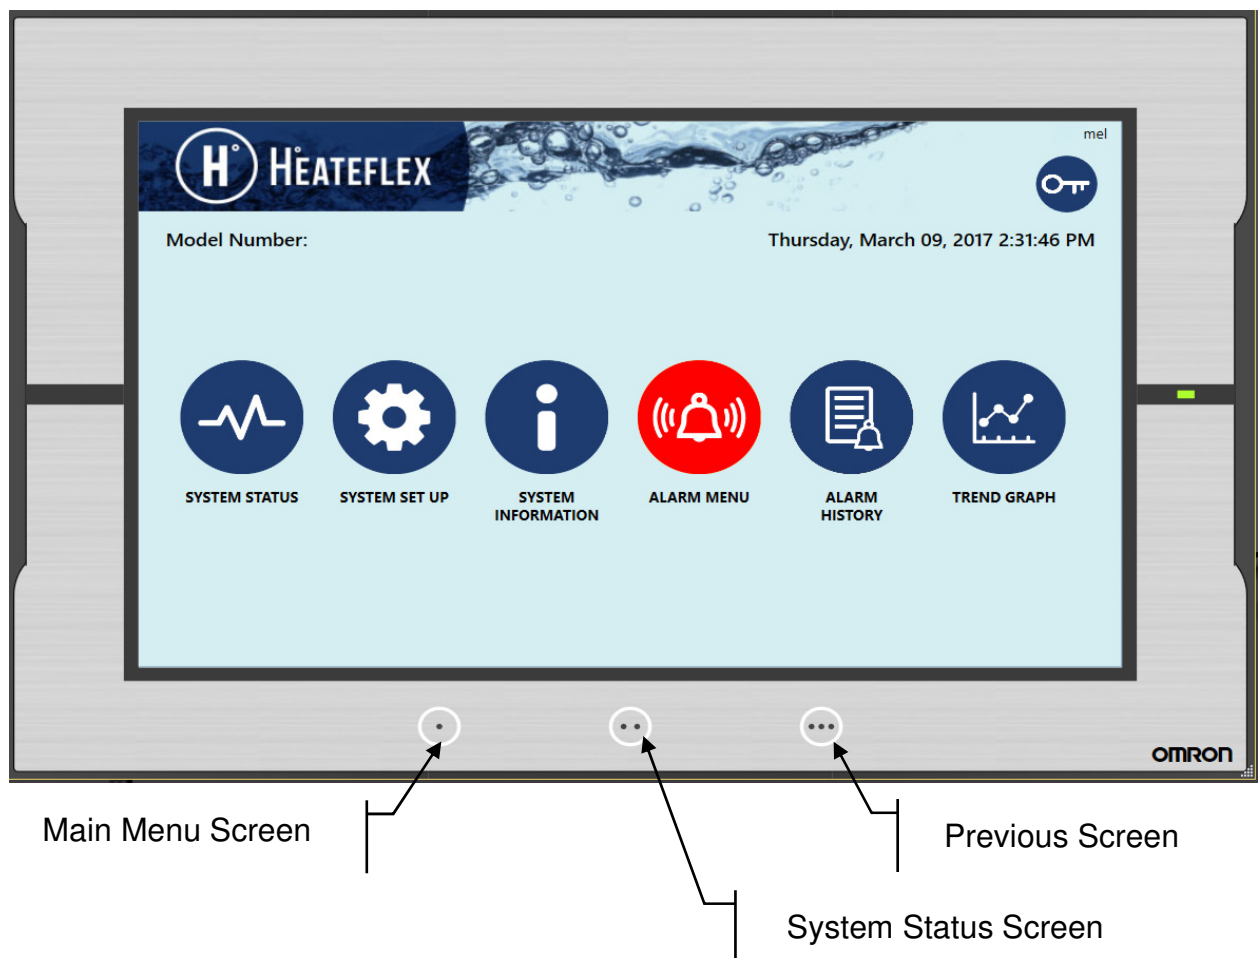Figure 2-4: Function Keys




3. SECURITY

In some cases, it may be desirable to restrict access to the Aquarius® settings, parameters and set points. With that in mind a Password System is incorporated into the Aquarius® D.I. Water Heating Systems to limit access, prevent unauthorized access or prevent unintentional changes to the system.

3.1. LOG IN

A username and password is required to access some of the parameters and set points of the **System Set Up** submenus (**Control Settings, Alarm Set Points, Ethernet Settings, Options** (if available), and **System Calibration**). When a user level access is required, the user must select the Login key at the upper right hand corner of the screen (see Table 2-1 for icon) to bring up the **Login** window. The user must enter the correct **Name** and **Password** with the proper credentials. Touch the input boxes within the **Login** window, shown in Figure 3-1 below, to access the **Keyboard** window so that the **Name** and **Password** can be entered. (For instructions on how to use the **Keyboard** see Section 2.2) Once the correct **Name** and **Password** are entered, select the **Return** key on the **Keyboard** window and then select the **OK** key on the **Login** window. When the **Name** and **Password** is entered, the operator will gain access to the different settings, parameters, and set points associated with the password level entered. The active user Name will be shown at the upper right hand corner of the screen (See Figure 1-1). If the controller is left idle for over two minutes, the “password lock” will be activated which will require the operator to re-enter the **Name** and **Password** for access. The passwords are eight digits alpha-numeric.

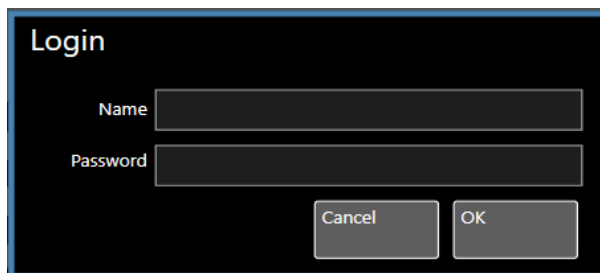Figure 3-1: Login Window




The screenshot shows a black login window with a blue border. At the top left is the word "Login" in white. Below it are two input fields: "Name" and "Password", each with a white text box. At the bottom right are two buttons: "Cancel" and "OK", both in white text on a black background.

Table 3-1: Default Login Username & Password

TYPE	LEVEL	NAME	PASSWORD
Operator	1	User	ABCD1234
Manager	3	Manager	abCH0213

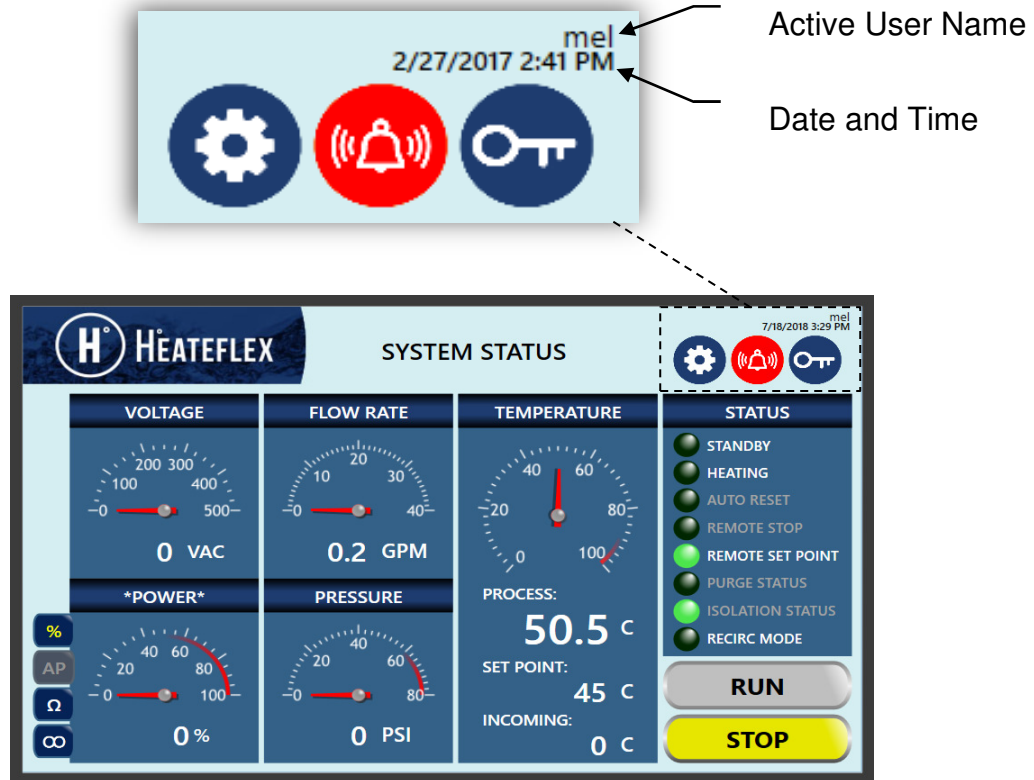Figure 3-2: Close Up of Active User Name, Date and Time



The Operator (Level 1) name and password will allow the user to modify the parameters and set points within the **Control Settings, Alarm Set Points, System Calibration, Ethernet Settings** and **Options** (if options are available). In addition, the Operator user password is required in order to clear the information on the **Alarm History** screen and in order to activate the **GFCI TEST** key for the **GFCI Alarm**.

The Manager (Level 3) name and password will allow the user to access the troubleshooting menus which includes the **System Inputs, System Outputs, System PLC I/O**, and **System Performance**.


*Note: The user logins provided will not grant access to the **Factory System Menu** screen. This menu is for Factory Use Only and a Factory Name and Password is required to access these screens.*

3.2. ADD USER

The PF3000 has the feature add up to five user defined usernames to the system. This is a new feature to the PF3000 which has been requested by many users of the previous Aquarius units. This can be achieved by navigating to the Add a New User screen.

To navigate to the Add a New User screen (see Figure 3-4) from the Main Menu select the System Information Menu>Add User. which requires a user of level 3 (Manager) or higher. See Figure 3-3 Below

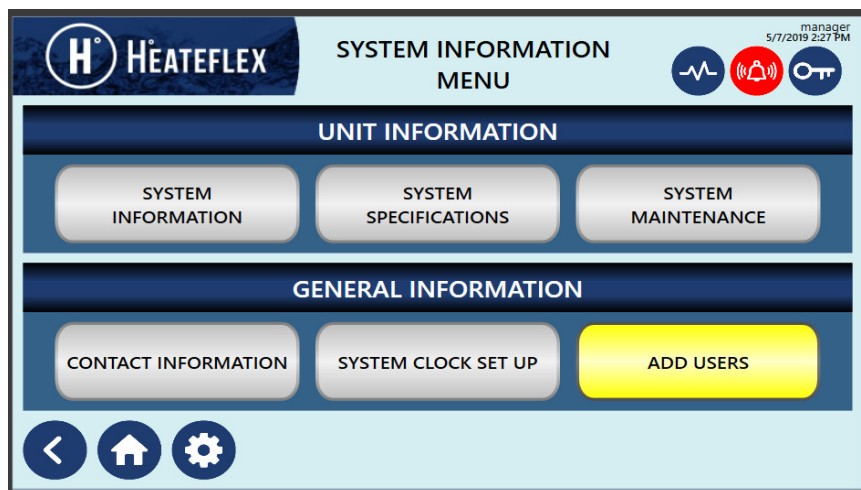Figure 3-3: System Information with Add Users highlighted



To create a new username the person logged into the system must be Manager level (Level 3) or higher. The person currently logged will be shown on the left side of the screen along with the current user's security level labeled "Current Level."


The number of user created usernames are shown as the "Number User Count". It will show a value of 0 through 5.

To create a user, please enter the desired username, password, and comment in the appropriate spaces and select the user role from the selection box. The new user's password must be at least 8 characters long. The selectable user roles are Guest (Level 1). Operator (Level 2), and Manager (Level 3).

After the information is entered, select the "Save New User" button to create the new user.

The new username entry will be logged and saved onto the PLC. The number of user created user names are saved as "New User Count" Shown on the lower left corner of the "Add a New User" screen.

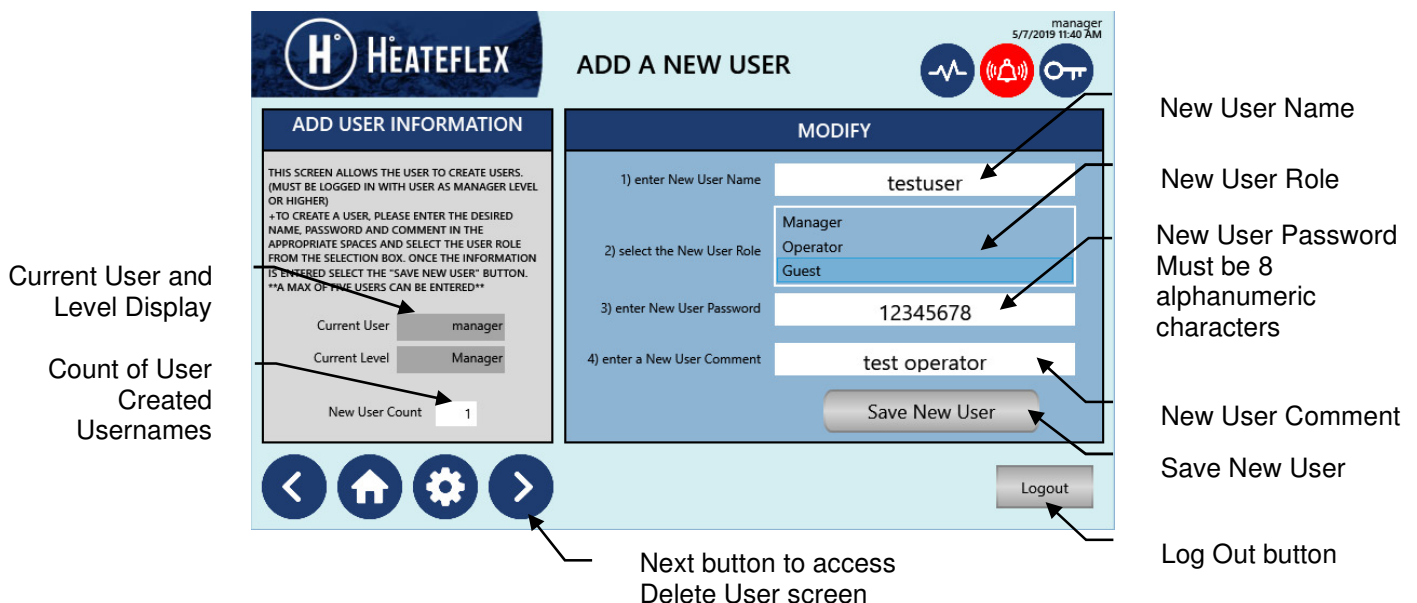Figure 3-4: Add Users screen




3.3. DELETE USER

A username that was created can be deleted through the Delete Users page. This page can be accessed through the Add Users page. See Figure 3-4 for Add User Page to locate the next button which leads to the Delete Users screen. See Figure 3-5 for the Delete User page.

This page displays all of the user created usernames information and provides a means to delete unwanted usernames.

To delete unwanted user names, select the Delete Selection button corresponding to the username to be removed, and then select the “Delete User” button. The unwanted username should disappear from the list of usernames. The remaining usernames will reorganize to eliminate a “gap” where the unwanted username was if needed. Allow time for the process to take place before deleting another user. Verify that the number of users listed is the same as the New User Count.

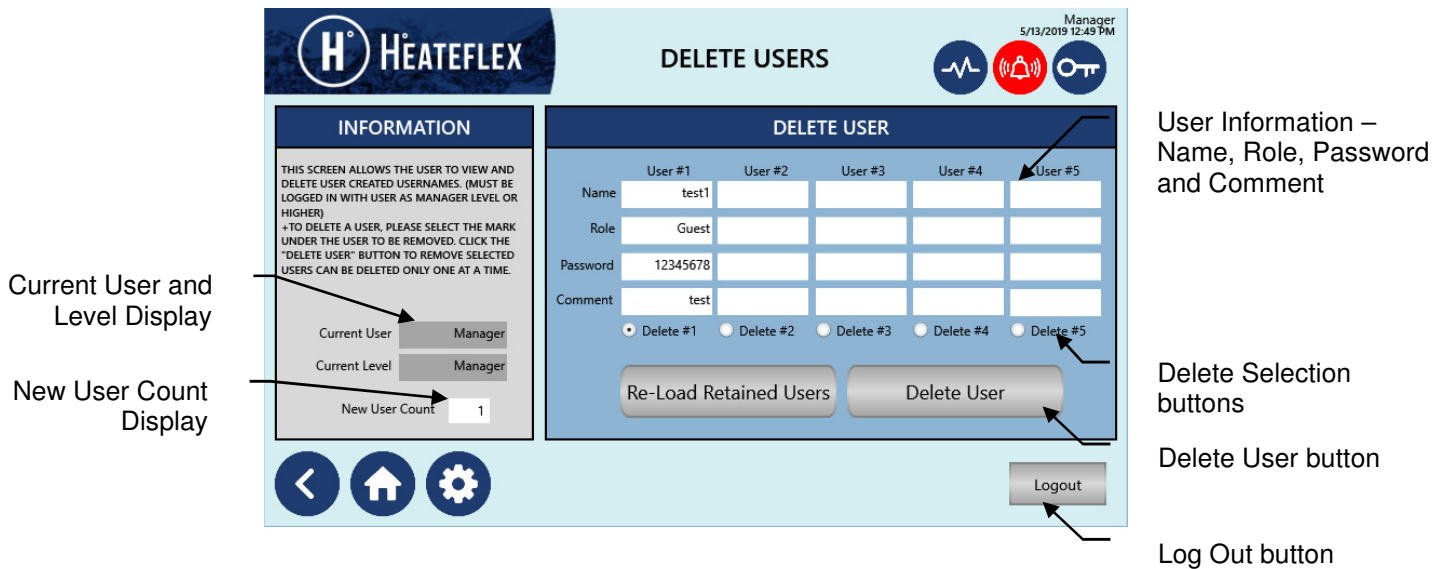Figure 3-5: Delete User screen




Note:

The standard factory set of users cannot be modified or deleted.

4. DATE/TIME SET UP

To navigate to the **System Clock Set Up** screen, select the System Information Key from the Main Menu Screen. Next select System Clock Set Up. This is shown in Figure 4-1 below.

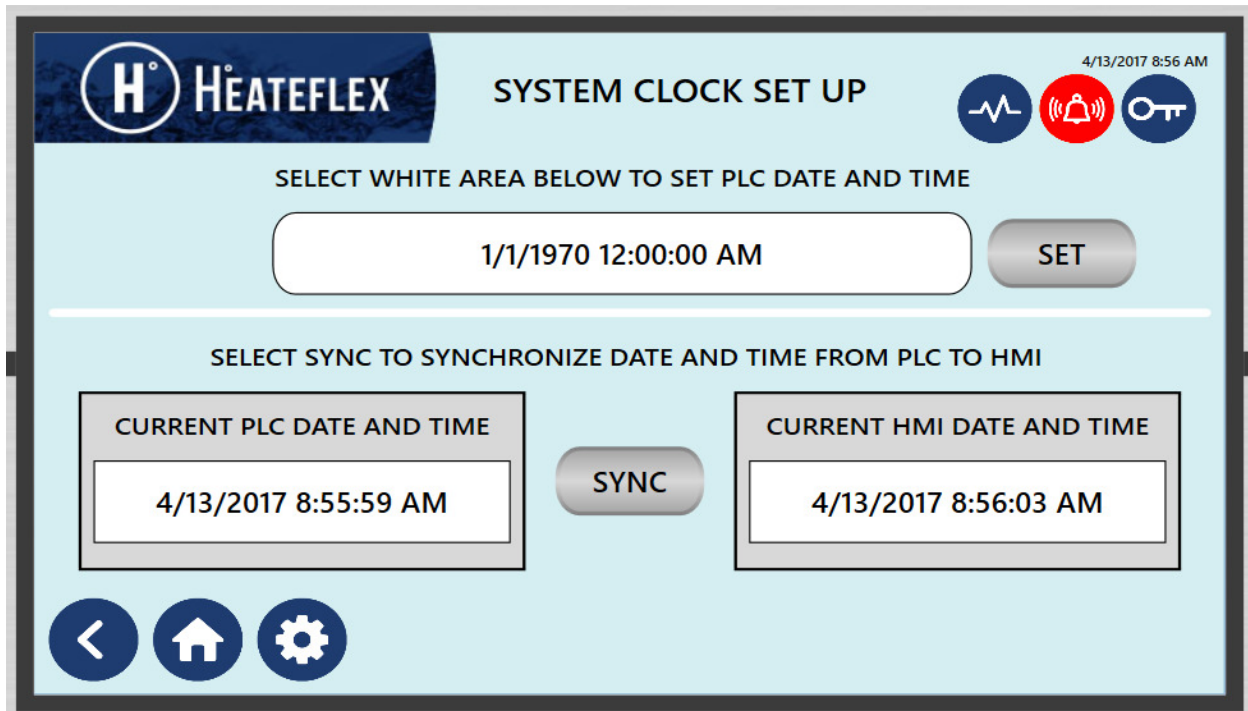Figure 4-1: System Clock Set Up Screen



The system will prompt you to enter the **User Password**. Once the correct password is entered, the date and time can be modified.

To change the date and time, select the white area left of the **SET** key. The **Set NA Calendar/Clock** window will display. The date and time can be entered using the drop-down menus labeled Day, Month, Year, Hour, Minute, and Second. Press **Enter** key to accept entered date and time.

After the current date and time has been entered in the white area, press the **SET** key to send the date and time value to the PLC.

After the current date and time has been entered in the PLC, press the **SYNC** key to send the changes to the HMI.

5. OPERATION

The basic function of the **PF3000** Controller is to provide hot D.I. water on demand. The unit continually monitors the flow sensor and once flow is detected by the flow sensor the heaters are turned on to a proportional power level that is calculated by the following formula:

$$KW = \frac{GPM \times \Delta T^{\circ}C}{3.79}$$

This formula utilizes the input thermocouple temperature and process set point temperature to calculate $\Delta T^{\circ}C$. The flow value in GPM is taken from the flow meter reading and the power or KW is adjusted by time proportioning the “on time” of the heaters in ratio to the time base set in the “**Cycle Rate**” (**CR**) parameter.

This value becomes the maximum KW that the system may utilize. Additionally, the actual percentage of power that is utilized is determined by the temperature control section utilizing the output thermocouple.

The temperature control section operates as an adjusting mechanism to the power requirement. It monitors the discharge temperature and compares it against the required set point. Based on the “**Power Reset**” (**PR**) parameter, it will adjust the power that is applied to the unit to bring the discharge temperature into complete compliance with the requirements. The “**Dead Band**” (**DB**) setting is utilized to establish a range above and below the set point in which the temperature control section will take no further action. This means that the **PR** parameter will adjust the power on a periodic basis and examine the temperature output to determine whether the temperature is within the customer specified control band. If the temperature is within this **DB**, it will leave the power alone. If the temperature is outside this **DB**, it will continue to adjust the power until the temperature is within the **DB**.

The **PF3000** has a large number of inputs and outputs. The main output is the silicon controlled relay drive to the heaters. This is a 12 VDC output signal that is active high. It has sufficient capacity to drive 10 solid-state relays. The alarm output is an open collector transistor that may be interfaced with an external alarm. The purge valve output is a form C relay. It will close either on automatic or manual purge.

When the system is powered ON, the **Main Menu** screen will appear and the unit will be in **STANDBY** mode. In this mode, all the keyboard operational features are active, the **Heater Master Relay** is inactive (normally open), and the **Heater Safety Relay** is active (normally closed). The Aquarius® D.I. Water Heating System is ready to process, provided that all the installation requirements have been fulfilled, including water flow through the unit system, the desired process temperature has been entered, and there are no “critical alarms” present. The “critical” alarms in the system are designated as manual reset alarms. When any of these “critical” alarms are triggered, the unit will go into **STANDBY** mode and the heaters will be disabled. The unit will not return to normal operation until after the alarm condition has been resolved and the operator has initiated the Alarm Reset manually reset by pressing the **ALARM RESET** key (located on the **Alarm Menu** screen or Alarm submenu screens) or via remote command. “Non-critical” alarms do not affect the system and serve only as a warning to the user.

Under normal operating conditions a minimum flow rate is required based on the size of the Aquarius® D.I. Water Heating System plumbing in order to process fluid (0.5 GPM for standard plumbing sizes). The Aquarius® D.I. Water Heating System has a special feature called “**Automatic Reset**” (**Auto Reset**) which allows the user to disable this minimum flow rate requirement. When the **Auto Reset** parameter is set to **ON**, the **Low Flow Alarm** will be disabled and the “**Low Flow Alarm Set Point**” will temporarily be set to 0 GPM. The system will automatically go from **STANDBY** mode to **ACTIVE** mode and start **HEATING** (indicated by the flickering light) when the system detects an adequate flow rate provided there are no critical alarms present. The unit will remain in **STANDBY** mode when a flow rate of 0.5 GPM or lower exists. In addition, when the **AR** parameter is set to **ON**, the previous “**Low Flow Alarm Set Point**” will be stored and re-entered once the **AR** parameter is set to **OFF**. In order to process fluid in the “**Automatic Reset**” mode the **AR** setting must be set to **ON** and the **RUN** key must be pressed.

The **PF3000** has two redundant relays dedicated to the **Master System Contactor** coil. This **Heater Master Relay** which is linked to the Safety PLC and is interlocked with a number of intelligent alarms. Depending on the type of “critical alarm”, the **Heater Master Relay** will open (if the system is processing) thus opening the **Master System Contactor** and disabling power to the heaters. In addition, if the unit is turned off, the power to the **Master System Contactor** will be disrupted, opening the **Heater Master Relay** and disabling power to the heaters. The Safety PLC is wired to two independent contact relays with relays wired in series to the **Master System Contactor**. This redundancy is to prevent a false contact condition.

The **Heater Safety Relay** is also interlocked with a number of intelligent alarms. Each of the “critical alarms” has the capability of disabling the **Heater Safety Relay**. As a result, when any of the “critical” alarms are triggered, they not only shut down the intelligent drive to the Silicon Controlled Rectifier (SCR), disable the **Heater Safety Relay** to provide an additional element of protection by mechanically eliminating the signal which controls power to the heaters.

The **PF3000** has an additional safety interlock feature that is transparent to its normal operation. If for some reason, the discharge temperature reaches 5°C higher than the process temperature set point, the heaters will be disabled. This is not announced as an alarm unless this temperature exceeds “**High Temperature Alarm**” setting. However, it is provided to ensure that the set point has overriding control over all of the automatic calculations. This provides additional first line protection against erroneous heater output due to conditions such as bad voltage or current sensors.

The Aquarius® D.I. Water Heating System has an optional **Auto Purge** feature that flushes or purges the unit after a programmable period of time where there is no demand for D.I. water. **Auto Purge** monitors the amount of time elapsed since leaving **ACTIVE** mode (i.e.: “No Flow Time”). If this amount of time exceeds the programmed “**Auto Purge Period**” (**AP**) parameter, the system is purged for the amount of time programmed in the “**Auto Purge Duration**” (**AD**) parameter. This cycle will continue until the Auto Purge feature is disabled or turned off. The system will continue to purge even if flow is detected while the unit is in **AUTO RESET** mode or **MANUAL** mode. Once the “**Auto Purge Period**” has elapsed, the unit will return to **AUTO RESET** mode. The purge cycle may be terminated prematurely by pressing the **PURGE** key located on the **System Status** screen. Note, to access the Purge Key, select the AP option key to display the Auto Purge User Selected Display. (The **PF3000** also supports a remote **Auto Purge** switch, which is available in the standard Ethernet Communications and Discrete Interface Package Option of the Auto Purge Option.) Please note that the heaters will be disabled during “**Auto Purge Duration**” time. See Section 11 for more details on Auto Purge.

For applications where monitoring process fluid purity levels are a concern, a **Resistivity** option is offered for the Aquarius® D.I. Water Heating Systems. The Resistivity option utilizes a standard Resistivity sensor with a cell constant of 0.01. It excites the sensor with an AC signal to prevent any interference due to electrolysis or secondary reactions with the electrode material. The standard cell has an extremely non-linear characteristic with respect to temperature. The transmitter has an extensive compensation algorithm to handle the standard 3D curve. It should be noted, that while the cell has an internal temperature sensor, heating the process fluid is not dependent on the resistivity readings of the system. The Low Resistivity Alarm is considered a non-critical alarm and will not affect the heaters.

The Aquarius® D.I. Water Heating Systems incorporate a large red emergency power off switch (EMO) and an optional remote emergency power off switch is also supported (See Discrete Interface Package Option). Each of these switches will produce the same effect. When the switch is pressed, the normally closed contacts will open which causes the Safety Relay to POWER OFF the entire system therefore interrupting power to the Master Contactor holding coil, and disabling the heaters.

5.1. SYSTEM STATUS SCREEN

The **System Status** screen shown below is used to monitor and operate the system. The **Mode Indicating Lamps** are used to distinguish the different system modes. In addition, the operator will also be notified of any alarm conditions that are present on this screen. When an alarm condition is present the alarm icon will be illuminated red. When the alarm is reset the alarm icon will be illuminated green. The **System Status Displays** provide values for the Voltage, Power, Purge (optional), Resistivity (optional), Recirculation (optional), Flow Rate, Pressure, Process Temperature, Set Point Temperature, and Incoming Temperature. The **Unit Change Keys** are used to easily switch from English units to metric or SI units or vice versa. The units **GPM**, **PSI**, and **F** can be changed to **LPM**, **kPa**, and **C** by clicking on the unit label. The **System Operation Keys** are used to “**RUN**” the system or alternatively to “**STOP**” the system from heating, manually initiate Auto Purge (if available), and enable Recirculation (if available). See Table 5-3 for more information. Note, Auto Purge, Resistivity, and Recirculation are optional features. These sub-menus can only be accessed if the option is available. Furthermore, the sub-menus for Power, Purge, Resistivity, and Recirculation cannot be displayed concurrently. The **System Screen Keys** are used to easily navigate to various system screens. See Figure 5-1 below for more detail.

Figure 5-1: System Status Screen

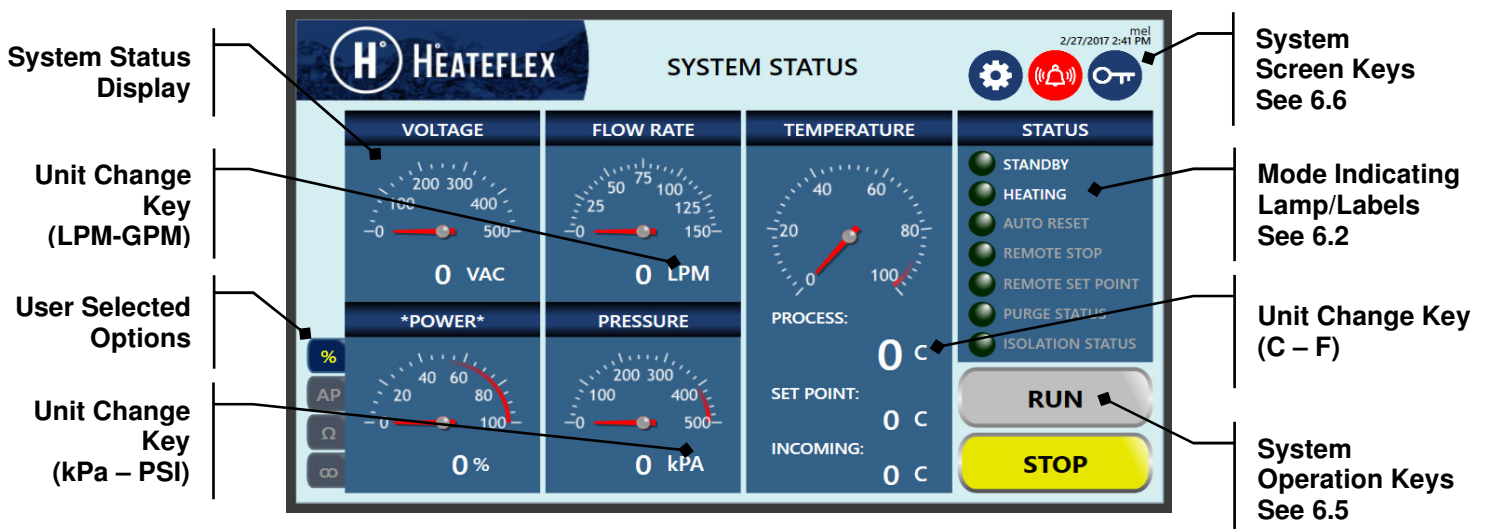


Figure 5-2: System Status Screen User Selection Keys

	Power Display (Standard – always available for selection)
	Purge Display (Optional – only available with Auto Purge option)
	Resistivity Display (Optional – only available with Resistivity option)
	Recirculation Display (Optional – only available with Recirculation)

Please note that the appearance of the **System Status** screen may vary depending on the Aquarius® D.I. Water Heating System options such as the **Resistivity, Auto Purge, Discrete Interface, Analog Interface Package (Remote Temperature Set Point), Secondary Process Temperature Set Point** and **Recirculation** that are present. Figure 5-3 through 5-5 illustrate a typical Aquarius® **System Status** screen with Auto Purge, Resistivity, and Recirculation options.

Figure 5-3: System Status Menu Screen w/ Auto Purge Selected


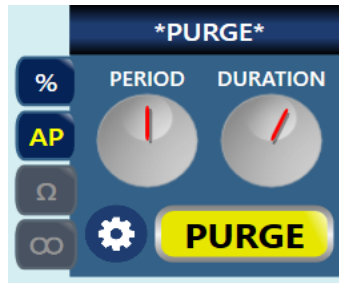


Figure 5-4: System Status Menu Screen w/ Resistivity Selected

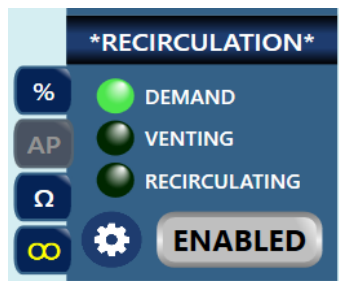

Figure 5-5: System Status Menu Screen w/ Recirculation Selected



5.2. MODE INDICATING LAMPS/LABELS

There are two primary modes which are indicated by lamps and labels on the **System Status** screen which are **STANDBY/ACTIVE** and **HEATING**. Additional mode indicating lamps/labels will appear based on the Aquarius® D.I. Water Heating System options. See Table 5-1 for a complete list of system status mode descriptions.

Table 5-1: System Status Modes

MODE LAMP	DESCRIPTION
STANDBY	When the system is first powered ON the unit will load into the STANDBY mode. In this mode, all of the keyboard operational features are active, but the Heater Master Relay is inactive (disabling all power to the heaters), and the Heater Safety Relay is active provided that there are no critical alarms present. The system is “standing by” and is ready to go into ACTIVE mode.
ACTIVE	This is the normal operating mode for the system. In this mode, if there are no critical alarms present and the required minimum flow rate is detected, the control system will meter power to the heaters to raise the output D.I. water temperature to the “ Process Temperature Set Point ” parameter. This mode is initiated by pressing the RUN key while in STANDBY mode. The STANDBY label will automatically switch to the ACTIVE label and a green indicating lamp will illuminate.
HEATING	This mode lamp indicates the status of the heaters. When the heaters are ON the lamp will flicker amber. This lamp will cycle as required by the system parameters.
AUTO RESET	This mode lamp is active if the AUTO RESET mode is enabled. This mode allows the user to disable the minimum flow requirement by automatically disabling the heaters when flow is near 0. The Low Flow Alarm is disabled, and the Low Flow Alarm Set Point is temporarily set to zero. The system will automatically reset when there is flow and no critical alarms are present.

MODE LAMP	DESCRIPTION
REMOTE STOP (Optional)	This mode lamp is active only if the Discrete Interface Package option is available. This mode lamp notifies the user when the unit is remotely stopped or placed into STANDBY . When the Remote Stop function is active this mode lamp will illuminate green.
REMOTE SET POINT (Optional)	This mode lamp is active only if the Ethernet Remote Set Point (available standard), Analog Remote Set Point (option) or Secondary Set Point (option) is active. This mode lamp notifies the operator whether the “ Process Temperature Set Point ” is being controlled locally or remotely. When the “ Process Temperature Set Point ” is being controlled locally the REMOTE SET POINT mode lamp will not be illuminated. When the system is being controlled remotely the REMOTE SET POINT mode lamp will illuminate green.
PURGE STATUS (Also located in User Selected Option Area when AP is selected)	This mode lamp is active only if the Auto Purge option is available. This mode lamp notifies the user as to the current status of the purging feature of the unit. When the system is automatically (Auto Purge) or manually purging this mode lamp will illuminate green.
ISOLATION STATUS (Optional)	This mode lamp is active only if the Water Leaks with Isolation Valves option is available and enabled. This mode lamp notifies the user when the isolation valves are active as a result of the detection of a user specified critical leak condition.
RECIRC MODE (Optional)	This mode lamp is active only if the Recirculation option is available and enabled. This mode lamp notifies the user when the system is in recirculation mode.
DEMAND, VENTING, RECIRCULATION (Located in User Selected Option Area when ∞ is selected)	<p>The following mode lamps are only accessible if the Recirculation option is available.</p> <ul style="list-style-type: none"> • DEMAND: This mode lamp/label notifies the operator that the unit is in DEMAND mode and will illuminate green when active. • VENTING: This mode lamp/label notifies the operator that the unit is in VENTING mode and will illuminate green when active. • RECIRCULATION: This mode lamp/label notifies the operator that the unit is in RECIRCULATION mode and will illuminate green when active.

5.3. SYSTEM STATUS DISPLAY

The **System Status Display** allows the operator to monitor the real time values for the **Process Temperature, Incoming Temperature, Flow Rate, Pressure, Voltage, Power, and Resistivity** (Optional). The **System Status Display** also includes functional features for **Recirculation** and **Auto-purge** options. The read only value for the **Temperature Set Point** is also displayed.

Table 5-2: System Status Display

DISPLAY	DESCRIPTION	UNITS
Temperature Set Point	The temperature set point of the process D.I. water discharge.	°C (default) or °F
Process Temperature	The actual temperature of the process D.I. water discharge.	°C (default) or °F
Incoming Temperature	The incoming or input temperature of the process D.I. water discharge.	°C (default) or °F
Flow Rate	The flow rate of the process D.I. water discharge.	Gpm (default) or lpm
Pressure	The pressure of the system.	Psi (default) or kPa
Voltage	The voltage of the system.	Volts (AC)
Power	The percentage of power delivered to the heater modules.	%
Resistivity (Located in User Selected Option Area when Ω is selected)	The resistivity of the system.	Mega Ohms
Recirculation (Located in User Selected Option Area when ∞ is selected)	The recirculation mode.	Demand, Venting, or Recirculating
Auto Purge (Located in User Selected Option Area when AP is selected)	The purge period and duration, and the manual purge button.	% of Elapsed Time to Total Time

5.4. UNIT CHANGE KEY

The units for the **Temperature Set Point**, **Process Temperature**, **Incoming Temperature**, **Flow Rate**, and **Pressure** on the **System Status Display** can be changed from English units to Metric units or vice versa. To change the units, press the “unit description” located in the lower area of the respective box. This is indicated in Figure 5-1.

Note: The “**Unit Change Keys**” are available and functional only on the **System Status** screen and **Trend Graph** screen. All parameters and set points need to be entered according to the unit description on the parameter/set point label.

5.5. SYSTEM SCREEN KEYS

The **System Screen Keys** are used to go to various system screens such as the **Main Menu**, **Alarm Menu**, **System Set Up Menu**, and/or the **Trend Graph** screens when present. The **Alarm Menu** key will also notify the operator of any alarm conditions that are present (critical or non-critical). When there are no alarms present, the **Alarm Menu** key lamp will illuminate green. When a critical alarm is present the **Alarm Menu** key lamp will illuminate red, while if a non-critical alarm is present **Alarm Menu** key lamp will illuminate yellow. In the instance that both a critical and non-critical alarm is present at the same time, any critical alarm that is present will supersede any of the non-critical alarms and will the lamp will illuminate red. For a complete list o

Note: The system may or may not go into **STANDBY** depending on the alarm type (critical or non-critical) or if **Automatic Reset** is enabled.

5.6. SYSTEM OPERATION KEYS

The **System Operation** keys give the operator control over the Aquarius® D.I. Water Heating System functions and features such as heating, purging, and recirculation.

The Purge and Enable/Disable (Recirculation) keys, shown in Figure 5 3 and Figure 5 5, are available only when these options are installed on the unit.

Table 5-3: System Status Operation Keys

KEY	DESCRIPTION
RUN	This key is used to switch the system from STANDBY mode to ACTIVE mode. While in STANDBY mode, depression of this key will activate the system and the heater modules. This key will illuminate yellow when the system is in ACTIVE mode.
STOP	This key is used to switch the system from ACTIVE mode to STANDBY mode. While in ACTIVE mode, depression of this key will deactivate the system and the heater modules. This key will illuminate when the system is in STANDBY mode.
PURGE (Located in User Selected Option Area when AP is selected)	This key is used to initiate manual purging. Depression of the PURGE key will activate the purging feature of the system. The system will continue purging until the PURGE key is pressed again to deactivate purging.
PURGE SETUP (Located in User Selected Option Area when AP is selected)	This key is used to access the Purge Mode Screen. See Section 11 for more information.
RECIRCULATION ENABLED/DISABLED (Located in User Selected Option Area when ∞ is selected)	This key is used to enable or disable the recirculation system. The recirculation system is enabled by pressing the ENABLED/DISABLED key. The recirculation system is enabled when the ENABLED label is displayed and illuminated yellow and disabled when the DISABLED label is displayed.

6. SYSTEM SET UP

The values that are entered into the various program settings, parameters and set points determine the actual operation of the system. While many of the parameters and set points will be specifically dictated by user requirements, the purpose of this section is to give a general indication of the meaning and effect of the control parameters.

The “**Process Temperature Set Point**” is the primary temperature control parameter for the system. This is the desired discharged temperature. It serves as the target around which all of the other control parameters function.

The Power-To-Flow® Control computations are based on the readings taken from the Flow Sensor, the Input Thermocouple, the Process Thermocouple(s) and the Line Voltage. These inputs are used in conjunction with the “**Heater Amperage**” (**HA**) setting to compute the heater “on time”. The **HA** parameter should be set to the nominal heater amperage at rated line voltage. This setting will allow the unit to compute the nominal available KW. Variations in the line voltage will allow the adjustment of this figure, should other than expected line voltages exist. It is recommended to match the **HA** parameter to the measured amperage of the overall unit while in ramp up / full on condition.

The Power-To-Flow® section automatically computes the first approximation of the KW required to establish the desired discharge temperature. The “**Power Reset**” (**PR**) parameter is utilized in conjunction with the “**Dead Band**” (**DB**) parameter to adjust further computations to compensate for any error that might exist. The **DB** setting should be made to establish a satisfaction band for the system. If, for example, it is desirable to maintain the discharge temperatures to within + or – 1.0 degrees, then the **DB** should be set to 1.0. This will inhibit any further adjustment when the temperature is within this tolerance band. Initially, it would appear that the tighter this band, the better the control. However, it should be noted that depending on system operations, if the band becomes too small, the system will simply oscillate, rather than becoming stable.

The **PR** parameter is the primary temperature compensation for the system. It functions much like the Reset parameter in a standard three-mode control algorithm. However, in this algorithm, the **PR** parameter actually adjusts the output power of the system to compensate for errors in discharge temperature. The **PR** setting is adjusted in seconds and roughly indicates the period at which power adjustments will be made in an attempt to compensate for errors in the discharge temperature. As an example, if the parameter is set to 30 seconds, the system will make an adjustment in the system power once every 30 seconds in a positive or negative direction depending on whether the discharge temperature is below or above the process temperature.

The control loop is capable of adjusting the power to the nearest half cycle. Therefore, at 60 Hz., this amounts to 120 half cycle adjustments every second. If the “**Cycle Rate**” (**CR**) parameter is set to one second, there are 120 power adjustments that can be made. This is approximately a 1 percent resolution. If **CR** is set to 2 seconds, there are 240 adjustment points corresponding to approximately 0.4 percent resolution.

The **PR** parameter will make an adjustment of 1 resolution point after each time-out. Therefore, in a system with a **CR** of 1 second and a **PR** of 30 seconds, the system will adjust out at the rate of approximately 1 percent per 30 seconds. If the **CR** is increased to 2 seconds, this means that every 30 seconds the power is adjusted by approximately 0.4 percent (1/240).

In setting the **PR** parameter, it is desirable to examine the throughput for the system. The initial setting for this parameter should be such that the effect of the power change can be seen by the output sensor, prior to its making another change. In essence, this dictates the time that is approximately equal to the throughput time for a given system.

To compensate for this, the unit automatically adjusts the **PR** parameter in an inverse ratio to the flow. The **PR** setting should be made initially with the flow of 1 GPM. The system will then take this value and adjust it in accordance with varying flows. For example, when the flow is 2 GPM, the **PR** parameter will be cut in half.

The net effect of the **PR** parameter is that it will compute a necessary addition or subtraction to the required KW to match the discharge temperature to the “**Process Temperature Set Point**”. The “**Power Adjust**” (**PA**) parameter is provided as a manual reset function for the system. The **PA** setting allows the user to directly input the offset to the power formula, if desirable. This setting is normally not necessary, but may be utilized, if it is found that for some reason, the system has either a fixed over temperature or under temperature initialization. The **PR** parameter will eventually adjust this error out, but if it is desirable to decrease the settling time, the **PA** parameter may be set. The net effect will be that the Power-to-Flow® computation will be completed and the **PA** parameter will be added to this computation as a percentage power, just as the **PR** parameter previously described. However, the **PA** parameter will not vary and will serve as a fixed constant in this computation. The **PR** parameter will continue to adjust and fine tune, if necessary, regardless of the setting of the **PA** parameter.


6.1. SYSTEM SET UP MENU

This is a guide to navigate through the **System Set Up** menus. To access the **System Set Up Menu** screen, start with the **Main Menu** screen, then select **System Set Up**. The **System Set Up Menu** screen (Figure 6-1) will appear and give you access to the following set up menus: **CONTROL SETTINGS**, **ALARM SET POINTS**, **SYSTEM CALIBRATION**, **FACTORY SETUP**, **ETHERNET INTERFACE**, and **OPTION SETTINGS**.

Notes:

- The **CONTROLLER TROUBLESHOOTING**, **SYSTEM INPUTS**, **SYSTEM OUTPUTS**, **SAFETY PLC (I/O)**, and **SYSTEM PERFORMANCE** screens will be inaccessible without Manager (Level 3) Password.
- The **FACTORY SETUP** screens will be inaccessible without Factory Password. This screens are intended for Factory Use Only.

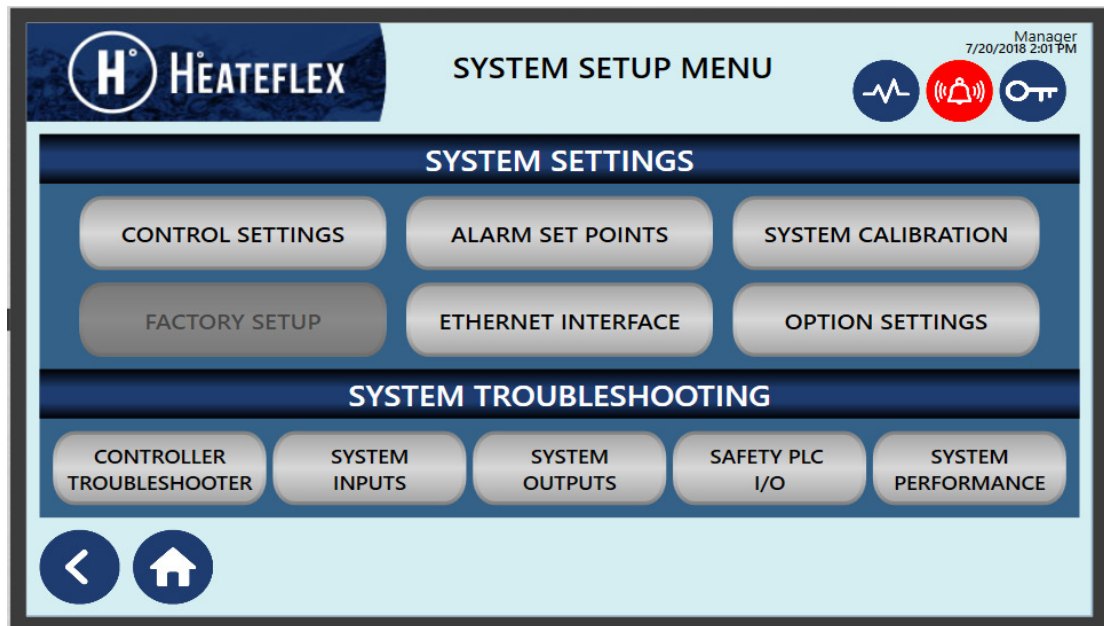Figure 6-1: System Setup Menu Screen




6.2. CONTROL SETTINGS SCREEN

A number of parameters are used to control the temperature of the process D.I. water discharge. To modify the values of any of these parameters, first Login (all parameters available on the **Control Settings** screen can be accessed by Level 1 users and higher), press the box with the value of the parameter to be changed (See Figure 6-2).

For the **Process Temperature Set Point**, **Heater Amperage**, **Cycle Rate**, **Power Reset**, **Dead Band**, and **Power Adjust** parameters, a number pad will appear so that the user can enter a numerical value. Enter the desired value, and press the **Enter** key. The desired value for the selected parameter will be stored. The **Frequency** and **Auto Reset** parameters are toggle switches and will toggle between their available values. Table 6-1 details all the parameters that can be modified on this screen.

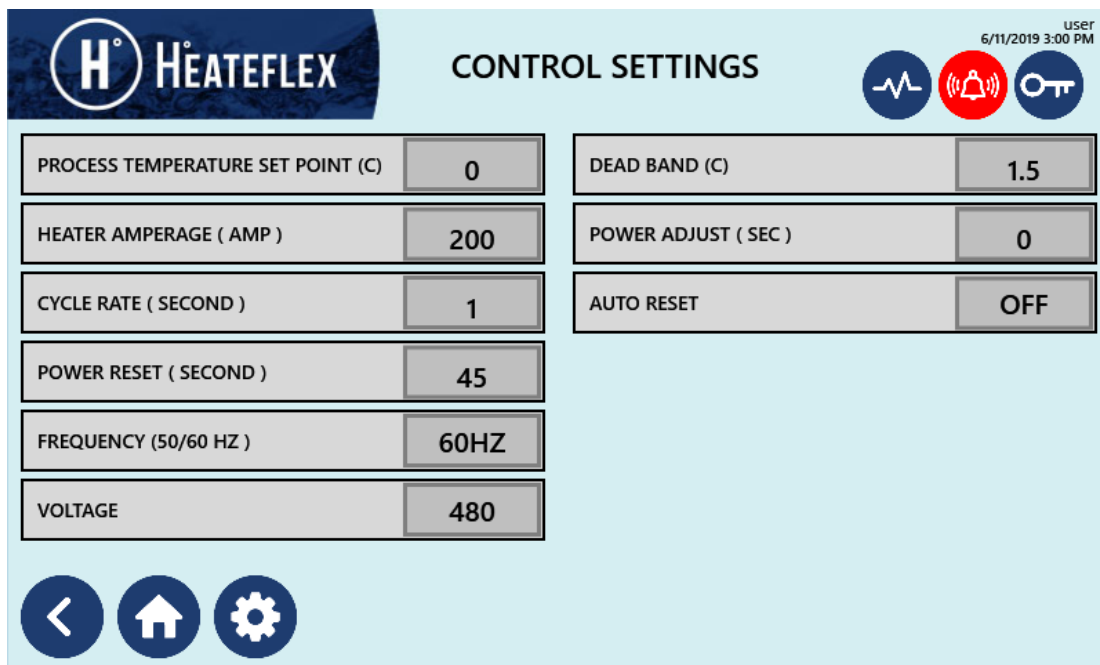Figure 6-2: Control Settings Screen



CONTROL SETTINGS	
PROCESS TEMPERATURE SET POINT (C)	0
HEATER AMPERAGE (AMP)	200
CYCLE RATE (SECOND)	1
POWER RESET (SECOND)	45
FREQUENCY (50/60 HZ)	60HZ
VOLTAGE	480
DEAD BAND (C)	1.5
POWER ADJUST (SEC)	0
AUTO RESET	OFF

Note: The appearance of the **Control Settings** screen may vary depending on the Aquarius® D.I. Water Heating System options.

Table 6-1: Control Settings Parameters and Ranges

PARAMETER NAME	SETTING RANGE	FACTORY DEFAULT
Process Temperature Set Point	0 to 95 °C (Integers only)	0 °C
Heater Amperage (HA)	0 to 400 Amps (Integers only)	Varies unit to unit
Cycle Rate (CR)	1 or 2 sec (Integers only)	1 sec
Power Reset (PR)	30 to 90 sec (Integers only)	45 sec
Dead Band (DB)	1.0 to 4.0 °C	1.5 °C
Power Adjust (PA)	Minus 99 to Plus 99 (Integers only)	Plus 0
Frequency	50 or 60 Hz.	60 Hz.
Auto Reset	Off or On	Off

Note:


1. The **Voltage Selection Set Up** is for Factory Use Only and is inaccessible to the customer.
2. The Low Flow Alarm is not active when Auto Reset is set to ON or enabled.

The **Process Temperature Set Point** value that is inputted in the **Control Settings** screen is the systems **Local Process Temperature Set Point**. The value inputted will be displayed in the **Temperature Set Points Options** screen (see Figure 15-1) under the **Local** value. Reference Section 15 for more instructions on Temperature Set Points. The different types of **Process Temperature Set Point** can be activated from a selection shown on the **Temperature Set Points Options** screen.

6.3. ALARM SET POINTS SCREEN

The Alarm Set Points screen displays the Alarm Set Points and Current Values for the **Process Temperature, Flow Rate, Pressure, and Resistivity** (optional). There are two groups of alarms set points shown on this screen, Local Set Points and Ethernet Set Points. The active group will show the title in black (as “Local Set Points” is shown in Figure 6-3 below) and the inactive set will have the title shown in gray (as “Ethernet Set Points” is shown in Figure 6-3 below). A number of alarm set points may be set in this screen. To modify the local values of any of these set points, the user must be logged in. See Section 3.1 for more details on how to Log In. Once the user is logged in, the local alarm set points can now be changed. Press the box with the value of the alarm to be changed in the Local Set Points column (See Figure 6-3). Enter the desired value using the number pad, and press then **Enter** key. The desired value for the selected alarm set point will be stored. Table 6-2 details all the alarm set points that can be modified on this screen. To modify the Ethernet Set Points please see Section 11 for the Ethernet Communications.

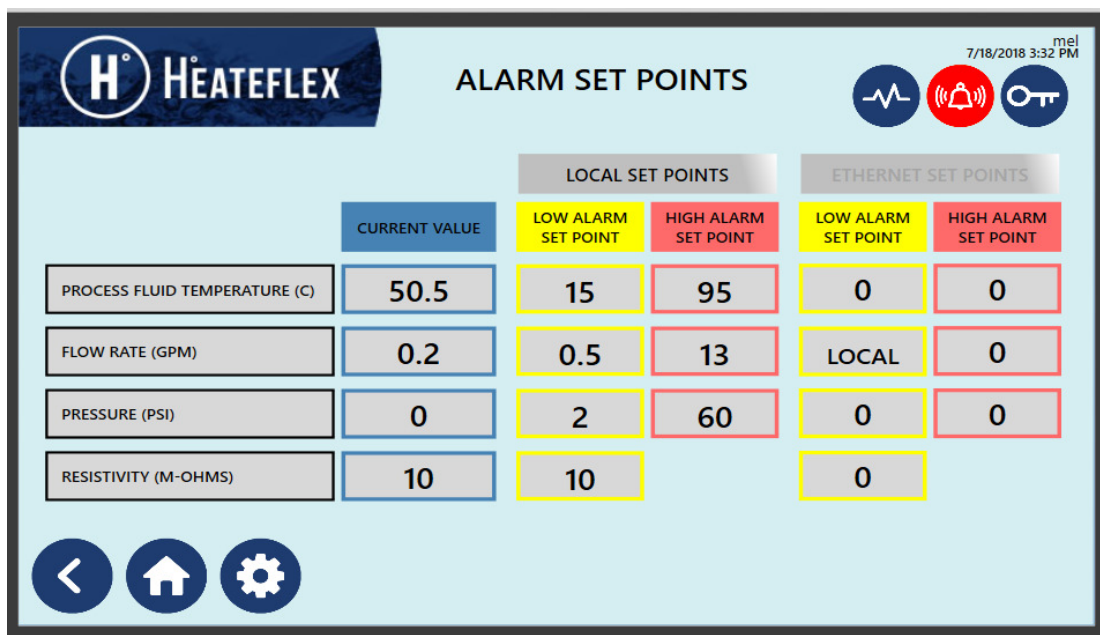Figure 6-3: Alarm Set Points Screen



Note: The appearance of the **Alarm Set Points** screen may vary depending on the Aquarius® D.I. Water Heating System options.

Table 6-2: Alarm Set Point Ranges

PARAMETER NAME	SETTING RANGE	FACTORY DEFAULT
Low Temperature Alarm	0.0 to 98.0 °C	20.0 °C
High Temperature Alarm	0.0 to 98.0 °C	95.0 °C
Low Flow Alarm ★	Min Flow to Max Flow	Min Flow
High Flow Alarm ★	0.0 to Max Flow	Max Flow
Low Pressure Alarm	0.0 to 80.0 psi	2.0 psi
High Pressure Alarm	0.0 to 80.0 psi	60.0 psi
Low Resistivity Alarm (Optional)	0.0-20.0 M-Ohms	10.0 M-Ohms

★ Based on plumbing size, see Table 6-3 below.


Table 6-3: Plumbing and Minimum/Maximum Flow Rates

Flow Sensor Tee Connector Type	Minimum Flow [gpm]	Maximum Flow [gpm]
3/4" Flare, 5/8" I.D.	0.5	13.0
32mm Pipe, 2.4mm wall	1.0	18.0
40mm Pipe, 2.4mm wall	1.0	32.0

6.4. OPTIONS SCREEN

All of the optional features for the **PF3000** can be modified on the respective option screen by pressing the **OPTION SETTINGS** key on the **System Setup Menu** screen to access the **Option Settings** screen, which is shown in Figure 6-4 below. Note that this screen may vary depending on the options available. Select the option you wish to modify by pressing the respective key, i.e. depression of the **PURGE** key will switch to the **PURGE MODE** screen, as shown in Figure 12-1. To modify the values of any of these settings, the user must be logged in. See Section 3.1 for more details on how to Log In. Once the user is logged in. Access to the parameters and set points displayed on this screen will depend on the model and selected options for the Aquarius® D.I. Water Heating System. Inactive parameters are designated by a greyed colored button, see Recirculation button in Figure 6-4 as an inactive button example. See the Aquarius® D.I. Water Heating System Instruction Manual for a complete list and more information on **PF3000** optional features.

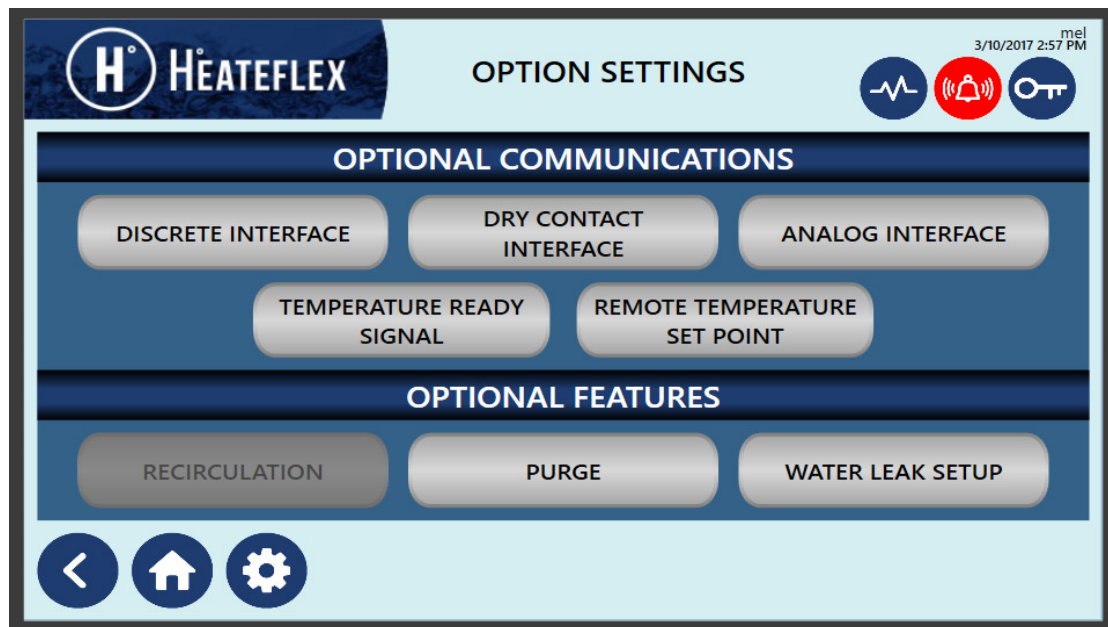
Figure 6-4: Option Settings Screen



6.5. SYSTEM CALIBRATION SCREEN

The **System Calibration** screen (See Figure 6-5) is used to calibrate the system and to further compensate for any potential errors. This screen allows the user to adjust the reading from the following analog sensors or thermocouples: flow sensor, pressure transducer, voltage transducer, incoming temperature thermocouple, process temperature thermocouple, and optional resistivity sensor. To modify the calibration values of any of these sensors, the user must be logged in. See Section 3.1 for more details on how to Log In. Once the user is logged in, press the box with the value of the sensor to be calibrated. Enter the desired value using the displayed number pad, and press the **Enter** key. The desired calibration value for the sensor will be stored. Table 6-4 details all the sensors that can be calibrated in this screen.

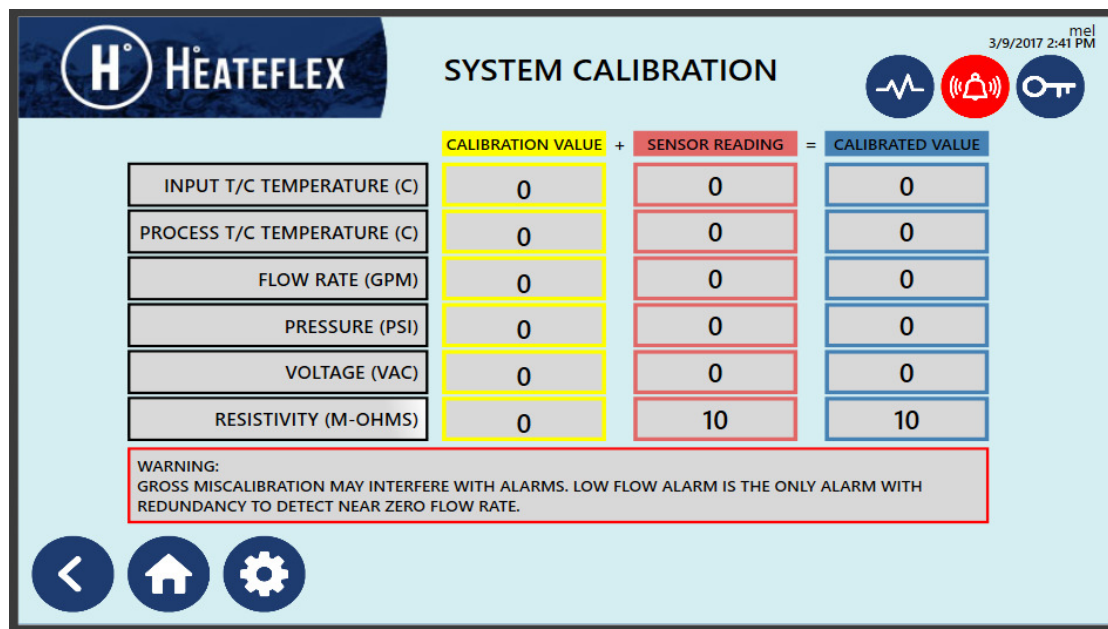Figure 6-5: System Calibration Screen



	CALIBRATION VALUE	+	SENSOR READING	=	CALIBRATED VALUE
INPUT T/C TEMPERATURE (C)	0		0		0
PROCESS T/C TEMPERATURE (C)	0		0		0
FLOW RATE (GPM)	0		0		0
PRESSURE (PSI)	0		0		0
VOLTAGE (VAC)	0		0		0
RESISTIVITY (M-OHMS)	0		10		10

WARNING:
GROSS MISCALIBRATION MAY INTERFERE WITH ALARMS. LOW FLOW ALARM IS THE ONLY ALARM WITH REDUNDANCY TO DETECT NEAR ZERO FLOW RATE.

Note: The appearance of the **System Calibration** screen may vary depending on the Aquarius® D.I. Water Heating System options.

Table 6-4: System Calibration Ranges

SENSOR	CALIBRATION RANGE
Incoming Thermocouple	-10.0 to +10.0 °C
Process Thermocouple	-10.0 to +10.0 °C
Flow Sensor	-2.0 to +4.0 gpm
Pressure Transducer	-5.0 to +5.0 psi
Voltage Transducer	-20 to +20 VAC (Integers Only)
Resistivity Sensor (Optional)	-5.0 to + 5.0 M-Ohms

Note:

- 1) The calibration for the resistivity sensor is available only if the Resistivity option is available.

7. ALARM MENU


Various **Alarm** conditions are activated by many sources and are annunciated by the screen displays and by an audio tone. The flashing **ALARM MENU** key or illuminated lamp indicates that an **Alarm** condition has occurred. The alarms are either classified as “non-critical” or “critical”. For more information on which alarms are “critical” or “non-critical” see Table 7-1. The non-critical alarms are automatic reset alarm types and will automatically be cleared by the **PF3000** when the alarm condition is no longer present. The non-critical alarms have no effect on the operation of the system and serves as a warning only. The critical alarms are manual reset alarm types. The critical alarms directly affect the operation of the system in various ways depending on the alarm that is triggered. All of the critical alarms when triggered will automatically send the unit from **ACTIVE** mode into **STANDBY** mode and shut off the signal to the heaters. The alarm condition needs to be resolved and a manual reset is required in order to return to normal operation. The critical **Alarm** triggered may remain active even after the condition has disappeared or resolved. To clear the alarm condition the **ALARM RESET** key must be pressed, which is located on the **Alarm Menu** screen and on all of the alarm description screens. Note that if any of the critical alarms has disabled the heaters, they will remain disabled to protect the equipment from any potential damage. In order to start processing the **RUN** key must be pressed.

All of the alarms activate an audio tone regardless of alarm type. If any alarms are present a solid red or yellow respective **Alarm Indicating Lamp** located on the **Alarm Menu** screen (shown in Figure 7-1 to 7-2) will appear. In addition, the **ALARM MENU** key will flicker yellow for non-critical alarms and red for critical alarms on various screens. The non-critical alarms are superseded by critical alarms in any situation when both alarm types are present. The **ALARM MENU** key is located on the **Main Menu** screen and top right hand corner of all the screens but the **Main Menu** screen. The audio tone and the **ALARM MENU** key alternate ON and OFF to draw attention to the alarm. Depression of the **SILENCE ALARM** key temporarily eliminates the audio alarm. However, the **Alarm** keys and **ALARM MENU** key will continue to flash to annunciate the alarm condition.

A **Heater Master Relay** and **Heater Safety Relay** are provided as an additional mechanical interlock for the critical alarms. The **Heater Master Relay** is a normally open relay that is wired in series to control the **Master System Contactor**. When the system is processing the **Heater Master Relay** will close, thus providing power through the contactor. The **Heater Master Relay** will open, and shut off power to the heaters when specific critical alarms are triggered. The **Heater Safety Relay** is normally closed when no critical alarms are present. Should any of the critical alarms become active the **Heater Safety Relay** will open and drop out the relay. These relays may only be reset by a manual depression of the **ALARM RESET** key after the alarm condition has been cleared. For more information on which alarms effect the **Heater Master Relay** or the **Heater Safety Relay** see Table 7-1.

To determine which alarm has been activated, touch the **ALARM MENU** key to access the **Alarm Menu** screen (shown in Figure 7-1). This screen lists the different alarms of the system. Non-critical alarms that are active will be illuminated yellow, while critical alarms will be illuminated red. See Table 7-1 for detailed information on the various alarms. If Recirculation option is present, press the **NEXT** key to move to the next **Alarm Menu** screen.

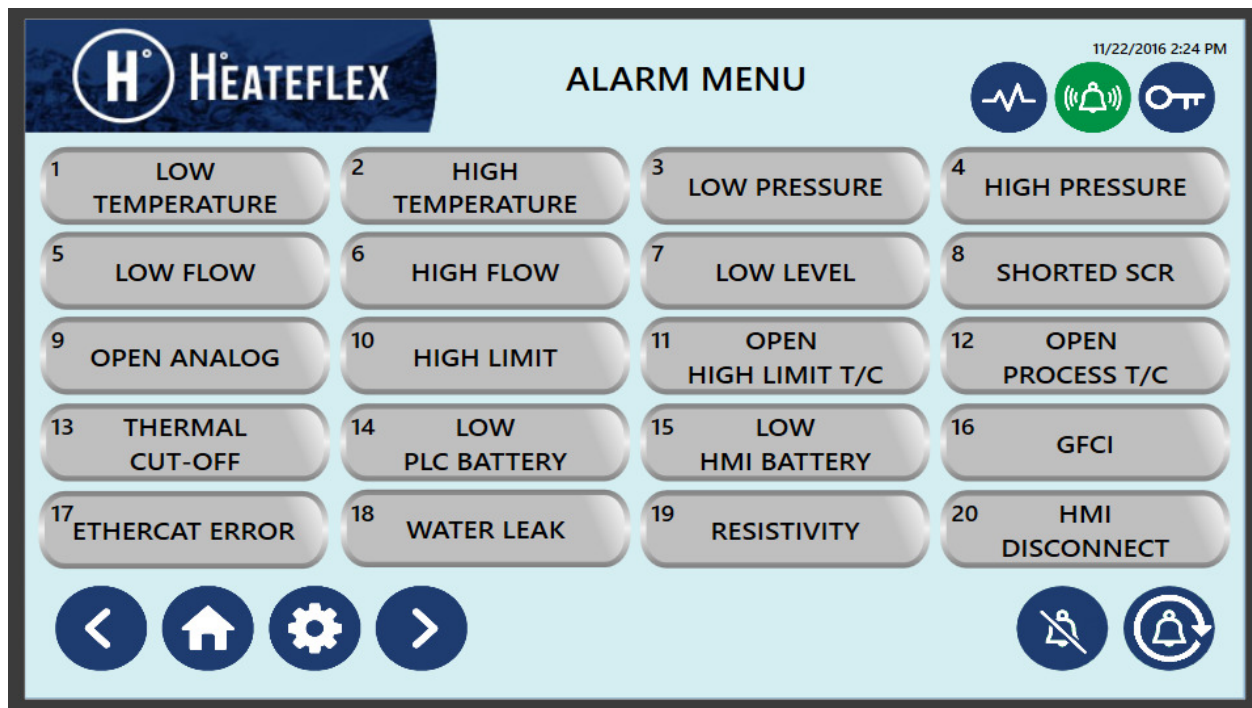Figure 7-1: Alarm Menu Screen 1



Note: Not all of the **Alarms** will be active if the option is not installed in the unit. This is designated by a greyed box.

For alarm description and troubleshooting tips press on the alarm key corresponding to the alarm in question. The alarm screen will open with the **DESCRIPTION** tab open. See Figure 7-2 for a typical alarm description screen. To view troubleshooting suggestions, select the **TROUBLESHOOTING** tab towards the top of the screen. Figure 7-3 for a typical alarm troubleshooting screen. The active tab will be highlighted in blue with white lettering. Inactive tabs will be white with black lettering.

Figure 7-2: Typical Alarm Description Screen


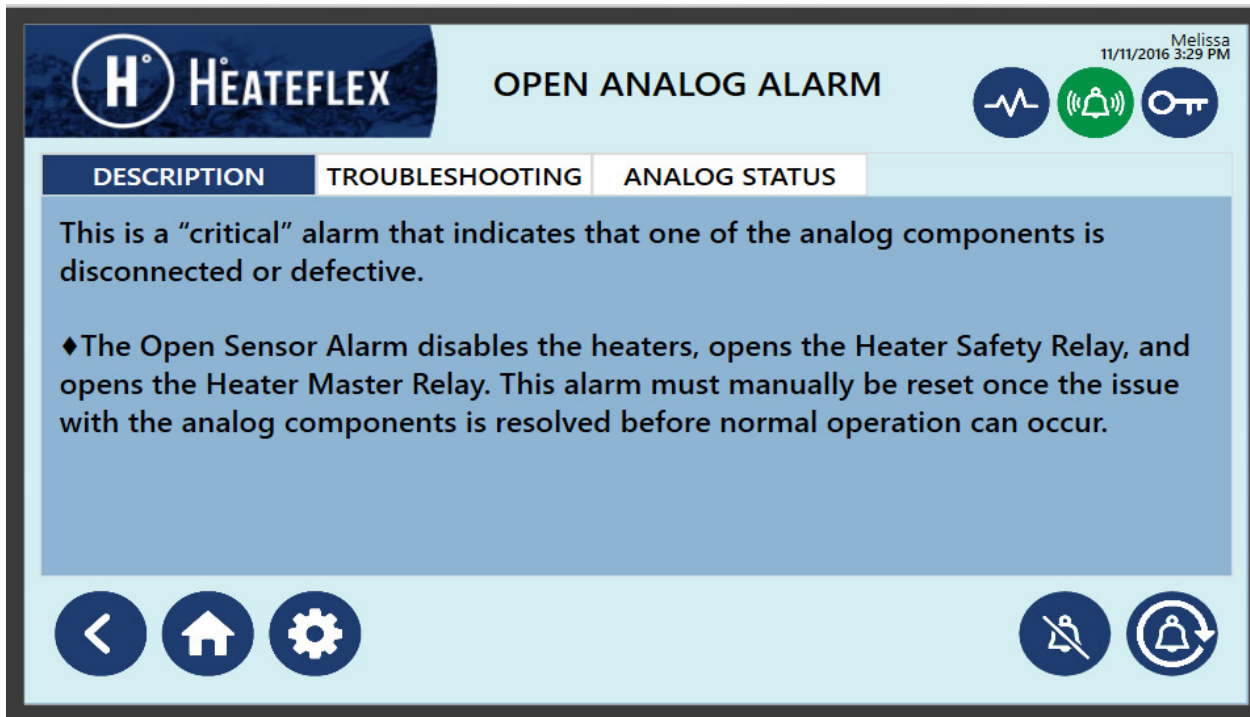


Figure 7-3: Typical Alarm Troubleshooting Screen

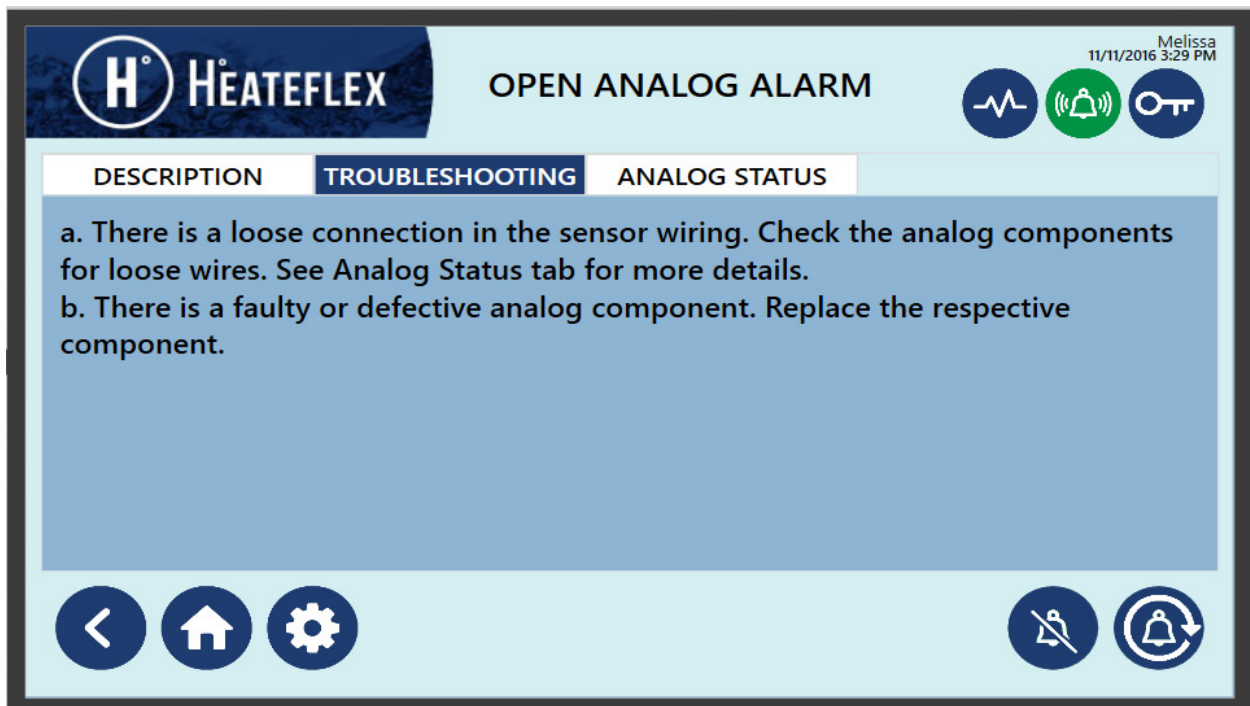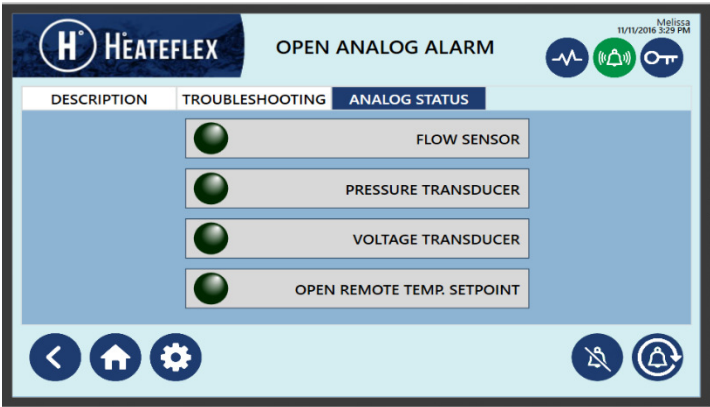


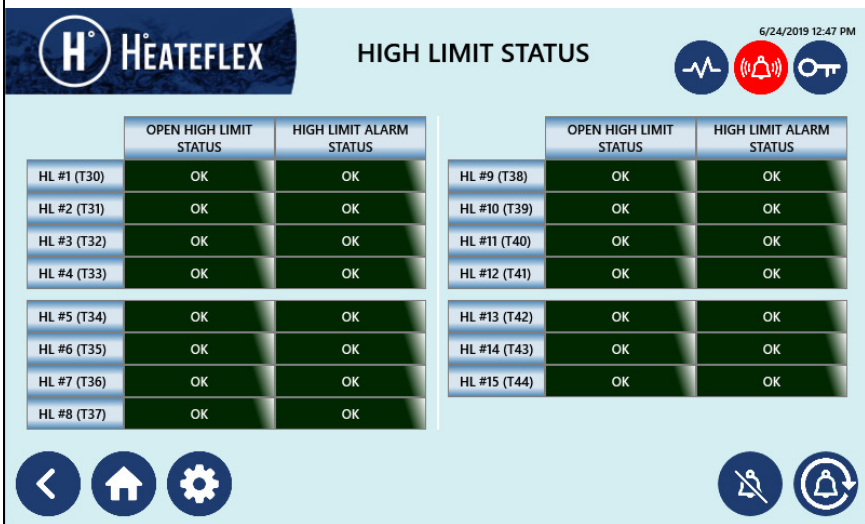
The **SILENCE ALARM** key is located on all of these types of screens while the **ALARM RESET** key appears on “critical” or manual reset alarm type screens. In addition several alarm types contain additional screen to provide more information about the alarm condition, such as the **Open Analog Sensor**, **High Limit T/C**, **Open High Limit T/C**, **Open Process T/C**, and the **Resistivity** (Optional). To access these additional screens press the respective tab key on the alarm screen.

Table 7-1: Alarm Description and Troubleshooting


ALARM	DESCRIPTION/TROUBLESHOOTING
Low Temperature	<ul style="list-style-type: none"> ❖ Description This is a “non-critical” alarm that indicates a process fluid temperature below the “Low Temperature Alarm Set Point”. ★ The Low Temperature Alarm does not disable the heaters and automatically resets once the temperature is above the “Low Temperature Alarm Set Point”. ❖ Troubleshooting <ul style="list-style-type: none"> a. The “Low Temperature Alarm Set Point” is set too high. b. The “Process Temperature Set Point” is set too low.
High Temperature ★	<ul style="list-style-type: none"> ❖ Description This is a “critical” alarm that indicates a process fluid temperature exceeding the “High Temperature Alarm Set Point”. ★ The High Temperature Alarm disables the heaters, opens the Heater Safety Relay and must be manually reset once the temperature is below the “High Temperature Alarm Set Point” before normal operation can occur. ❖ Troubleshooting <ul style="list-style-type: none"> a. The “High Temperature Alarm Set Point” is set too low. b. The “Process Temperature Set Point” is set too high.
Low Pressure	<ul style="list-style-type: none"> ❖ Description This is a “non-critical” alarm that indicates a system pressure below the “Low Pressure Alarm Set Point”. ★ The Low Pressure Alarm does not disable the heaters and automatically resets once the system pressure is above the “Low Pressure Alarm Set Point”. ❖ Troubleshooting <ul style="list-style-type: none"> a. Incoming pressure to the unit is too low. Increase the incoming pressure. b. The “Low Pressure Alarm Set Point” is set too high. c. The pressure transducer is faulty or defective. Replace the pressure transducer.


ALARM	DESCRIPTION/TROUBLESHOOTING
High Pressure★	<p>❖ Description This is a “critical” alarm that indicates a system pressure exceeding the “High Pressure Alarm Set Point”.</p> <p>★The High Pressure Alarm disables the heaters, opens the Heater Safety Relay and must manually be reset once the system pressure is below the “High Pressure Alarm Set Point” before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> Incoming pressure to the unit is too high. Regulate the incoming pressure. The “High Pressure Alarm Set Point” is set too low. The pressure transducer is faulty or defective. Replace the pressure transducer.
Low Flow★	<p>❖ Description This is a “critical” alarm that indicates a flow rate below the “Low Flow Alarm Set Point”.</p> <p>★The Low Flow Alarm disables the heaters, opens the Heater Safety Relay and must manually be reset once the flow rate is above the “Low Flow Alarm Set Point” before normal operation can occur.</p> <p>★When the “Automatic Reset” function is ON. The Low Flow Alarm will be disabled.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> Verify that there is fluid flow through the unit. The “Low Flow Alarm Set Point” is set too high. The flow sensor is not calibrated properly. Calibrate the flow sensor. The flow sensor is faulty or defective. Replace the flow sensor. Verify that the input solenoid valve is operational.
High Flow	<p>❖ Description This is a “non-critical” alarm that indicates a flow rate exceeding the “High Flow Alarm Set Point”.</p> <p>★The High Flow Alarm does not disable the heaters and automatically resets once the flow rate is below the “High Flow Alarm Set Point”.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> Verify that the flow sensor is connected. The flow sensor is not calibrated properly. Calibrate the flow sensor. The “High Flow Alarm Set Point”. Is set too low. The flow sensor is faulty or defective. Replace the flow sensor.
Low Level★	<p>❖ Description This is a “critical” alarm that indicates a low fluid level condition in the unit.</p> <p>★The Low Level Alarm disables the heaters, opens the Heater Safety Relay and must manually be reset once the liquid level sensor detects fluid before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> Verify that the fluid is flowing through the unit. Adjust the sensitivity of the liquid level sensor. There is a loose connection in the sensor wiring. Check the sensor for loose wires. Check the valves and solenoid valves. There is a faulty sensor or sensor failure. Replace the sensor.

ALARM	DESCRIPTION/TROUBLESHOOTING
Shorted SCR Alarm ★	<ul style="list-style-type: none"> ❖ Description This is a “critical” alarm that indicates failure in at least one of the heater silicon controlled rectifier (SCR). ★The Shorted SCR Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the issue with the SCR is resolved before normal operation can occur. ❖ Troubleshooting <ul style="list-style-type: none"> a. There is a loose connection in the electrical wiring. Check the sensor for loose wires. ❖ There is a faulty or defective SSR. Replace the respective component.
Open Analog ★	<ul style="list-style-type: none"> ❖ Description This is a “critical” alarm that indicates that one of the analog components is disconnected or defective. ★The Open Sensor Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the issue with the analog components is resolved before normal operation can occur. ❖ Troubleshooting <ul style="list-style-type: none"> a. There is a loose connection in the sensor wiring. Check the analog components for loose wires. b. There is a faulty or defective analog component. Replace the respective component. ❖ Open Analog Sensor Screen When the Open Analog Alarm is triggered, this screen can be used to determine which of the analog sensors or signals is having an issue. This screen, shown below in Figure 7-4, will display which analog sensor is initiating the alarm by illuminating a red lamp. ★The analog sensors or signals that are monitored are: <ul style="list-style-type: none"> a. Flow Sensor b. Pressure Transducer c. Pressure Transducer d. Remote Temperature Set Point Signal (Optional) <p>Figure 7-4: Open Analog Alarm Screen</p> 


ALARM	DESCRIPTION/TROUBLESHOOTING
High Limit T/C★	<p>❖ Description This is a “critical” alarm that indicates an over-temperature condition in one of the heater modules. ★The High Limit Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the over temperature condition is resolved before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> The “High Limit Set Points” are set up incorrectly. There is a loose connection in the electrical wiring. Check sensors for loose wires. There is a faulty or defective thermocouple (T/C) sensor. Replace the T/C sensor. Verify that communication is present between the respective High Limit Node and the Safety PLC. <p>❖ High Limit Status Screens When the High Limit Alarm is triggered, use the High Limit Status screen shown below in Figure 7-5 which displays which heater high limit thermocouple is initiating the alarm by illuminating a red lamp next to the corresponding high limit T/C. If the alarm condition is resolved the indicating lamp on this screen will disappear but the alarm will still be latched. The ALARM RESET key must be pressed in order to clear the alarm. See Open High Limit T/C Alarm for more information.</p> <p style="text-align: center;">Figure 7-5: High Limit Status Screen</p> 


ALARM	DESCRIPTION/TROUBLESHOOTING
Open High Limit T/C★	<p>❖ Description This is a “critical” alarm that indicates an open or defective high limit sensor (T/C) in one of the heater modules. ★The Open High Limit T/C Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the issue with the high limit sensors is resolved before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> There is a loose connection in the sensor wiring. Check sensors for loose wires. There is a faulty sensor or sensor failure. Replace the thermocouple sensor. Check the High Limit Controller for loose High Limit Nodes or EDU. <p>❖ High-Limit Info. When the Open High Limit T/C Alarm is triggered, the High Limit Status screen shown in Figure 7-5 will display which heater high limit thermocouple is initiating the alarm by illuminating a red lamp underneath the corresponding high limit T/C. If the alarm condition is resolved the indicating lamp on this screen will disappear but the alarm will still be latched. The ALARM RESET key must be pressed in order to clear the alarm. If communication is present, the Communications Status Lamp underneath the corresponding high limit T/C or Channel will flicker a green lamp. The actual amount of High Limit sensors will vary depending on the model of the unit.</p>

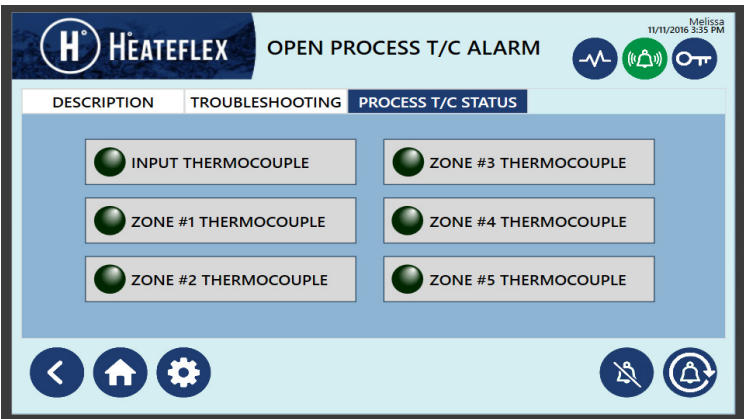ALARM	DESCRIPTION/TROUBLESHOOTING
Open Process T/C★	<p>❖ Description This is a “critical” alarm that indicates an open or defective thermocouple sensor in one of the master zone heater modules or in the incoming thermocouple. ★The Open Process T/C Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the issue with the process sensors is resolved before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> There is a loose connection in the sensor wiring. Check the sensors for loose wires. There is a faulty sensor or sensor failure. Replace the thermocouple. <p>❖ Open Process Thermocouple Screen When the Open Process Alarm is triggered, the screen shown below in Figure 7-6, will display which process thermocouple(s) is initiating the alarm with a green illuminated indicating light. The actual number of “zones” shown on this screen will vary according to the model of the unit. Inactive zones will be greyed.</p> <p style="text-align: center;">Figure 7-6: Open Process Thermocouple Screen</p> 
Thermal Cut-Off Alarm★	<p>❖ Description This is a “critical” alarm that indicates an over-temperature condition, open, or defective thermal cut-off in one of the heater modules. ★The Thermal Cut-Off Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the thermal cut-off is physically replaced before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> There is a loose connection in the electrical wiring. Check he sensors for loose wires. The thermal cut-off sensor was exposed to temperatures exceeding its threshold. Replace the thermal cut-off sensor. <p>❖ There is a faulty or defective thermal cut-off. Replace the thermal cut-off.</p>

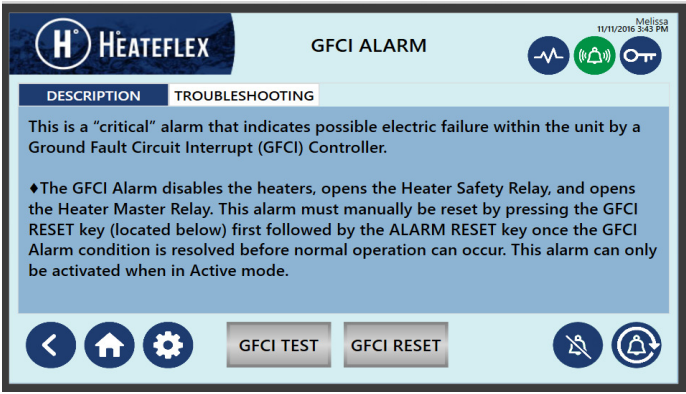ALARM	DESCRIPTION/TROUBLESHOOTING
GFCI★ (Option)	<p>❖ Description This is a “critical” alarm that indicates possible electric failure within the unit by a Ground Fault Circuit Interrupt (GFCI) Controller. ★The GFCI Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset by pressing the GFCI RESET key first followed by the ALARM RESET key once the GFCI Alarm condition is resolved before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> Verify that the “GFCI Control Settings” are correct. There is a loose connection in the electrical wiring. Check for loose wires. Resolve any possible shorts. Check the GFCI controller or Current Transformer (CT). The GFCI controller or Current Transformer (CT) is faulty or defective. Replace the respective component. <p>❖ GFCI Alarm Screen The GFCI Alarm can be tested by pressing the GFCI TEST key shown in Figure 7-7. The GFCI test function requires that the User Password be entered. In addition, in order to clear the GFCI Alarm the GFCI RESET key must be pressed prior to the ALARM RESET key. Note that the GFCI Alarm can only be triggered when in ACTIVE mode or the heaters are ON.</p> <p style="text-align: center;">Figure 7-7: GFCI Alarm Screen</p> 

ALARM	DESCRIPTION/TROUBLESHOOTING
Low PLC Battery	<p>❖ Description This is a “non-critical” alarm that indicates that the battery level of the Safety PLC is low and must be replaced. ★The Low PLC Battery Alarm does not disable the heaters and automatically resets once the battery is replaced. It is recommended that the battery is replaced immediately to prevent memory loss. The battery must be replaced within 5 days of the alarm to prevent memory loss. *If power to the Safety PLC is removed when a low battery condition is present the Safety PLC program and memory may be lost. *Please take appropriate measures to: (1) ensure that the Safety PLC battery is replaced in a reasonable amount of time and (2) when replacing the Safety PLC battery. *Please note that the Safety PLC will retain the Safety PLC program even with a low battery condition as long as power is maintained to the PLC.</p> <p>❖ Troubleshooting a. Replace the battery located in the Safety PLC.</p>
Low TS Battery	<p>❖ Description This is a “non-critical” alarm that indicates that the battery level of the touch screen is low and must be replaced. ★The Low TS Battery Alarm does not disable the heaters and automatically resets once the battery is replaced. It is recommended that the battery is replaced immediately to prevent memory loss. The battery must be replaced within 5 days of the alarm to prevent memory loss. *If power to the touch screen is removed when a low battery condition is present the touch screen program and memory may be lost. *Please take appropriate measures to: (1) ensure that the touch screen battery is replaced in a reasonable amount of time and (2) when replacing the touch screen battery. *Please note that the touch screen will retain the touch screen program even with a low battery condition as long as power is maintained to the PLC.</p> <p>❖ Troubleshooting a. Replace the battery located in the touch screen and then cycle power.</p>
Touch Screen / HMI Disconnect★	<p>❖ Description This is a “critical” alarm that indicates a disconnected or defective touch screen. ★The Touch Screen Disconnect Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the issue with the touch screen is resolved before normal operation can occur.</p> <p>❖ Troubleshooting a. There is a loose connection in the electrical wiring. Check the ethernet cables for loose wires b. The touch screen is faulty or defective. Replace the touchscreen.</p>

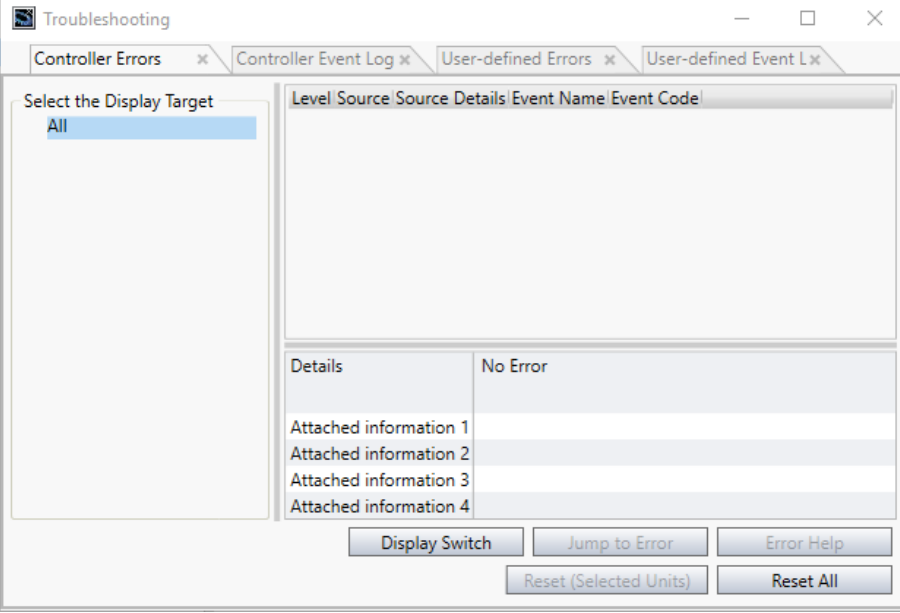ALARM	DESCRIPTION/TROUBLESHOOTING
EtherCAT Error Alarm★	<p>❖ Description This is a “critical” alarm that indicates a disconnected or defective EtherCAT component. Possible causes include: Cable(s) are disconnected, Module is not present, Sensor is disconnected. ★The EtherCAT Error Alarm disables the heaters, opens the Heater Safety Relay, and opens the Heater Master Relay. This alarm must manually be reset once the issue with the EtherCAT components is resolved before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> There is a loose connection in the electrical wiring. Check the etherCAT cables for loose wires There is a faulty connection between the PLC components. Verify all PLC components are installed correctly. There is a faulty or defective PLC component(s). Replace the respective component. Analog sensor is disconnected. Verify all sensors are connected properly. If there is a communication error consult the Controller Troubleshooter for more details. Manager level log in is needed to access this feature. <p>❖ Controller Troubleshooting screen This screen can be accessed through the EtherCAT Error Alarm</p> <p style="text-align: center;">Figure 7-8: Controller Troubleshooting screen</p> 

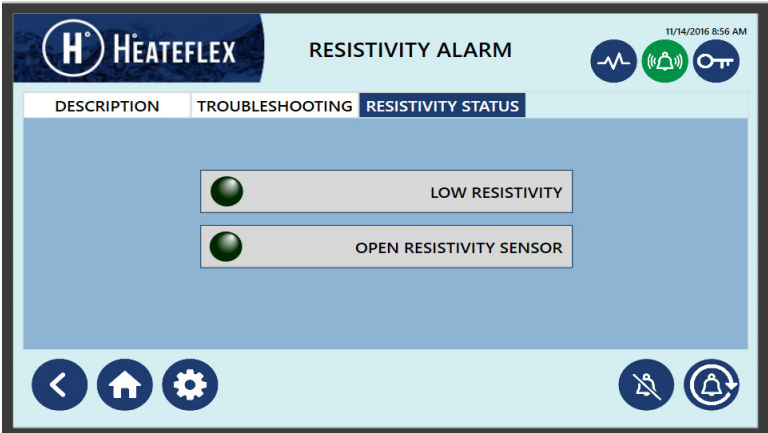ALARM	DESCRIPTION/TROUBLESHOOTING
Water Leak★ (Option)	<p>❖ Description This is an alarm that indicates a fluid leak in the drip pan of the unit. The alarm type is user defined. (Factory Default Water Leak Type is Non-Critical) ★If Water Leak Alarm Type is set to NON-CRITICAL, the heaters ARE NOT disabled and the alarm resets once the leak condition is resolved. (Factory Default) ★If Water Leak Alarm Type is set to CRITICAL, the heaters ARE disabled and requires a manual reset once the leak condition is resolved before normal operation can occur. If Isolation Valve is enabled, the incoming water AOV valve (Critical Leak Valve) will close preventing any fluid from entering into the unit.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> There is a loose connection in the electrical wiring. Check the sensor for loose wires. Check the plumbing for possible leaks. Check for faulty/defective sensor or plumbing components.
Resistivity (Option)	<p>❖ Description This is a “non-critical” alarm that indicates a resistivity value below the “Low Resistivity Alarm Set Point” or an Open Resistivity Sensor. ★The Resistivity Alarm does not disable the heaters and automatically resets once the resistivity value is above the “Low Resistivity Alarm Set Point” or the open sensor condition is resolved.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> The “Low Resistivity Alarm Set Point” is set too high. There is a loose connection in the electrical wiring. Check the sensor for loose wires. Check for faulty/defective sensor or an open resistivity sensor. <p>❖ Resistivity Alarm Type Screen The type of Resistivity Alarm that is triggered can be determined on the screen shown below (See Figure 7-8). This screen will display which type of Resistivity Alarm is being triggered with a red illuminated indicating light.</p> <p style="text-align: center;">Figure 7-9: Resistivity Alarm Type Screen</p> 

ALARM	DESCRIPTION/TROUBLESHOOTING
Pump Alarm ★	<p>❖ Description This is a “critical” alarm that indicates an error with the recirculation pump and/or pump controller. ★ The Pump Alarm disables the heaters and turns OFF the pump. This alarm must manually be reset once the issue with the pump and/or pump controller is resolved before normal operation can occur.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> Check the temperature of the pump and/or pump controller. Check for loose connections in the electrical wiring, including the pump and/or pump controller. Refer to the pump manual for more information or for troubleshooting.
Pump Warning	<p>❖ Description This is a “non-critical” alarm that indicates a potential problem with the recirculation pump and/or pump controller. ★ The Pump Warning Alarm does not disable the heaters or affect the operation of the pump and automatically resets.</p> <p>❖ Troubleshooting</p> <ol style="list-style-type: none"> Check the temperature of the pump and/or pump controller. Check for loose connections in the electrical wiring, including the pump and/or pump controller. Refer to the pump manual for more information or for troubleshooting.


★ Denotes a “critical” alarm condition

8. ALARM HISTORY

The **Alarm History** screen is used to log alarm events, shown in Figure 8-1. The alarms will be logged as they occur and “roll off” older alarm logs as the maximum number of log entries (100) is reached. The active alarms are indicated by a “red flag” while resolved or cleared alarms are indicated by a “green flag”. This is illustrated on the screen below. In addition, the date and time will also be recorded during the occurrence of the alarm event. The scroll bar on the right of the screen is used to scroll through the various alarm logs.

The Alarm History can be cleared by pressing the **CLEAR HISTORY** key. Note that a **User Password** is required in order to access the **CLEAR HISTORY** key and clear the screen.

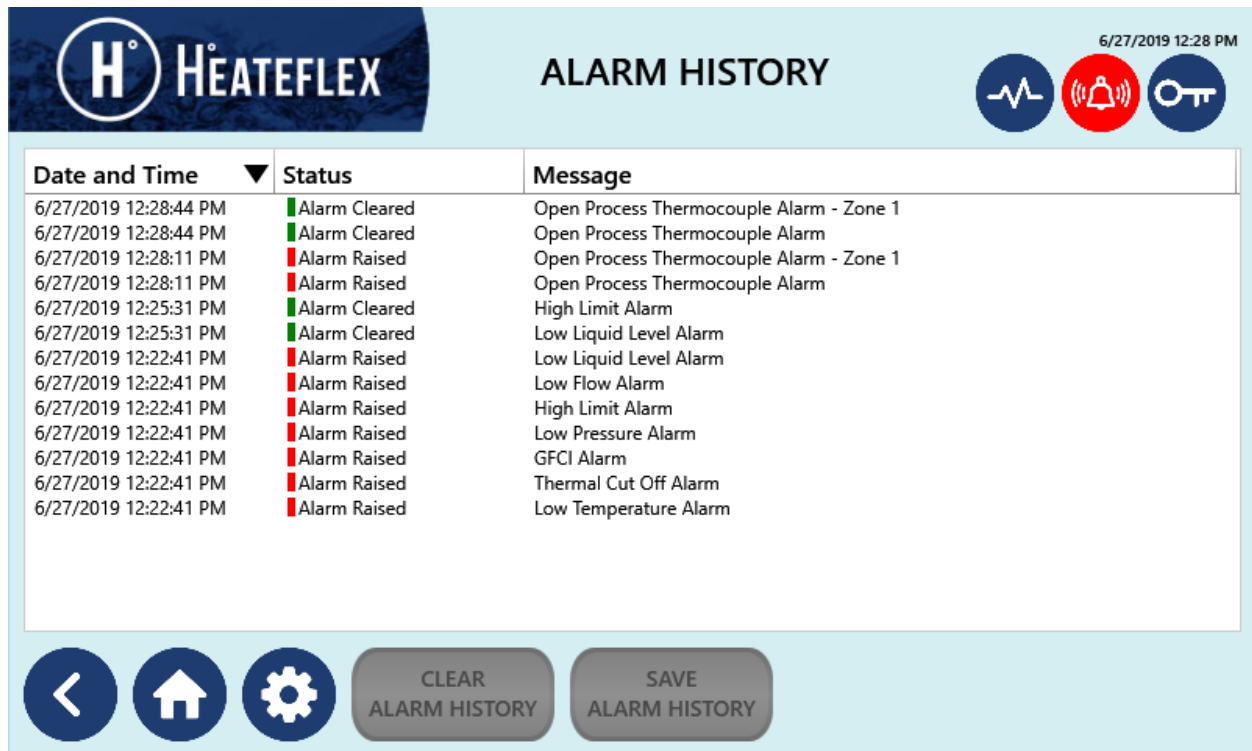Figure 8-1: Alarm History Screen



Date and Time ▼	Status	Message
6/27/2019 12:28:44 PM	Alarm Cleared	Open Process Thermocouple Alarm - Zone 1
6/27/2019 12:28:44 PM	Alarm Cleared	Open Process Thermocouple Alarm
6/27/2019 12:28:11 PM	Alarm Raised	Open Process Thermocouple Alarm - Zone 1
6/27/2019 12:28:11 PM	Alarm Raised	Open Process Thermocouple Alarm
6/27/2019 12:25:31 PM	Alarm Cleared	High Limit Alarm
6/27/2019 12:25:31 PM	Alarm Cleared	Low Liquid Level Alarm
6/27/2019 12:22:41 PM	Alarm Raised	Low Liquid Level Alarm
6/27/2019 12:22:41 PM	Alarm Raised	Low Flow Alarm
6/27/2019 12:22:41 PM	Alarm Raised	High Limit Alarm
6/27/2019 12:22:41 PM	Alarm Raised	Low Pressure Alarm
6/27/2019 12:22:41 PM	Alarm Raised	GFCI Alarm
6/27/2019 12:22:41 PM	Alarm Raised	Thermal Cut Off Alarm
6/27/2019 12:22:41 PM	Alarm Raised	Low Temperature Alarm


9. SYSTEM INFORMATION

The System Information screens are intended to provide more information about the Aquarius® D.I. Water Heating System. The **System Information Menu** screen can be accessed by pressing the **System Information** key located on the **Main Menu** screen (see Figure 1-1).

9.1. SYSTEM INFORMATION MENU SCREEN

The **System Information**, **System Specifications**, **System Maintenance**, and **Contact Information** screens can be accessed by pressing the respective keys shown in Figure 9-1 below.

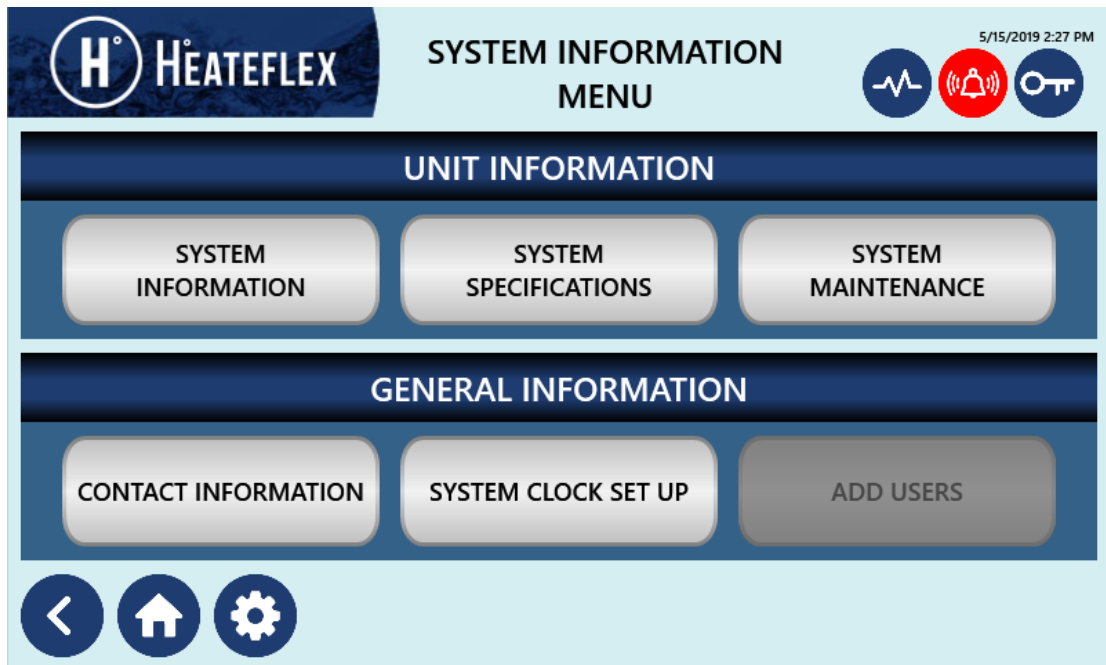
Figure 9-1: System Information Menu Screen



9.2. SYSTEM INFORMATION SCREEN

The **System Information** screen (Figure 9-2) provides more information about the Aquarius® D.I. Water Heating System, such as the Model Number, Serial Number, Manufacturing Date, and the **PF3000** program names, versions and data memory. In addition, there are two totalizers on this screen which track the “TOTAL PROCESS TIME” and the “TOTAL PROCESS VOLUME” passing through the unit. These totalizers cannot be reset.

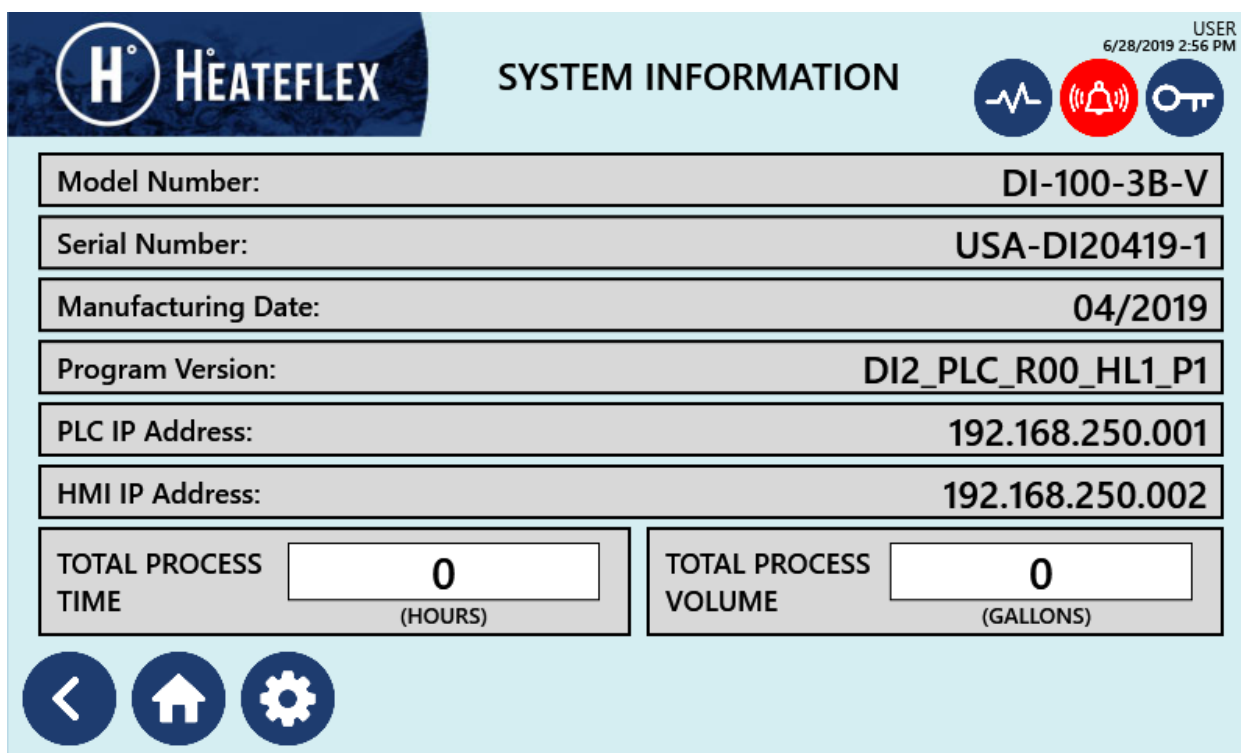Figure 9-2: System Information Screen



SYSTEM INFORMATION	
Model Number:	DI-100-3B-V
Serial Number:	USA-DI20419-1
Manufacturing Date:	04/2019
Program Version:	DI2_PLC_R00_HL1_P1
PLC IP Address:	192.168.250.001
HMI IP Address:	192.168.250.002
TOTAL PROCESS TIME	0 (HOURS)
TOTAL PROCESS VOLUME	0 (GALLONS)

9.3. SYSTEM SPECIFICATIONS SCREEN

The **System Specifications** screens (Figure 9-3 to Figure 9-5) display information about the Aquarius® D.I. Water Heating System specifications, such as the power, the voltage, the amperage, the frequency, the plumbing fitting requirements, etc.

Figure 9-3: System Specifications Screen – Electrical


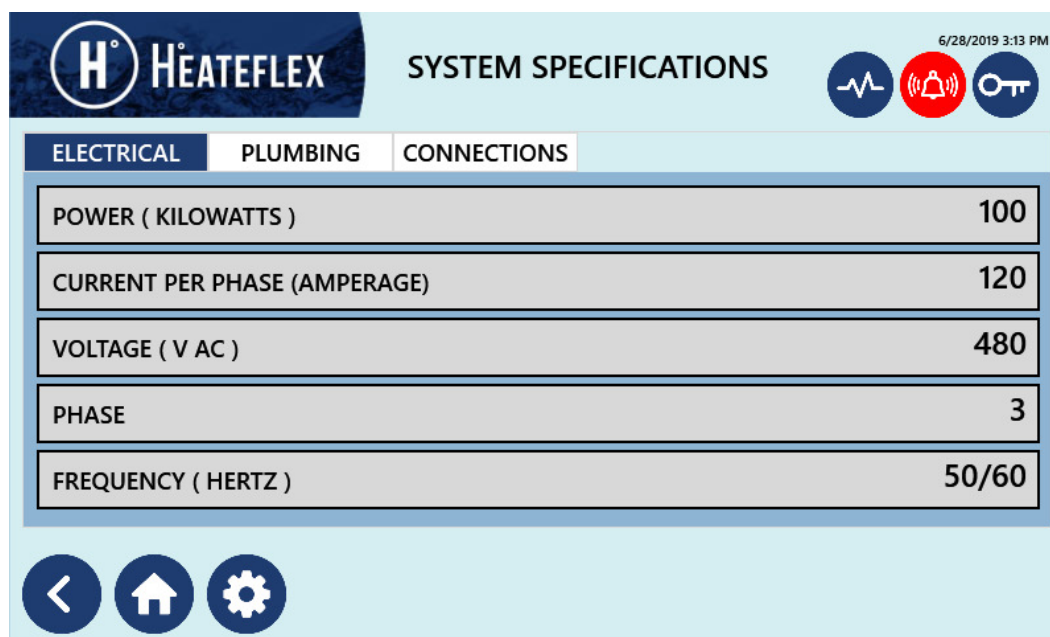


Figure 9-4: System Specifications Screen – Plumbing

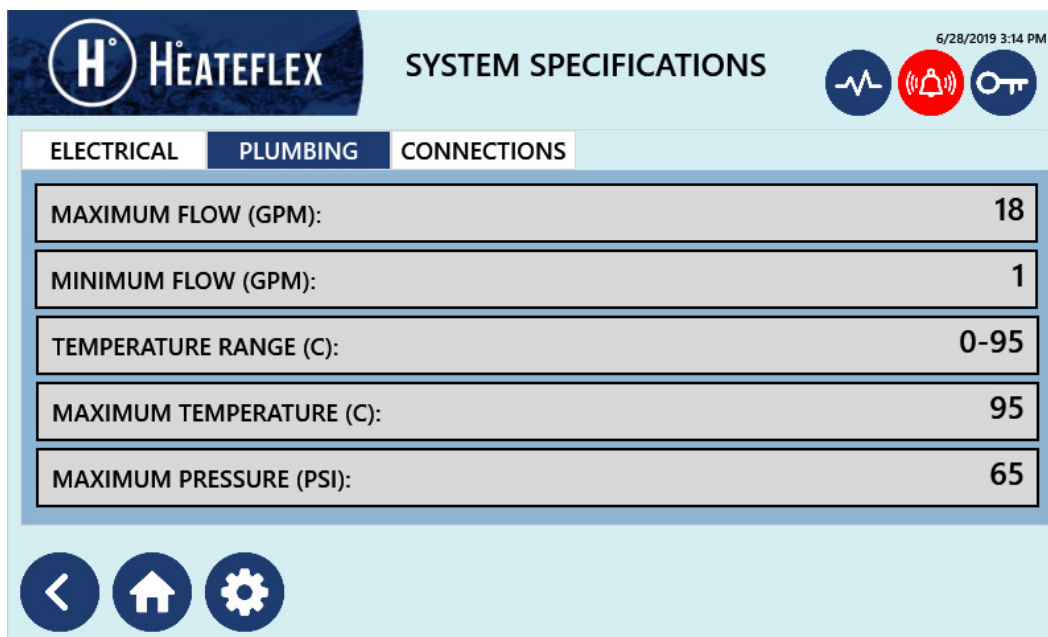

6/28/2019 3:14 PM


HEATEFLEX SYSTEM SPECIFICATIONS

ELECTRICAL **PLUMBING** CONNECTIONS

MAXIMUM FLOW (GPM):	18
MINIMUM FLOW (GPM):	1
TEMPERATURE RANGE (C):	0-95
MAXIMUM TEMPERATURE (C):	95
MAXIMUM PRESSURE (PSI):	65

< ⏠ ⚙

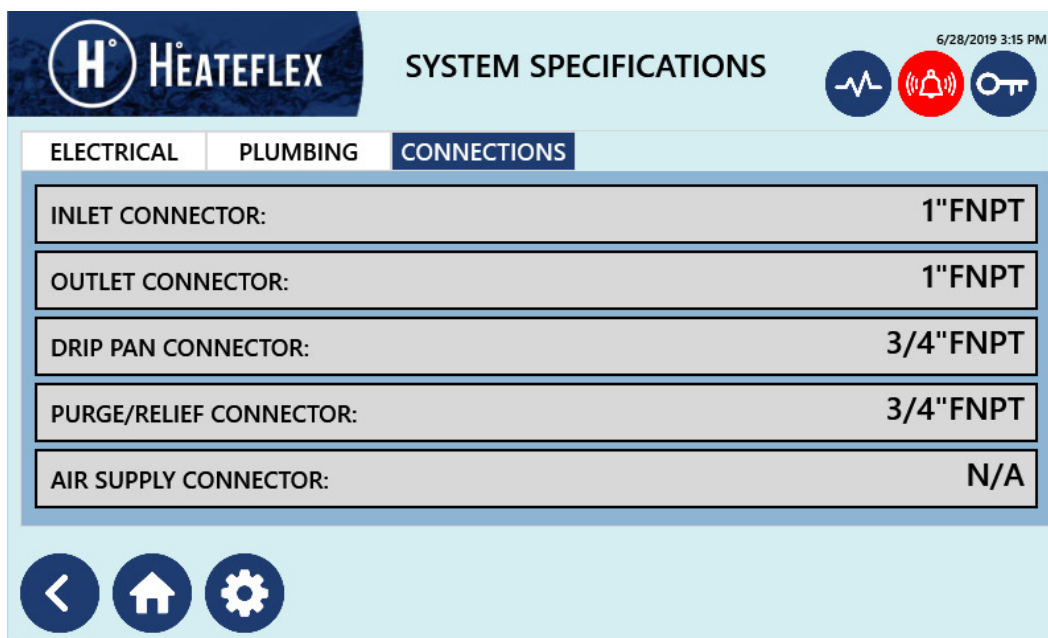Figure 9-5: System Specifications Screen – Connections



6/28/2019 3:15 PM

HEATEFLEX SYSTEM SPECIFICATIONS

ELECTRICAL PLUMBING **CONNECTIONS**


INLET CONNECTOR:	1" FNPT
OUTLET CONNECTOR:	1" FNPT
DRIP PAN CONNECTOR:	3/4" FNPT
PURGE/RELIEF CONNECTOR:	3/4" FNPT
AIR SUPPLY CONNECTOR:	N/A

< ⏠ ⚙

9.4. SYSTEM MAINTENANCE SCREEN

The **System Maintenance** screen (Figure 9-6) provides general information for the component life and maintenance of the Aquarius® D.I. Water Heating System and components.

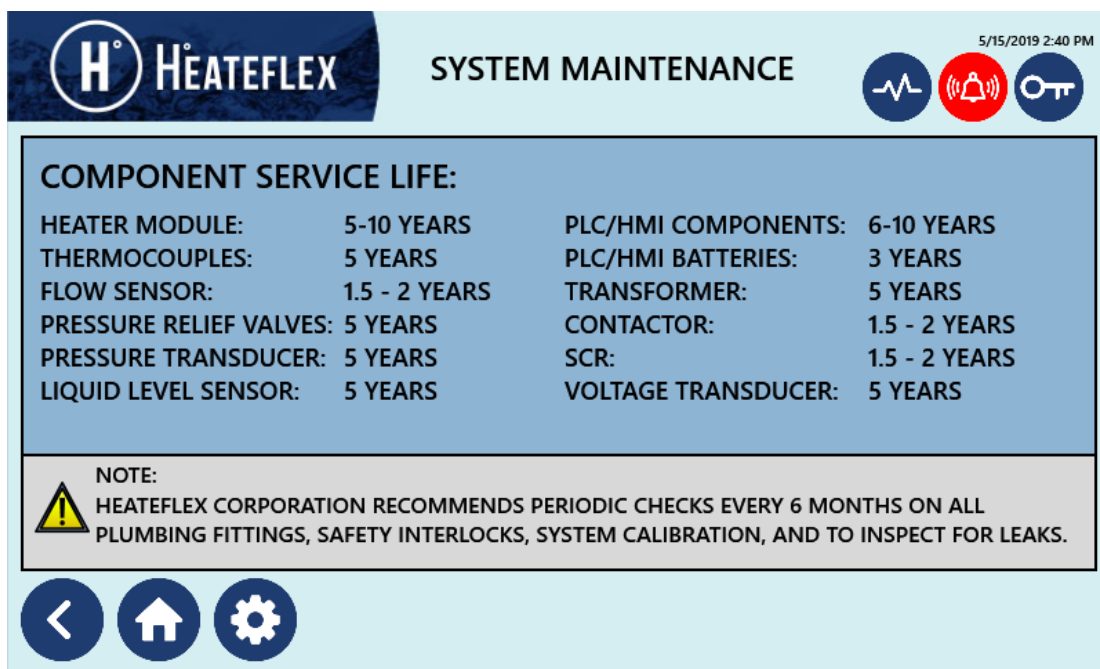Figure 9-6: System Maintenance Screen



9.5. CONTACT INFORMATION SCREEN

The **Contact Information** screen (Figure 9-7) displays the company and contact information for Heateflex Corporation.

Figure 9-7: Contact Information Screen



10. TREND GRAPH


The **Trend Graph** screen, as shown in Figure 10-1 below, can be accessed by pressing the **TREND GRAPH** key located on the **Main Menu** screen. The **Trend Graph** screen is used to track the system performance of the Aquarius® D.I. Water Heating System. This graph tracks the actual process temperature and flow rate of the system. The temperature data is shown in red while the flow rate data is shown in blue. The Trend Graph shows Temperature in Celsius and Flow Rate in GPM (gallons per minute)

The temperature and flow rate units shown on the right of the screen can also be toggled between English to SI units.

To change the temperature units press the **C** or **F** key in the Temperature section. The **F** key label will switch to **C** and vice versa. When the key shows **F** the temperature value shown to the left is in Fahrenheit and Celsius if the key shows **C**.

To change the flow units press the **GPM** or **LPM** key in the Flow Rate section. The **GPM** key label will switch to **LPM** and vice versa. When the key shows **GPM** the flow rate value shown to the left is in gallons per minute and liters per minute if the key shows **LPM**.

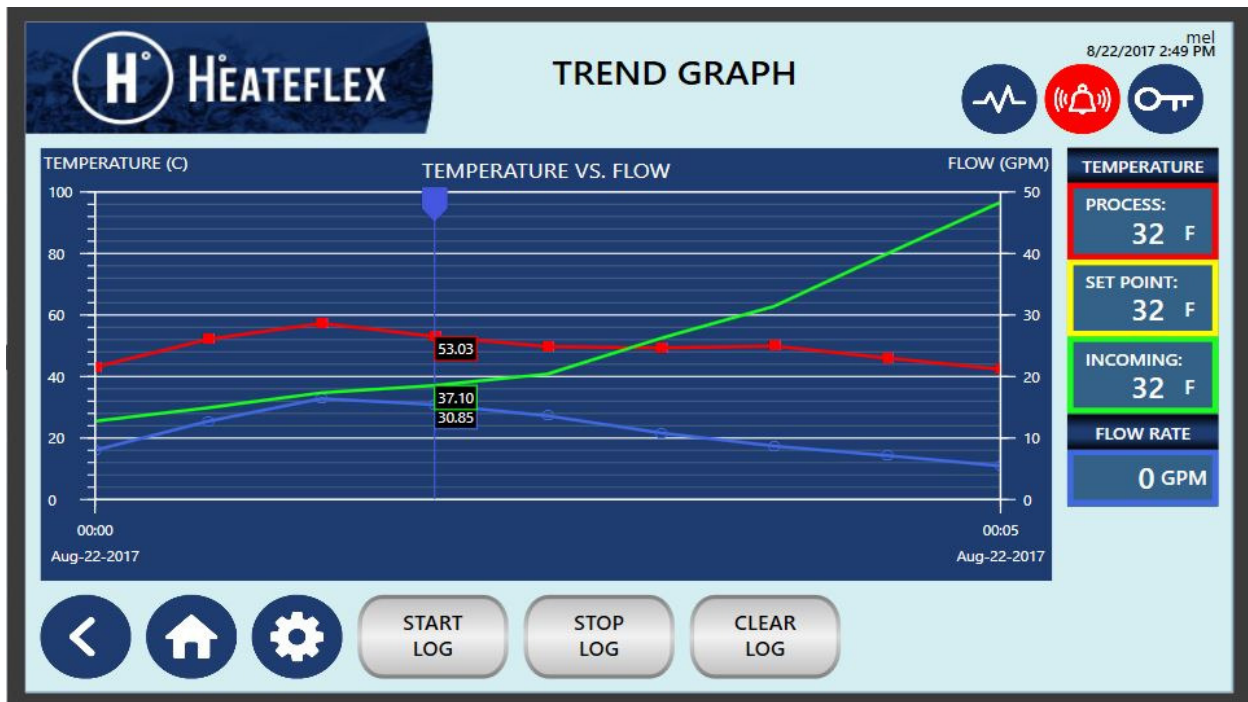Figure 10-1: Trend Graph Screen



The data will start recording upon power up of the unit. The data records will be saved to a new file every hour. These data record files will be saved onto the USB flash drive located on USB Host Port 1 of the touch screen. The data files are comma-separated values (.csv) files located in folder Data Logging>Log Files of the USB flash drive. There may be various different file folders and files within the folder.

Table 10-1: Variables of Recorded Data

Variable	units	Description
Timestamp	N/A	Time datapoint was acquired
Flow_GPM_FLPT	GPM	Calibrated Flow Rate
Final_Process_Temp_in_C	C	Calibrated Output Process Temperature
I_A_Zone5_TC_13_AB5	C	Uncalibrated Temperature at Zone 5*
I_A_Zone4_TC_13_AB7	C	Uncalibrated Temperature at Zone 4*
I_A_Zone3_TC_12_CD5	C	Uncalibrated Temperature at Zone 3*
I_A_Zone2_TC_12_CD7	C	Uncalibrated Temperature at Zone 2*
I_A_Zone1_TC_12_AB5	C	Uncalibrated Temperature at Zone 1
I_A_Input_TC_12_AB7	C	Uncalibrated Temperature at Input
Input_Temperature_Calibrated	C	Calibrated Input Temperature
Volts_FLPT	VOLTS	Calibrated Voltage
Pressure_FLPT_Calibrated_PSI_ONLY	PSI	Calibrated Pressure
Setpoint_BCD_Touchscreen	C	Process Temperature Set Point

*The number of zones is dependent on the model.

To stop recording the data press the **“STOP LOG”** key. To restart recording the performance of the system, press the **“START LOG”** key. The data on the graph can be cleared by pressing the **CLEAR LOG** key.

11. ETHERNET COMMUNICATIONS

The **Ethernet Communications** feature provides a data connection to the Aquarius® D.I. Water Heating System which allows remote control and monitoring of the Aquarius® D.I. Water Heating System.

The **Ethernet Communications** feature allows you to retrieve “read only” and “write enabled” real time data, such as temperature, flow rate, pressure, voltage, resistivity (if available), system set points and system settings, and send data for select settings.. The data sent from the Aquarius® D.I. Water Heating System Ethernet communication is in Bool and Real number format. Refer to Section 11.2 for a complete list of all the system values, set points and settings that are available. Reference the same section for list of status, modes alarm conditions to be easily monitored and controlled via Ethernet.

To establish the connection to the Aquarius® **PF3000** via the **Ethernet Communications** feature, the user must determine how they wish to communicate to the unit. The **Ethernet Connectivity** Section 11.1 describes the possible ways of communicating to the unit via the **Ethernet Communications** feature. This section will also cover connecting to the Aquarius® **PF3000**.

The **Ethernet Data** Section 11.2 lists all the available data that are accessible through the Ethernet Communications feature. These variables are available independently and within an incoming data structure and/or outgoing data structure. It is ultimately the user’s responsibility to acquire the data that is made available and provide the means to do so.

The Aquarius® **PF3000** also provides a method for troubleshooting the Ethernet data coming from the Aquarius. These Ethernet Communications screens, see Section 11.4, provide a method to verify that the Aquarius® System is sending out the respective data via Ethernet.

To troubleshoot the data being sent to the Aquarius unit utilize the Ethernet Writable Menus, see 11.6. Values shown on these screens represent the values that were sent to the Aquarius unit. This is also the location to enable and disable these Ethernet values which activates the values to be used by the Aquarius unit.


The Aquarius® **PF3000** alarm and status variables that are monitored through Ethernet can have their signals inverted by the user. These settings can be modified in the Ethernet Signals Menus. See the Ethernet Alarm and Status Signals in Section 11.5.

A new feature for the Aquarius Ethernet Communications is the ability to change the IP address so that the user has the flexibility needed to communicate with the Aquarius unit.

11.1. ETHERNET CONNECTIVITY

There are two types of Ethernet communication, PLC to PLC and PLC to PC. The way that communication is established to the unit is determined by end user. Figure 11-1 below is a simplified flow chart to help determine what is needed to establish communication via ethernet. It basically illustrates that the DI Aquarius unit requires a host PLC or host PC equipped with means to receive/translate the data and means to interface with the data.

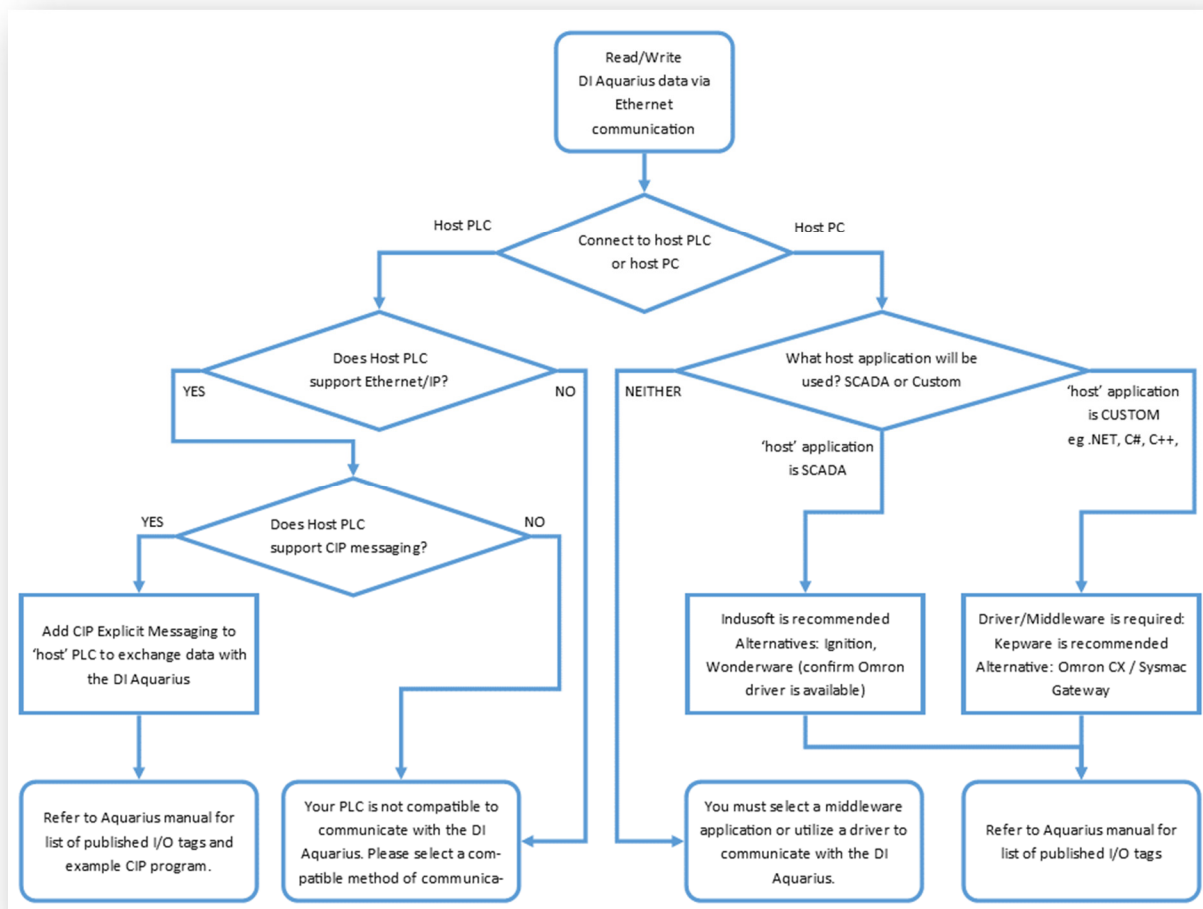Figure 11-1 – Ethernet Connectivity Flow Chart



- ❖ DI Aquarius (PLC) to PLC
 - The customer PLC (customer, tool, fab. Or bench) must be set as the HOST
 - The host PLC must be using Ethernet/IP to communicate to our machine
 - The customer PLC must be capable of CIP (Common Industrial Protocol) Explicit Messaging
 - The customer PLC must add code to their PLC programming to set up the communications to our Aquarius PLC. The code will vary from the different brands of customer PLCs Use the sample code shown below as a guideline only. Figure 11-2 is a sample PLC code which shows the code on an Omron PLC acting as the host PLC to communicate to the DI Aquarius.
- ❖ Aquarius (PLC) to PC
 - “Middleware” software such as Kepware, customized software, or drivers that are sometimes provided by the hardware manufacturers for the Industrial computers or PLCs operating under Linux.
 - PC (majority of the time it is an industrial PC)
 - A data management software such as SCADA made by Indusoft, Wonderware, Ignition etc. The end user is ultimately responsible for developing this required communications protocol.

Once the type of connection is determined, the customer must use the correct IP Address and Subnet Mask for the connection. Below lists the IP addresses for the PLC, HMI and the Ethernet Interface as well as a space for the customer to record their Customer Created Ethernet Interface IP Address. It is important that these IP Addresses be kept vacant on the extended network for the Aquarius unit to communicate and function properly.. For more information on how to change the IP address see Section 11.7.

Table 11-1: Ethernet IP Addresses

	IP Address	Subnet Mask
PF3000 (PLC)	192.168.250.001	255.255.255.0
Touch Screen (HMI)	192.168.250.002	255.255.255.0
Default Ethernet Interface	192.168.251.001	255.255.255.0
Customer Created		

Note, it is recommended to ping the PLC in order to check the IP address is correct.

Please note that a straight Ethernet cable is required in order to communicate with the Aquarius® D.I. Water Heating System.

11.2. ETHERNET DATA

After the path for **Ethernet Communications** has been established, it is necessary for the end user to determine what to do with all the data being received. The following tables are to show all the different values, setpoints, settings and alarms variables that are available along with their ethernet tag names.

Table 11-2: Ethernet System Values, Settings and Set Points

ETHERNET SYSTEM VALUES, SET POINTS & SETTINGS	TYPE	Tag Names		UNITS
		READ	WRITE	
Auto Purge Duration ¹	Setting	ETH_R_Auto_Purge_Duration	ETH_W_Auto_Purge_Duration	min
Auto Purge Period ¹	Setting	ETH_R_Auto_Purge_Period	ETH_W_Auto_Purge_Period	min
Auto Reset ³	Setting	ETH_R_Auto_Reset	N/A	-
Cycle Rate	Setting	ETH_R_Cycle_Rate	N/A	sec
Dead Band	Setting	ETH_R_Dead_Band	N/A	°C
First Temperature Set Point ¹	Set Point	ETH_R_First_Temperature_Set_Point	N/A	°C
Flow Rate	Values	ETH_R_Flow_Rate	N/A	gpm
Flow Rate Calibration ²	Setting	ETH_R_Flow_Rate_Calibration	N/A	gpm
Frequency	Setting	ETH_R_Frequency	N/A	Hz
Heater Amperage	Setting	ETH_R_Heater_Amperage	N/A	amps
High Flow Alarm Set Point	Set Point	ETH_R_High_Flow_Alarm_Set_Point	ETH_W_High_Flow_Alarm_Set_Point	gpm
High Pressure Set Point	Set Point	ETH_R_High_Pressure_Set_Point	ETH_W_High_Pressure_Set_Point	psi
High Temperature Alarm Set Point	Set Point	ETH_R_High_Temperature_Alarm_Set_Point	ETH_W_High_Temperature_Alarm_Set_Point	°C
Incoming Temperature	Values	ETH_R_Incoming_Temperature	N/A	°C
Input T/C Temperature Calibration ²	Setting	ETH_R_Input_TC_Temperature_Calibration	N/A	°C
Low Flow Alarm Set Point	Set Point	ETH_R_Low_Flow_Alarm_Set_Point	N/A	gpm
Low Pressure Set Point	Set Point	ETH_R_Low_Pressure_Set_Point	ETH_W_Low_Pressure_Set_Point	psi
Low Resistivity Alarm Set Point ¹	Set Point	ETH_R_Low_Resistivity_Alarm_Set_Point	ETH_W_Low_Resistivity_Alarm_Set_Point	M-Ohms
Low Temperature Alarm Set Point	Set Point	ETH_R_Low_Temperature_Alarm_Set_Point	ETH_W_Low_Temperature_Alarm_Set_Point	°C
Power Adjust	Setting	ETH_R_Power_Adjust	N/A	sec
Power Reset	Setting	ETH_R_Power_Reset	N/A	sec
Pressure	Values	ETH_R_Pressure	N/A	Psi
Pressure Calibration ²	Setting	ETH_R_Pressure_Calibration	N/A	psi
Process Temperature	Values	ETH_R_Process_Temperature	N/A	°C
Process Temperature Set Point	Set Point	ETH_R_Process_Temperature_Set_Point	ETH_W_Process_Temperature_Set_Point	°C
Remote Temperature Set Point ¹	Set Point	ETH_R_Remote_Temperature_Set_Point	ETH_W_Remote_Temperature_Set_Point	°C
Resistivity ¹	Values	ETH_R_Resistivity	N/A	M-Ohms
Resistivity Calibration ^{1,2}	Setting	ETH_R_Resistivity_Calibration	N/A	M-Ohms
Second Temperature Set Point ²	Set Point	ETH_R_Second_Temperature_Set_Point	ETH_W_Second_Temperature_Set_Point	°C
T/C Temp. Calibration ²	Setting	ETH_R_TC_Temp_Calibration	N/A	°C
Temperature Ready Dead Band Signal Set Point ¹	Set Point	ETH_R_Temperature_Ready_Dead_Band_Signal_Set_Point	ETH_W_Temperature_Ready_Dead_Band_Signal_Set_Point	°C
Voltage	Values	ETH_R_Voltage	N/A	VAC
Voltage Calibration ²	Setting	ETH_R_Voltage_Calibration	N/A	VAC

NOTE:

1. Available when specific option is selected. If option is unavailable a value of 0 will be sent.
2. In the BCD Format, a value of 0 will be sent if any negative number is Entered.
3. For Auto Reset "Sign" Values of:
0 = System is turned Off
1 = Active
2 = Inactive

Table 11-3: Ethernet Signal Status and Alarms

ETHERNET SYSTEM VALUES & ALARMS	POWER OFF	OPTION	OFF (DEFAULT)		ON		SIGNAL INVERSION	MEMORY REGISTER
			INACTIVE	ACTIVE	INACTIVE	ACTIVE		
Secondary Process Temperature Set Point Enabled ³	0	0	0	1	1	0	Yes	Ethernet_2 nd _Process_Temp_SP_Customer_Enabled
Active Mode	0	Std.	0	1	1	0	Yes	Ethernet_Active_Mode_Active
Auto Purge Enabled ³	0	0	0	1	1	0	Yes	Ethernet_Auto_Purge_Enabled
Critical Alarm Status	0	0	1	0	0	1	Yes	Ethernet_Critical_Alarm
Recirculation Signal Active ³	0	0	0	1	1	0	Yes	Ethernet_Customer_Recirculation_Signal_Active
Demand Mode ³	0	0	0	1	1	0	Yes	Ethernet_Demand_Mode_Active
Ground Fault Circuit Interrupt (GFCI) Alarm ³	0	Std.	1	0	0	1	Yes	Ethernet_GFCI_Alarm
Global Alarm	0	0	1	0	0	1	Yes	Ethernet_Global_Alarm
High Flow Alarm	0	Std.	1	0	0	1	Yes	Ethernet_High_Flow_Alarm
High Limit T/C Alarm (Global)	0	Std.	1	0	0	1	Yes	Ethernet_High_Limit_TC_Alarm_global
High Pressure Alarm	0	Std.	1	0	0	1	Yes	Ethernet_High_Pressure_Alarm
High Temperature Alarm	0	Std.	1	0	0	1	Yes	Ethernet_High_Temperature_Alarm
Low Flow Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Low_Flow_Alarm
Low Level Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Low_Level_Alarm
Low PLC Battery	0	Std.	1	0	0	1	Yes	Ethernet_Low_PLC_Battery_Alarm
Low Pressure Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Low_Pressure_Alarm
Low Resistivity Alarm ³	0	0	1	0	0	1	Yes	Ethernet_Low_Resistivity_Alarm
Low Temperature Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Low_Temperature_Alarm
Low TS Battery	0	Std.	1	0	0	1	Yes	Ethernet_Low_TS_Battery_Alarm
Non-Critical Alarm Status	0	0	1	0	0	1	Yes	Ethernet_NonCritical_Alarm
Open Analog Alarm (Global)	0	Std.	1	0	0	1	Yes	Ethernet_Open_Analog_Alarm_global
Open Flow Sensor	0	Std.	1	0	0	1	Yes	Ethernet_Open_Flow_Sensor_Alarm
Open High Limit T/C Alarm (Global)	0	Std.	1	0	0	1	Yes	Ethernet_Open_High_Limit_TC_Alarm_global
Open Input T/C Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Open_Input_TC_Alarm
Open Pressure Transducer	0	Std.	1	0	0	1	Yes	Ethernet_Open_Pressure_Transducer_Alarm
Open Process T/C Alarm (Global)	0	Std.	1	0	0	1	Yes	Ethernet_Open_Process_TC_Alarm_global
Open Remote Temperature Set Point ³	0	0	1	0	0	1	Yes	Ethernet_Open_Remote_Temp_SP_Alarm
Open Resistivity Alarm ³	0	0	1	0	0	1	Yes	Ethernet_Open_Resistivity_Alarm
Open Voltage Transducer	0	Std.	1	0	0	1	Yes	Ethernet_Open_Voltage_Transducer_Alarm
Open Zone #1 T/C Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Open_Zone_1_TC_Alarm
Open Zone #2 T/C Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Open_Zone_2_T_C_Alarm
Open Zone #3 T/C Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Open_Zone_3_TC_Alarm
Open Zone #4 T/C Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Open_Zone_4_TC_Alarm
Open Zone #5 T/C Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Open_Zone_5_TC_Alarm
PLC to Communications Alarm	0	Std.	1	0	0	1	Yes	Ethernet_PLC_to_HMI_TS_Comms_Alarm
Pump Air Cooling System Active ³	0	0	0	1	1	0	Yes	Ethernet_Pump_Air_Cooling_System_Active
Pump Alarm ³	0	0	1	0	0	1	Yes	Ethernet_Pump_Alarm
Pump Warning ³	0	0	1	0	0	1	Yes	Ethernet_Pump_Warning_Alarm
Purge Mode ³	0	0	0	1	1	0	Yes	Ethernet_Purge_Mode_Active
Recirculation Enabled ³	0	0	0	1	1	0	Yes	Ethernet_Recirculation_Customer_Enabled
Recirculation Mode ³	0	0	0	1	1	0	Yes	Ethernet_Recirculation_Mode_Active
Remote Process Temperature Set Point Active ³	0	0	0	1	1	0	Yes	Ethernet_Rem_Temp_SP_Active
Resistivity alarm ³ (Global)	0	0	1	0	0	1	Yes	Ethernet_Resistivity_Alarm_global
Run Mode	0	Std.	0	1	1	0	Yes	Ethernet_Run_Mode_Active
SCR Alarm	0	Std.	1	0	0	1	Yes	Ethernet_SCR_Alarm
Secondary Process Temperature Set Point Active ³	0	0	0	1	1	0	Yes	Ethernet_Secondary_Process_Temperature_Set_Point_Active
Standby Mode	0	Std.	0	1	1	0	Yes	Ethernet_Standby_Mode_Active
Stop Mode	0	Std.	0	1	1	0	Yes	Ethernet_Stop_Mode_Active
Thermal Cutoff Alarm	0	Std.	1	0	0	1	Yes	Ethernet_Thermal_Cutoff_Alarm
Venting Mode ³	0	0	0	1	1	0	Yes	Ethernet_Venting_Mode_Active
Temperature Ready Dead Band Signal ³	0	0	0	1	1	0	Yes	Ethernet_Water_at_Temperature_DB_Signal_Active
Water Leak Alarm ³	0	0	1	0	0	1	Yes	Ethernet_Water_Leak_Alarm

NOTE:

- 0 – Open Signal; 1 – Closed Signal
- Signal inversion is specific to the respective Communication Interface. Same signal types must be inverted on each respective communication interface.
- Available when specific option is selected.

Table 11-4: Ethernet System Keys

ETHERNET SYSTEM KEY	INACTIVE	ACTIVE	STANDARD OR OPTION	MEMORY REGISTER
Silence Alarm	0	1	STANDARD	ETH_K_Silence_Alarm
Alarm Reset	0	1	STANDARD	ETH_K_Alarm_Reset
Standby	0	1	STANDARD	ETH_K_StandbyActive
Remote Purge	0	1	AUTO PURGE	ETH_K_Purge
Recirculation Signal	0	1	RECIRCULATION	ETH_K_RecirculationSignal

NOTE:

1. 0 – Open Signal; 1 – Closed Signal

The Aquarius PF3000 has read and write ethernet variables organized in data structures to facilitate the exchange of data. Figure 11-2 shows a sample code for a host Omron PLC to communicate to the Aquarius PF3000 PLC.

The data structure to read is **CIP_READ** and the data structure to write to is **CIP_WRITE**.

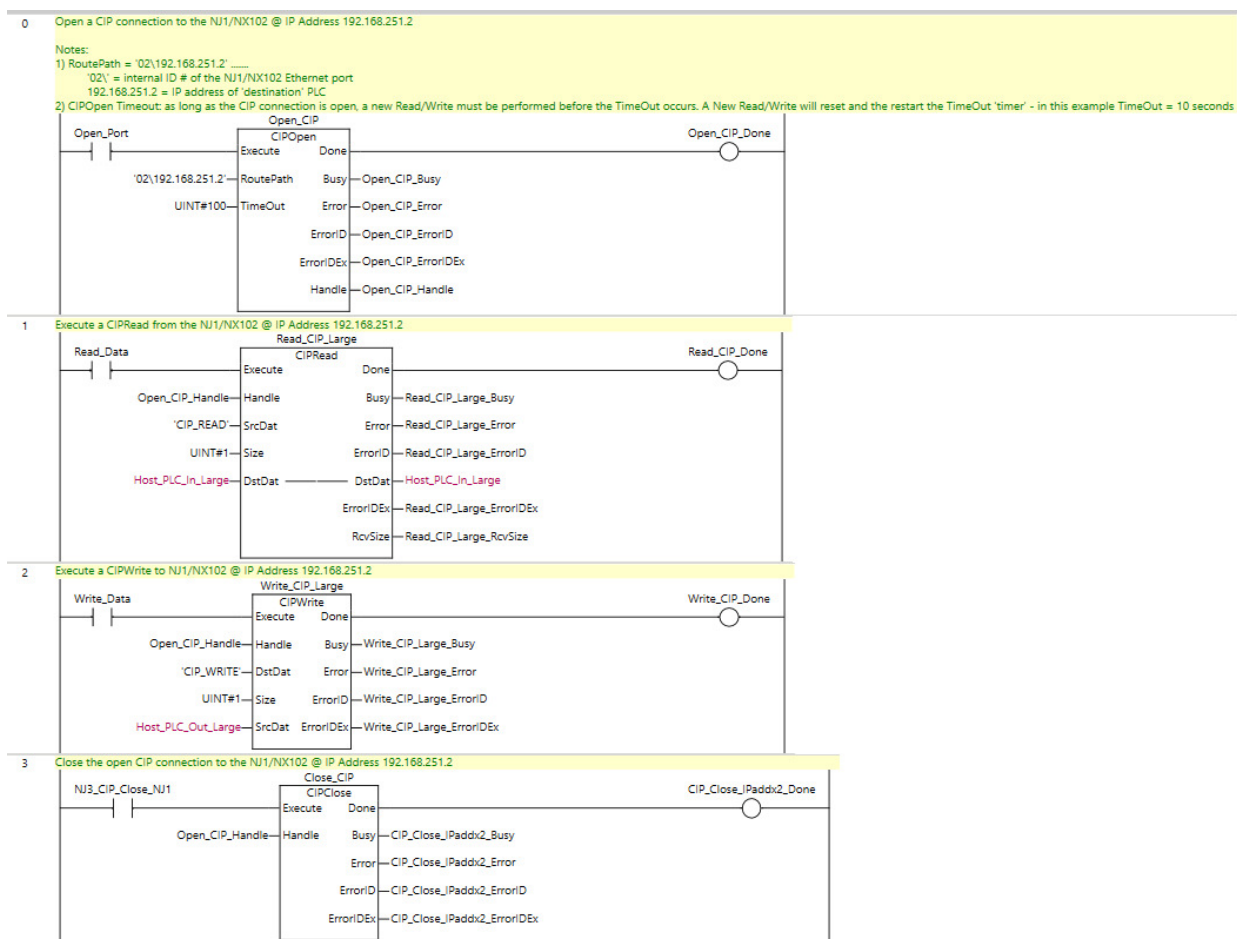
Figure 11-2 – Host Omron PLC Sample Code for Communicating PLC to PLC via Ethernet


Table 11-5: Data Structure for CIP_READ

Name	Type	Name	Type
ETH K Alarm Reset	BOOL	Ethernet Secondary Process Temperature Set Point Active	BOOL
ETH K Purge	BOOL	Ethernet Standby Mode Active	BOOL
ETH K RecirculationSignal	BOOL	Ethernet Stop Mode Active	BOOL
ETH K Silence Alarm	BOOL	Ethernet Thermal Cutoff Alarm	BOOL
ETH K StandbyActive	BOOL	Ethernet Venting Mode Active	BOOL
ETH R Invalid Data Flag	BOOL	Ethernet Water at Temperature DB Signal Active	BOOL
Ethernet 2 nd Process Temp SP Customer Enabled	BOOL	Ethernet Water at Temp DB Signal Customer Enabled	BOOL
Ethernet Active Mode Active	BOOL	Ethernet Water Leak Alarm	BOOL
Ethernet Auto Purge Enabled	BOOL	ETH R Auto Purge Duration	REAL
Ethernet Critical Alarm	BOOL	ETH R Auto Purge Period	REAL
Ethernet Customer Recirculation Signal Active	BOOL	ETH R Auto Reset	REAL
Ethernet Demand Mode Active	BOOL	ETH R Cycle Rate	REAL
Ethernet GFCI Alarm	BOOL	ETH R Dead Band	REAL
Ethernet Global Alarm	BOOL	ETH R First Temperature Set Point	REAL
Ethernet High Flow Alarm	BOOL	ETH R Flow Rate	REAL
Ethernet High Limit TC Alarm_global	BOOL	ETH R Flow Rate Calibration	REAL
Ethernet High Pressure Alarm	BOOL	ETH R Frequency	REAL
Ethernet High Temperature Alarm	BOOL	ETH R Heater Amperage	REAL
Ethernet Low Flow Alarm	BOOL	ETH R High Flow Alarm Set Point	REAL
Ethernet Low Level Alarm	BOOL	ETH R High Pressure Set Point	REAL
Ethernet Low PLC Battery Alarm	BOOL	ETH R High Temperature Alarm Set Point	REAL
Ethernet Low Pressure Alarm	BOOL	ETH R Incoming Temperature	REAL
Ethernet Low Resistivity Alarm	BOOL	ETH R Input TC Temperature Calibration	REAL
Ethernet Low Temperature Alarm	BOOL	ETH R Low Flow Alarm Set Point	REAL
Ethernet Low TS Battery Alarm	BOOL	ETH R Low Pressure Set Point	REAL
Ethernet NonCritical Alarm	BOOL	ETH R Low Resistivity Alarm Set Point	REAL
Ethernet Open Analog Alarm_global	BOOL	ETH R Low Temperature Alarm Set Point	REAL
Ethernet Open Flow Sensor Alarm	BOOL	ETH R Power Adjust	REAL
Ethernet Open High Limit TC Alarm_global	BOOL	ETH R Power Reset	REAL
Ethernet Open Input TC Alarm	BOOL	ETH R Pressure	REAL
Ethernet Open Pressure Transducer Alarm	BOOL	ETH R Pressure Calibration	REAL
Ethernet Open Process TC Alarm_global	BOOL	ETH R Process Temperature	REAL
Ethernet Open Remote Temp SP Alarm	BOOL	ETH R Process Temperature Set Point	REAL
Ethernet Open Resistivity Alarm	BOOL	ETH R Remote Temperature Set Point	REAL
Ethernet Open Voltage Transducer Alarm	BOOL	ETH R Resistivity	REAL
Ethernet Open Zone 1 TC Alarm	BOOL	ETH R Resistivity Calibration	REAL
Ethernet Open Zone 2 T C Alarm	BOOL	ETH R Second Temperature Set Point	REAL
Ethernet Open Zone 3 TC Alarm	BOOL	ETH R TC Temp Calibration	REAL
Ethernet Open Zone 4 TC Alarm	BOOL	ETH R Temperature Ready Dead Band Signal Set Point	REAL
Ethernet Open Zone 5 TC Alarm	BOOL	ETH R Voltage	REAL
Ethernet PLC to HMI TS Comms Alarm	BOOL	ETH R Voltage Calibration	REAL
Ethernet Pump Air Cooling System Active	BOOL	ETH W Auto Purge Duration	REAL
Ethernet Pump Alarm	BOOL	ETH W Auto Purge Period	REAL
Ethernet Pump Warning Alarm	BOOL	ETH W High Flow Alarm Set Point	REAL
Ethernet Purge Mode Active	BOOL	ETH W High Pressure Set Point	REAL
Ethernet Recirculation Customer Enabled	BOOL	ETH W High Temperature Alarm Set Point	REAL
Ethernet Recirculation Mode Active	BOOL	ETH W Low Pressure Set Point	REAL
Ethernet Rem Temp SP Active	BOOL	ETH W Low Resistivity Alarm Set Point	REAL
Ethernet Restivity Alarm_global	BOOL	ETH W Low Temperature Alarm Set Point	REAL
Ethernet Run Mode Active	BOOL	ETH W Process Temperature Set Point	REAL
Ethernet SCR Alarm	BOOL	ETH W Temperature Ready Dead Band Signal Set Point	REAL

Table 11-6: Data Structure for CIP_WRITE

Name	Type
ETH K Alarm Reset	BOOL
ETH K Purge	BOOL
ETH K RecirculationSignal	BOOL
ETH K Silence Alarm	BOOL
ETH K StandbyActive	BOOL
ETH W Auto Purge Duration	REAL
ETH W Auto Purge Period	REAL
ETH W High Flow Alarm Set Point	REAL
ETH W High Pressure Set Point	REAL
ETH W High Temperature Alarm Set Point	REAL
ETH W Low Pressure Set Point	REAL
ETH W Low Resistivity Alarm Set Point	REAL
ETH W Low Temperature Alarm Set Point	REAL
ETH W Process Temperature Set Point	REAL
ETH W Temperature Ready Dead Band Signal Set Point	REAL


11.3. ETHERNET INTERFACE MENU

The **Ethernet Interface Menu** (see Figure 11-3).consists of several keys to allow access to Ethernet Interface related screens and are separated into four sections: **Ethernet Communications**, **Ethernet Signals**, **Ethernet Write** and **IP Address**. The menus are as the follows:

- **Ethernet Communications**
 - **Ethernet Alarms** screens (Figure 11-4 to Figure 11-5),
 - **Ethernet Status** screen (Figure 11-6),
 - **Ethernet Values** screen (Figure 11-7),
 - **Ethernet Set Points** screen (Figure 11-8), and the
 - **Ethernet Settings** screens (Figure 11-9).
- **Ethernet Signals**
 - **Ethernet Alarms** screens (Figure 11-10 & Figure 11-11)
 - **Ethernet Status** screen (Figure 11-12)
- **Ethernet Write**
 - **Ethernet Write Standard Features** screens (Figure 11-13)
 - **Ethernet Write Optional Features** screens (Figure 11-14)
- **IP Address**
 - **Ethernet Settings** screens (Figure 11-15).

To access the Ethernet screens, start with the **Main Menu** screen, then select **System Set Up**, and finally select **Ethernet Interface**. The **Ethernet Interface** screen will appear as shown below in Figure 11-3. This screen allows access to the Ethernet related menus.

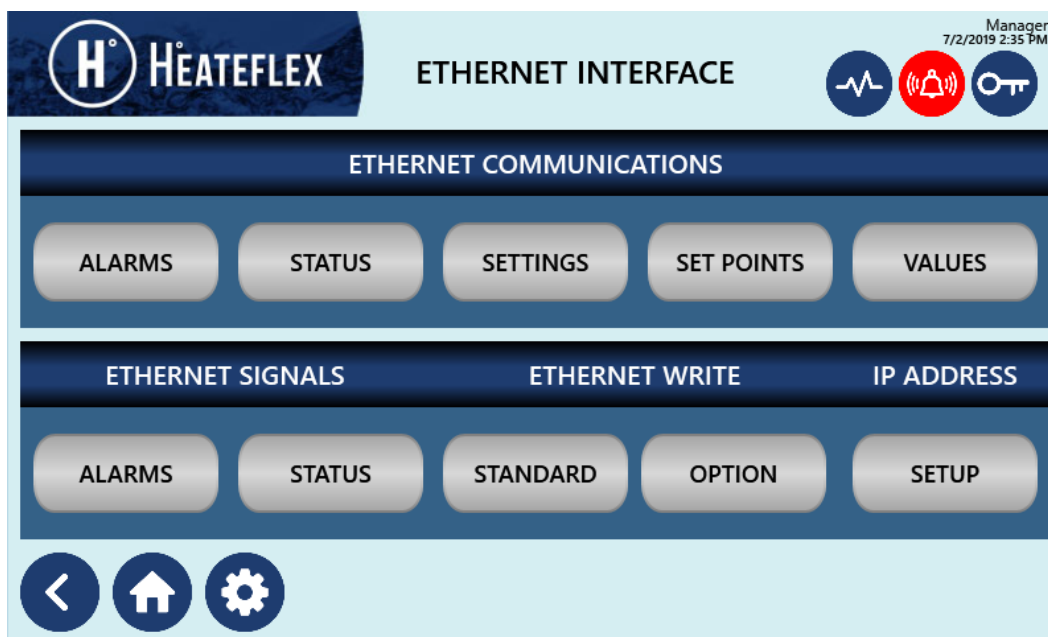Figure 11-3: Ethernet Interface Screen



11.4. ETHERNET COMMUNICATIONS MENUS


It is on these following screens where you can monitor the data from the Aquarius® System and troubleshoot the **Ethernet Communications** if desired.

The Aquarius® D.I. Water Heating System status, modes alarm conditions can be monitored in Figure 11-4 to Figure 11-9. To move between the screens press the **NEXT** or **BACK** key respectively.

Please note that the lamps shown on the **Ethernet Alarms** screens and the **Ethernet Status** screen are affected by the orientation of the signal (normally open or normally closed) and whether or not the respective signal has been inverted. See Section 18.3 of this instruction manual for system status signal and alarm signal inversion.

Table 11-2 lists the tag names for all of the system status, system modes and system alarms

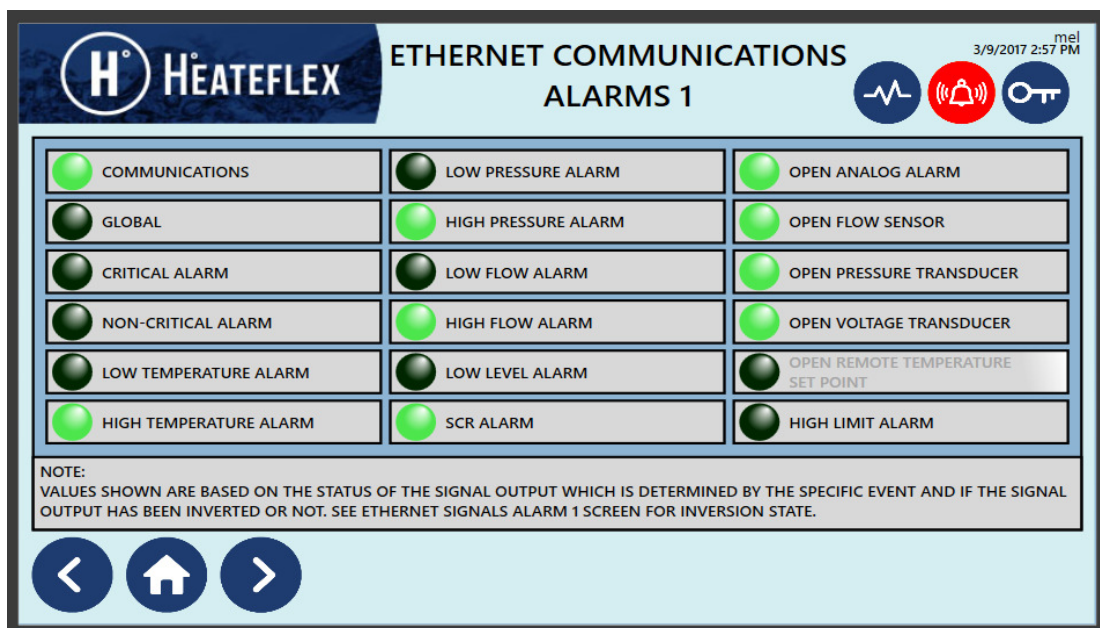Figure 11-4: Ethernet Communications Alarms 1 Screen



Note: This screen indicates that Low Flow Alarm is present.

Figure 11-5: Ethernet Communications Alarms 2 Screen


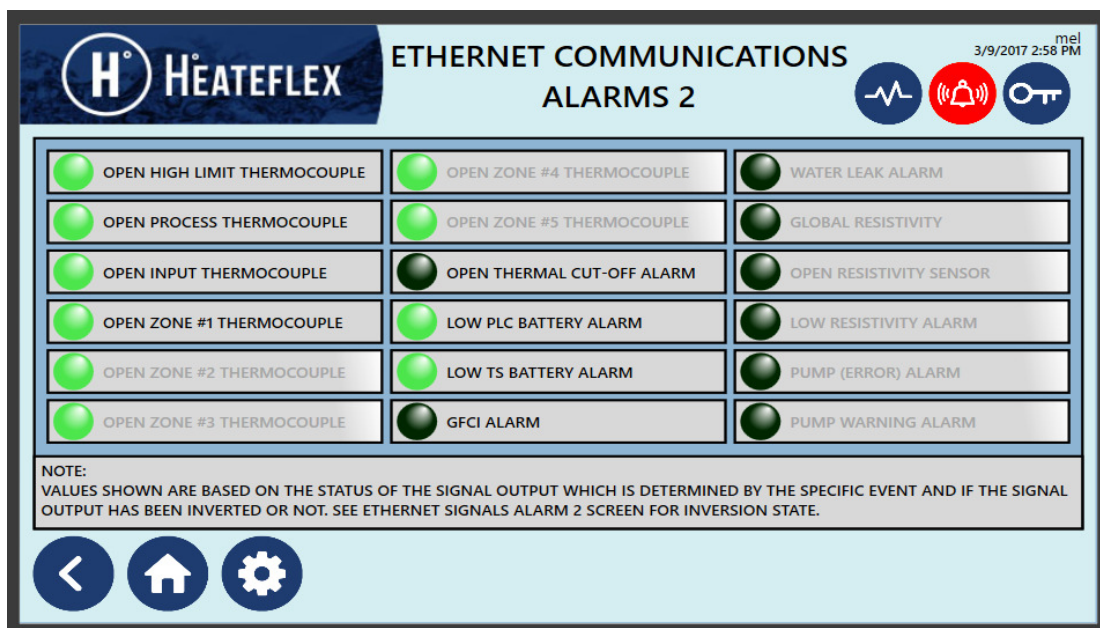


Figure 11-6: Ethernet Communications Status

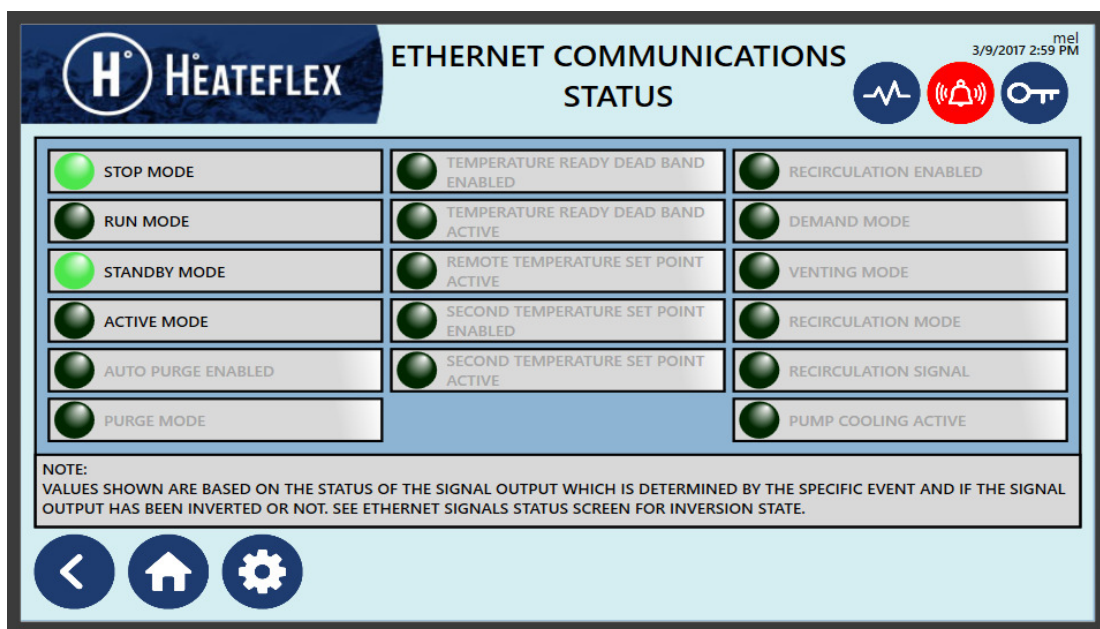

Note: This screen indicates that the system is in “**Stop**” mode and “**Standby**” mode.

The Aquarius® D.I. system values, system settings and system set points can be monitored in Figure 18-5 to Figure 18-7.

Table 18-1 lists the Tag Names of the system values, set points and settings.

Figure 11-7: Ethernet Communications Values Screen

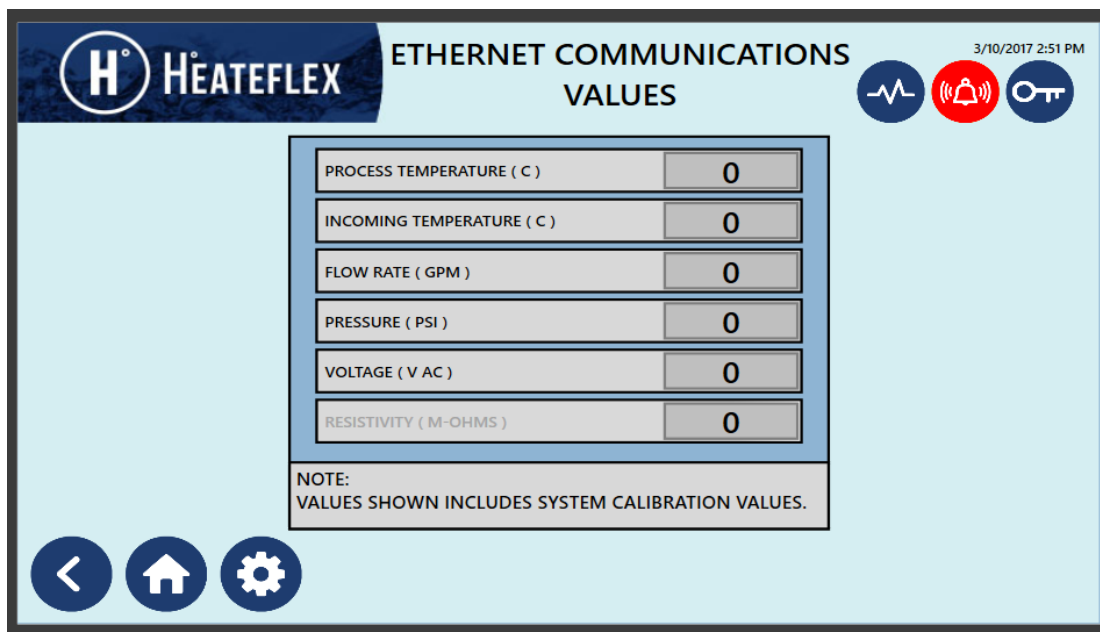


Figure 11-8: Ethernet Communications Set Points Screen

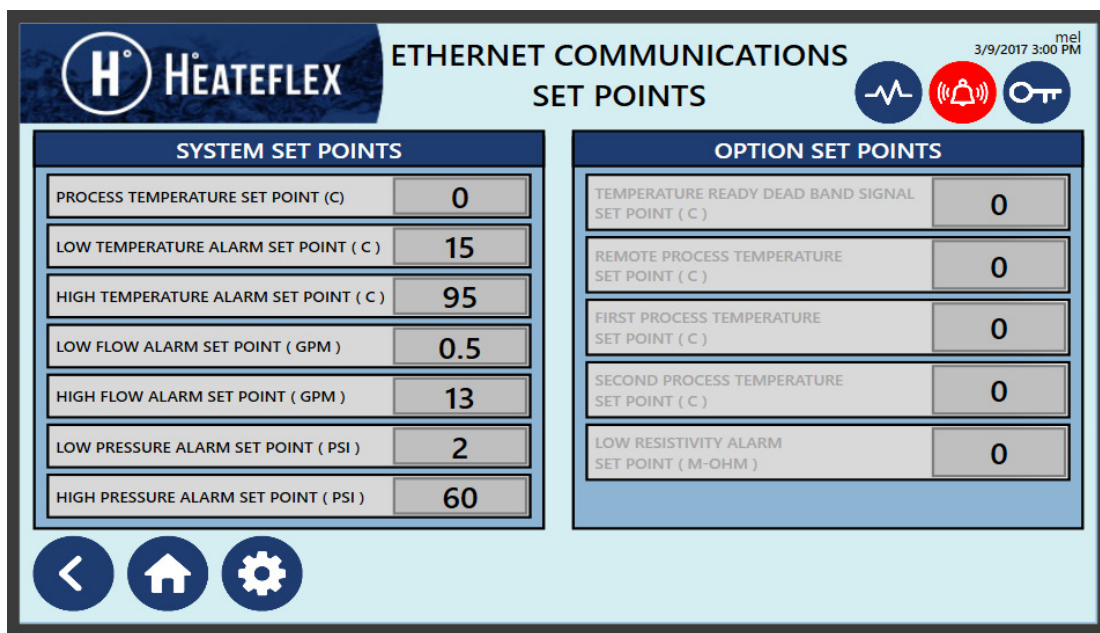


Figure 11-9: Ethernet Communications Settings Screen

ETHERNET COMMUNICATIONS SETTINGS

3/9/2017 2:59 PM
mel

CONTROL SETTINGS			
HEATER AMPERAGE (AMP)	0	CYCLE RATE (SEC)	1
		POWER ADJUST SIGN	1
FREQUENCY (HERTZ)	60	POWER RESET (SEC)	30
		POWER ADJUST (SEC)	0
		AUTO RESET	1

SYSTEM CALIBRATION		
INPUT THERMOCOUPLE CALIBRATION (C)	0	FLOW RATE CALIBRATION (GPM)
		0
PROCESS THERMOCOUPLE CALIBRATION (C)	0	PRESSURE CALIBRATION (PSI)
		0
		VOLTAGE CALIBRATION (VAC)
		0
		RESISTIVITY CALIBRATION (M-OHM)
		0

AUTO PURGE SETTINGS	
AUTO PURGE PERIOD (MIN)	0
	AUTO PURGE DURATION (MIN)
	0

<
⬆
⚙

11.5. ETHERNET ALARM AND STATUS SIGNALS

Signal Inversion is permitted on most of the **Ethernet Communications** system status signals and alarm signals provided that optional features are available and can be modified on the **Ethernet Alarm Signals** screen and the **Ethernet Status Signals** screens. To access these screens, press the **Alarms** or **Status** key located under the **Ethernet Signals** title (Figure 18-1).

Press the **Alarms** key to access the **Ethernet Alarms Signals** screens (Figure 11-10 to Figure 11-11). Press the **Status** key to access the **Ethernet Status Signals** screen (Figure 11-12).

To invert a signal set the specific signal setting to ON. Instructions on how to invert a signal is also detailed on the **Ethernet Alarm Signals** screen and the **Ethernet Status Signals** screens.

Aquarius® optional features that are not available will be greyed out buttons and descriptions and not be selectable.

Please note that inverting any of the signals will affect the data that is sent out from the DI Aquarius® and will directly affect the lamps on the **Ethernet Alarms** screens and the **Ethernet Status** screen.

Refer to Table 11-3 for the Factory Default settings for all of the Ethernet alarm and status signals.

Figure 11-10: Ethernet Signals Alarms 1 Screen

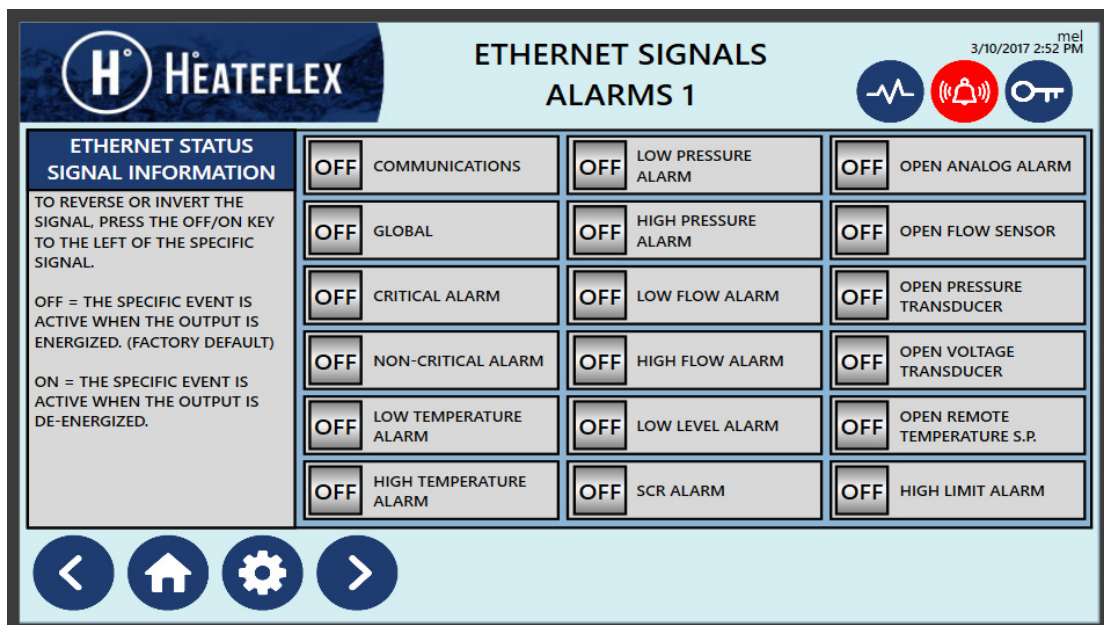


Figure 11-11: Ethernet Signals Alarms 2 Screen


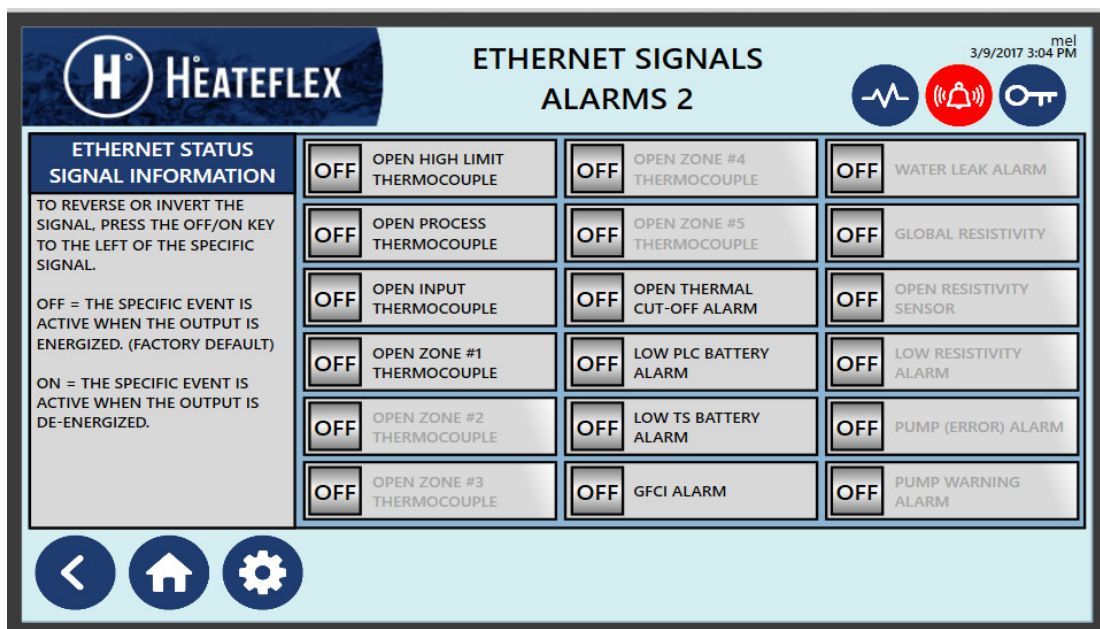


Figure 11-12: Ethernet Signals Status Screen

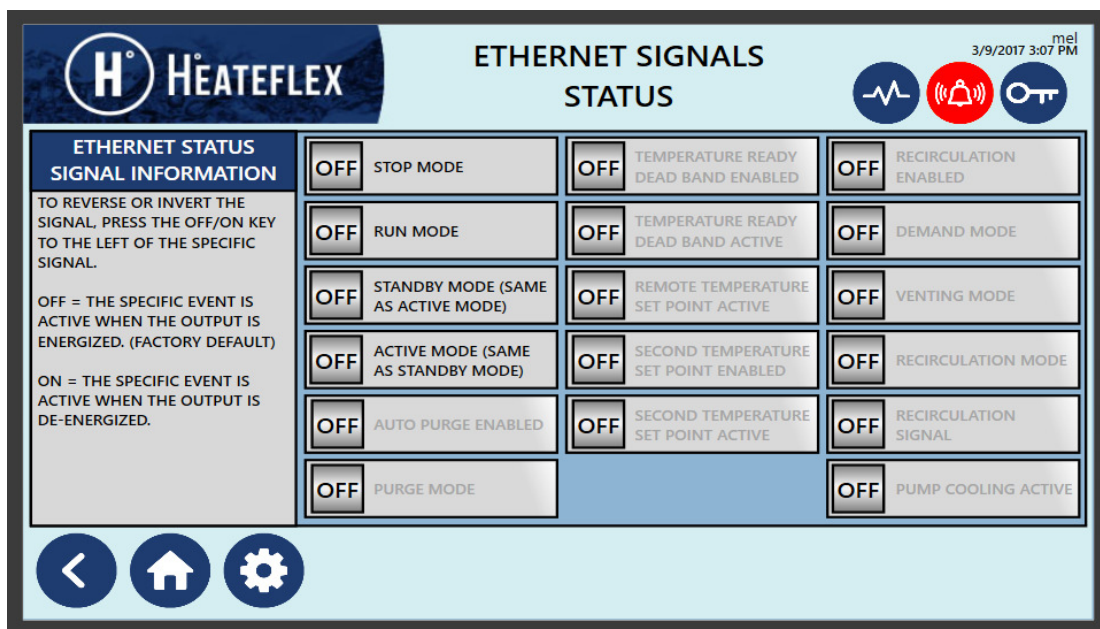


11.6. ETHERNET WRITABLE MENUS

To write to the DI Aquarius PLC, the function must be enabled via the touch screen. This is accessible by going from the **Main Menu > System Setup Menu > Ethernet Interface > Ethernet Write – Standard** (see Figure 11-13) or **Ethernet Write – Option** (Figure 11-14). This will allow you to select whether you want the DI Aquarius PLC to read a specific set of variables from the ethernet written values or the touchscreen using the **Enable Ethernet Write** button shown in Figure 11-13. These screens will also allow you to monitor the current values written to the DI Aquarius PLC via Ethernet Communication. Toggling the **Enable Ethernet write button** does not affect the read variables. Ethernet written values will be ignored when the **Enable Ethernet Write** button is inactive. When the **Enable Ethernet Write** button is active (yellow), all values visible on the screen will be written to the DI Aquarius PLC. All values must be written to the DI Aquarius PLC, zero values will not be ignored.

If the Aquarius detects invalid write values, the Ethernet Write Invalid indicating light will illuminate. This will need to be cleared with the Alarm Reset found in the Alarm menu (see Figure 7-1: Alarm Menu Screen 1)

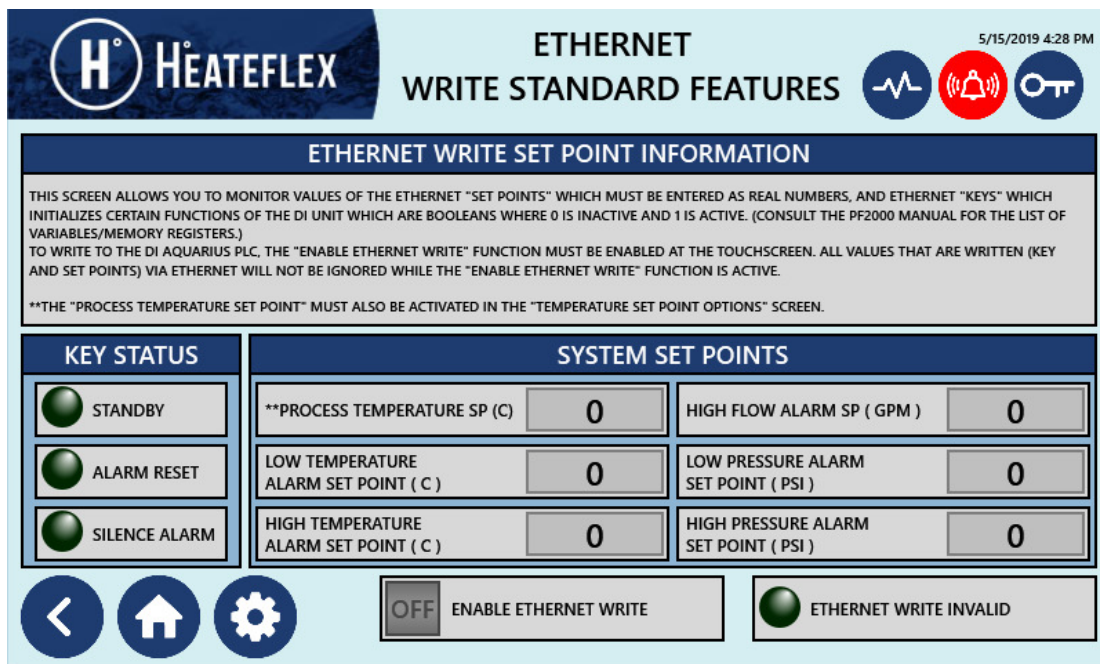Figure 11-13: Ethernet Write Standard Features Screen



ETHERNET WRITE STANDARD FEATURES 5/15/2019 4:28 PM

ETHERNET WRITE SET POINT INFORMATION


THIS SCREEN ALLOWS YOU TO MONITOR VALUES OF THE ETHERNET "SET POINTS" WHICH MUST BE ENTERED AS REAL NUMBERS, AND ETHERNET "KEYS" WHICH INITIALIZES CERTAIN FUNCTIONS OF THE DI UNIT WHICH ARE BOOLEANS WHERE 0 IS INACTIVE AND 1 IS ACTIVE. (CONSULT THE PF2000 MANUAL FOR THE LIST OF VARIABLES/MEMORY REGISTERS.)

TO WRITE TO THE DI AQUARIUS PLC, THE "ENABLE ETHERNET WRITE" FUNCTION MUST BE ENABLED AT THE TOUCHSCREEN. ALL VALUES THAT ARE WRITTEN (KEY AND SET POINTS) VIA ETHERNET WILL NOT BE IGNORED WHILE THE "ENABLE ETHERNET WRITE" FUNCTION IS ACTIVE.

**THE "PROCESS TEMPERATURE SET POINT" MUST ALSO BE ACTIVATED IN THE "TEMPERATURE SET POINT OPTIONS" SCREEN.

KEY STATUS	SYSTEM SET POINTS	
<input type="radio"/> STANDBY	**PROCESS TEMPERATURE SP (C) <input type="text" value="0"/>	HIGH FLOW ALARM SP (GPM) <input type="text" value="0"/>
<input type="radio"/> ALARM RESET	LOW TEMPERATURE ALARM SET POINT (C) <input type="text" value="0"/>	LOW PRESSURE ALARM SET POINT (PSI) <input type="text" value="0"/>
<input type="radio"/> SILENCE ALARM	HIGH TEMPERATURE ALARM SET POINT (C) <input type="text" value="0"/>	HIGH PRESSURE ALARM SET POINT (PSI) <input type="text" value="0"/>

ENABLE ETHERNET WRITE
 ETHERNET WRITE INVALID

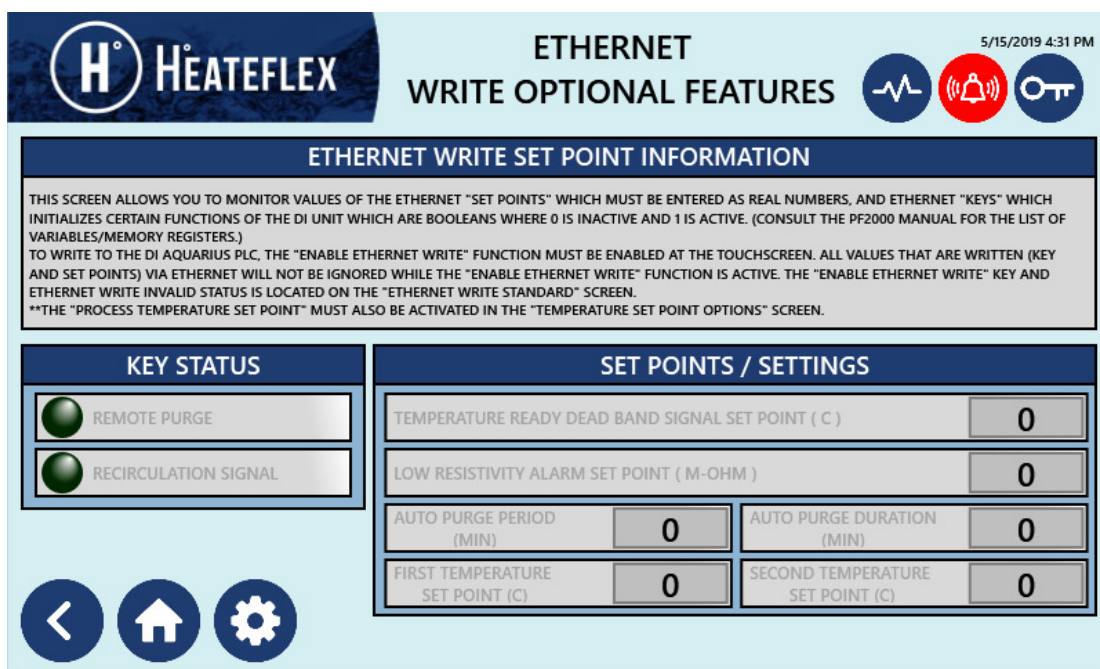

Figure 11-14: Ethernet Write Optional Features Screen


ETHERNET WRITE SET POINT INFORMATION

THIS SCREEN ALLOWS YOU TO MONITOR VALUES OF THE ETHERNET "SET POINTS" WHICH MUST BE ENTERED AS REAL NUMBERS, AND ETHERNET "KEYS" WHICH INITIALIZES CERTAIN FUNCTIONS OF THE DI UNIT WHICH ARE BOOLEANS WHERE 0 IS INACTIVE AND 1 IS ACTIVE. (CONSULT THE PF2000 MANUAL FOR THE LIST OF VARIABLES/MEMORY REGISTERS.)

TO WRITE TO THE DI AQUARIUS PLC, THE "ENABLE ETHERNET WRITE" FUNCTION MUST BE ENABLED AT THE TOUCHSCREEN. ALL VALUES THAT ARE WRITTEN (KEY AND SET POINTS) VIA ETHERNET WILL NOT BE IGNORED WHILE THE "ENABLE ETHERNET WRITE" FUNCTION IS ACTIVE. THE "ENABLE ETHERNET WRITE" KEY AND ETHERNET WRITE INVALID STATUS IS LOCATED ON THE "ETHERNET WRITE STANDARD" SCREEN.

**THE "PROCESS TEMPERATURE SET POINT" MUST ALSO BE ACTIVATED IN THE "TEMPERATURE SET POINT OPTIONS" SCREEN.

KEY STATUS		SET POINTS / SETTINGS	
	REMOTE PURGE	TEMPERATURE READY DEAD BAND SIGNAL SET POINT (C) 0	
	RECIRCULATION SIGNAL	LOW RESISTIVITY ALARM SET POINT (M-OHM) 0	
		AUTO PURGE PERIOD (MIN) 0	AUTO PURGE DURATION (MIN) 0
		FIRST TEMPERATURE SET POINT (C) 0	SECOND TEMPERATURE SET POINT (C) 0

If the ethernet connection is severed between the external device and the DI Aquarius PLC, the DI Aquarius PLC will continue using the last stored variables until the unit is powered down. The DI Aquarius PLC variables can be changed by using the **Enable Ethernet Write** button on the touchscreen or restoring the communications channel.

Table 11-2 shows the set point variables accessible from the DI Aquarius PLC. Not all values are able to be written via ethernet, if they are not the WRITE column will display N/A. To read the current values from the DI Aquarius PLC the variable under the READ column variable must be requested from the PLC IP address and as written in the table.

Table 11-3 shows the status of various alarms and settings on the DI Aquarius PLC. These values are Boolean (0 or 1) with the default values shown in the left most column. These variables cannot be written to and are read only.


11.7. CHANGE ETHERNET IP ADDRESS

The customer has the option to change the IP address of the PLC in order to facilitate communications with their facility. In order to access the Ethernet This setting can be found by accessing the **System Setup** screen then going to **Ethernet Interface** and finally select **Setup** under the **IP Address** header. This screen allows modification of the PLC IP address and Subnet mask. In order to make a change touch the number that needs to be modified. A number pad will be displayed to allow for any desired changes.

Pressing the **MODIFY** button will change the IP address of the PLC to whatever is shown in the IP address and subnet mask areas on the screen.

Pressing the **DEFAULT** button will change the IP address to 192.168.251.001 and subnet mask to 255.255.255.000. These are the original settings which can be used to communicate with the PLC if no changes to the IP address have been made.

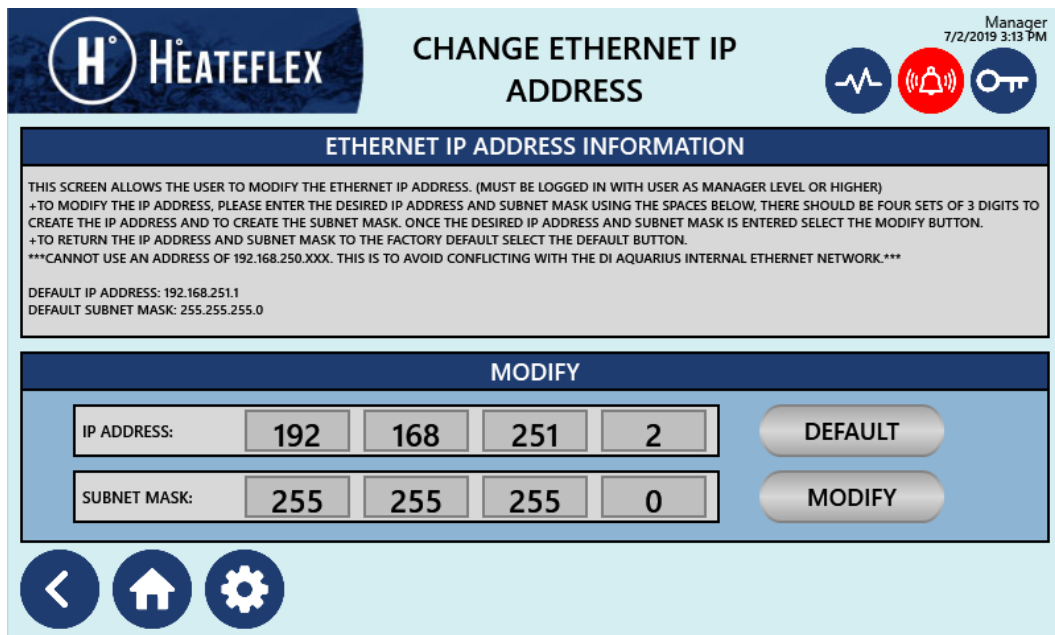Figure 11-15: Change Ethernet IP Address screen



CHANGE ETHERNET IP ADDRESS

Manager 7/2/2019 3:13 PM

ETHERNET IP ADDRESS INFORMATION

THIS SCREEN ALLOWS THE USER TO MODIFY THE ETHERNET IP ADDRESS. (MUST BE LOGGED IN WITH USER AS MANAGER LEVEL OR HIGHER)
 +TO MODIFY THE IP ADDRESS, PLEASE ENTER THE DESIRED IP ADDRESS AND SUBNET MASK USING THE SPACES BELOW. THERE SHOULD BE FOUR SETS OF 3 DIGITS TO CREATE THE IP ADDRESS AND TO CREATE THE SUBNET MASK. ONCE THE DESIRED IP ADDRESS AND SUBNET MASK IS ENTERED SELECT THE MODIFY BUTTON.
 +TO RETURN THE IP ADDRESS AND SUBNET MASK TO THE FACTORY DEFAULT SELECT THE DEFAULT BUTTON.
 CANNOT USE AN ADDRESS OF 192.168.250.XXX. THIS IS TO AVOID CONFLICTING WITH THE DI AQUARIUS INTERNAL ETHERNET NETWORK.

DEFAULT IP ADDRESS: 192.168.251.1
 DEFAULT SUBNET MASK: 255.255.255.0

MODIFY

IP ADDRESS: 192 168 251 2

SUBNET MASK: 255 255 255 0

DEFAULT

MODIFY

< Home Settings

12. AUTO PURGE

This feature is optional for the Aquarius® and is used to reduce the risk of potential bacteria growth in the D.I. water, Aquarius® System and plumbing. An indicating light which can be found next to the **Purge Status** label on the **System Status** screen notifies the user that the Purge/Vent is active. The Purge feature can be activated three ways as detailed below – Automatically, manually, or remotely:

- 2) Automatically: This is governed by the “Auto Purge Duration” and the “Auto Purge Period” parameters. The “**Auto Purge Duration**” parameter is the length of time that the unit is allowed to remain in idle before the **Auto Purge** initiates. The “**Auto Purge Period**” is the actual length of time that the **Auto Purge** will remain active for, it is during this time that the Aquarius® System will purge/vent D.I. water. The **Auto Purge** feature can only be utilized while the system is in **STANDBY** mode, the **AUTO RESET** is set to “**ON**” (refer to Table 5-1 for more information), and there is a no flow condition through the unit. The parameters for the **Auto Purge** feature can be found on the **Purge Mode** screen (see Figure 12-1) which can be accessed by going to the **Main Menu > System Set up > Options Menu > Auto Purge**. Table 12-1 below details all the parameters that can be modified on this screen.


Table 12-1: Auto Purge Parameters

PARAMETER NAME	SETTING RANGE	FACTORY DEFAULT
Enable Auto Purge	Off or On	Off
Auto Purge Period	0 to 600 min (10 hrs) (Integers Only)	1 min
Auto Purge Duration	0 to 60 min (Integers Only)	1 min

Please note that the **PF3000** will prompt you to enter the **User Password** in order to access the **Auto Purge** parameters and enable the **Auto Purge** feature.

- a. To access the **Auto Purge** screen, start with the **Main Menu** screen, then select **System Set Up**, next select **Options Menu**, and finally select **Auto Purge**. The **Auto Purge** screen will appear as shown in Figure 12-1.
- b. Enter the desired values for both the “**Auto Purge Duration**” and the “**Auto Purge Period**” parameters respectively. These values will be stored.
- c. Press the “**OFF**” key located next to the “**Enable Auto Purge**” label. The “**OFF**” key will then change to “**ON**” and will be illuminated yellow indicating that the **Auto Purge** feature is active.

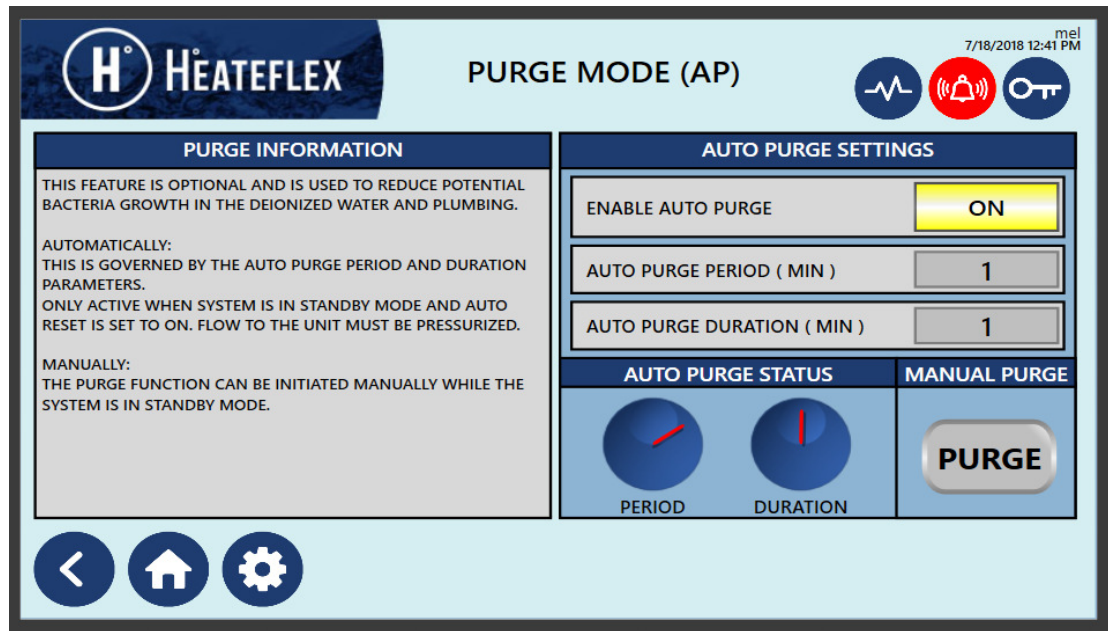Figure 12-1: Purge Mode Screen



- 3) Manually: by pressing the “**PURGE**” key located in the **Auto Purge** User Selected Display on the **System Status** screen. Reference Figure 5-1 and 5-3. Please note that the Purge/Vent can only be manually initiated when the system is in **STANDBY** mode.
- 4) Remotely (if applicable): by pressing a remote momentary switch or signal through a communications interface. Please refer to Section 15 of this Instruction Manual or the Electrical Schematic Drawing for more information. Please note that the Purge/Vent can only be initiated remotely when the system is in **STANDBY** mode.


13. RECIRCULATION

The Aquarius® D.I. Water Heating Systems feature a built-in recirculation system and is equipped with an ultra-pure PFA-PTFE bearing-less pump, a pump air cooling system, and safety interlocks that are controlled with the PF3000 Controller.

Please follow all Pre-Installation Preparation, Installation, Suggested Operational Inspection procedures and the Pump Air Cooling System Set Up and Calibration prior to activating recirculation. This includes the connection of an external maintain switch/signal to the Aquarius® “Recirculation Signal”. Please refer to the specific Electrical Component Layout drawing and the Electrical Schematic drawing for more information.

The Aquarius® D.I. Water Heating Recirculation System Recirculation modes are indicated on the **System Status** screen as shown in Figure 13-1. The three different modes are illustrated by a series of labels and/or lamps which are detailed in Table 13-1. Note that the Recirculation Menu may be displayed when the Recirculation Key is selected.

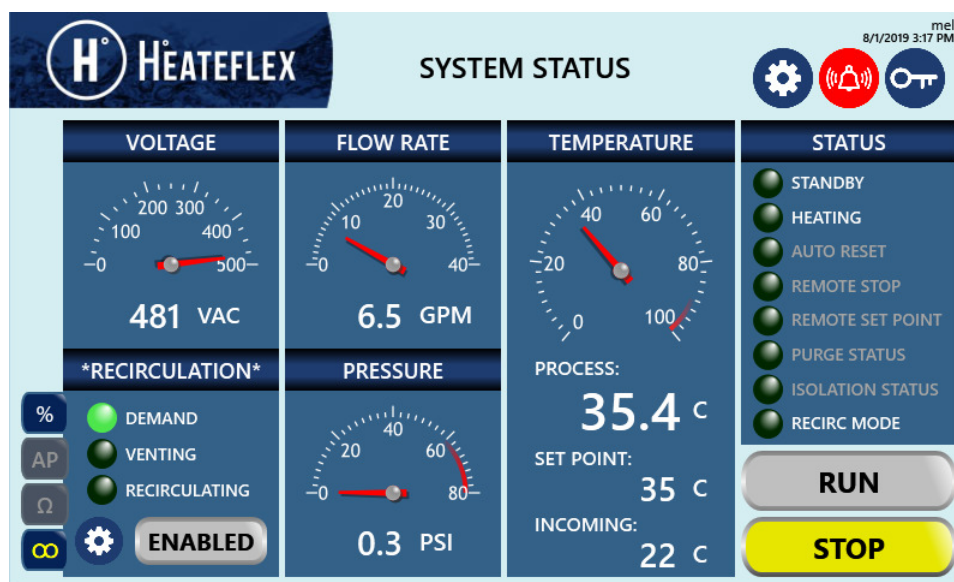Figure 13-1: System Status screen with Recirculation Mode Active



Note: The screen shown above is representative and may vary in appearance depending on the options selected.

Table 13-1: Recirculation Modes

MODE LAMP	DESCRIPTION
DEMAND	This is the default mode of the system. The system is in DEMAND mode and the recirculation system is not active. When the DEMAND mode is active the “Demand” lamp will illuminate green and/or the “Demand” label may be displayed.
VENTING	<p>During the VENTING mode the recirculation system is preparing to initiate and is either filling the pump and/or evacuating the system plumbing of any air/bubbles that may exist. Once the system plumbing is free of excessive air/bubbles the RECIRCULATION mode will activate. When the VENTING mode is active the “Venting” lamp will illuminate green and/or the “Venting” label may be displayed.</p> <p>Please note that the VENTING mode will activate if excessive air/bubbles are detected within the recirculation plumbing.</p>
RECIRCULATION	The system is in RECIRCULATION mode and no fluid is being diverted to process. When the RECIRCULATION mode is active the “Recirculation” lamp will illuminate green and/or the “Recirculation” label may be displayed.

The following conditions are necessary to place the Aquarius® into the **RECIRCULATION** mode:

- The Recirculation System must be enabled.
- A customer provided “Recirculation Signal” is required to send the system into the Recirculation mode.
- The Venting mode cannot be active.

If the above conditions are not met the Aquarius® will fail to enter the **RECIRCULATION** mode and remain in the **DEMAND** mode. Please note that the “Recirculation Signal” has no effect on the system if the Recirculation System is disabled. Table 13-1 details all recirculation settings. See Table 13-3 for details on the Recirculation Signal.

Table 13-2: Recirculation Parameters

SETTING NAME	SETTING RANGE	FACTORY DEFAULT
Recirculation System Enabled/Disabled	Disabled or Enabled	Disabled

Table 13-3: Recirculation Signal

RECIRCULATION SIGNAL	RECIRCULATION SYSTEM STATUS
Relay Open (Default)	Inactive
Relay Closed	Active

NOTE:

- The presence of any “critical” alarms will abort recirculation by shutting off the pump and deactivating the heaters. Once the “critical” alarms have been resolved, recirculation will automatically resume but the Aquarius® will be in **STANDBY** mode and the heaters will remain OFF until the system is placed back into the **ACTIVE** mode.
- The Process Temperature Set Point cannot be changed while Recirculation is active (System Status Screen Recirculation System is set to Enabled and the Remote User Recirculation Signal is in Active Status).

13.1. ACTIVATING RECIRCULATION

To ensure that the Recirculation feature is activated properly, it is required to have a local and remote setting be active for the Recirculation be activated. This is to ensure that personnel local and remote to the unit are aware.

1. Enable the Recirculation System by pressing the **DISABLED** key on the **System Status** screen. The “**Disabled**” label will change to “**Enabled**” which will be illuminated yellow. The **ENABLED / DISABLED** is illustrated in Figure 13-2.
2. Send the closed “Recirculation Signal” to the Aquarius® system to switch from **DEMAND** mode and to enter the **RECIRCULATION** mode.

13.2. DEACTIVATING RECIRCULATION

Open the “Recirculation Signal” to the Aquarius® system to switch from **RECIRCULATION** mode to **DEMAND** mode.


13.3. OR

Disable the Recirculation System by pressing the **ENABLED** key on the **System Status** screen. The “**Enabled**” label will change to “**Disabled**” and the system will automatically return to **DEMAND** mode. This particular method to deactivate recirculation will override the “Recirculation Signal” since the Recirculation System has been disabled.

13.4. PUMP AIR COOLING SYSTEM CALIBRATION

The pump air cooling system calibration can easily be done provided that all air supply connections for the pump air cooling system have been facilitated by pressing the **“Pump Air Cooling Calibration ON/OFF”** key located on the **Recirculation Mode Screen**. Along with the **“Pump Air Cooling Calibration ON/OFF”** key, the **Recirculation Mode Screen** includes general information and input and output status indicating lamps. These features are illustrated in Figure 13-2.

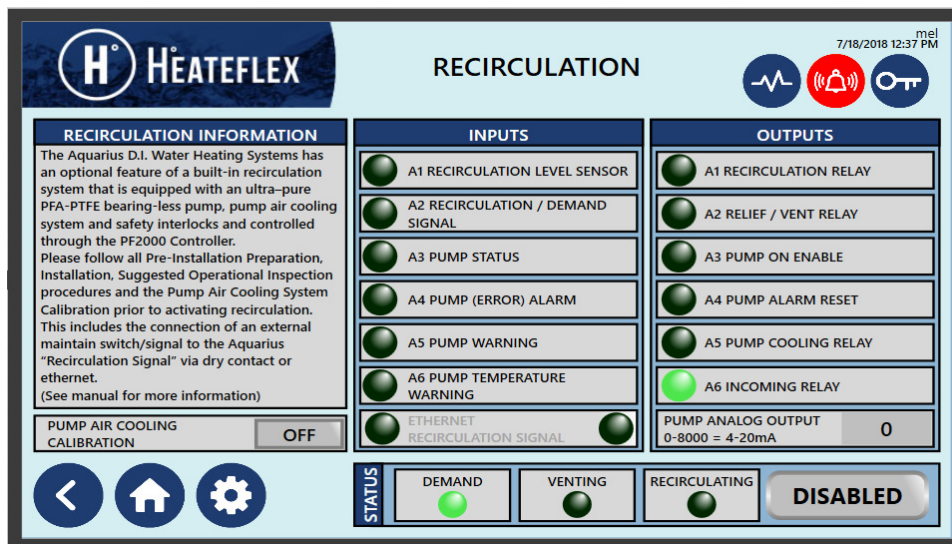Figure 13-2: Recirculation Mode Screen



This pump air cooling system calibration is achieved by regulating the air pressure of the pump air cooling system when it is active. To perform this calibration procedure access to the interior enclosure of the Aquarius® D.I. Water Heating System with the system powered ON is required.

Please take extreme cautionary measures as live voltage will be present in the Aquarius® D.I. Water Heating System during the Pump Air Cooling System Calibration procedure.

- 1) Take the appropriate steps necessary to have the Aquarius® D.I. Water Heating System powered ON with the enclosure door open. Please note that the Door Interlock switch will prevent the unit from powering ON when the enclosure door is open.
- 2) Verify that an adequate steady supply of air is being supplied to the pump air cooling system (60 psi maximum).
- 3) Locate the pump air cooling system pressure regulator/gauge in the heater compartment of the Aquarius® D.I. Water Heating System

and take note of the air pressure reading on the pressure gauge. Please refer to the Mechanical Layout Drawing in **SECTION II** for its specific location.

- 4) Turn the Aquarius® D.I. Water Heating System ON, once again with the enclosure door open.
- 5) Verify that the Recirculation System is enabled which is indicated by an illuminated yellow “**Enabled**” key on the **System Status** screen. If the Recirculation System is not enabled press the **DISABLED** key.
- 6) Send the unit into Recirculation mode by providing a closed “Recirculation Signal”.
- 7) Once the unit is in Recirculation mode, activate the pump air cooling system temporarily by pressing the “**Pump Air Cooling System Calibration ON/OFF**” key located on the **System Calibration** screen.
- 8) The pump air cooling system will activate for approximately 60 seconds and then shut off. Please note that the air pressure reading on the pressure gauge may drop when the pump air cooling system is actively cooling.
- 9) With the pump air cooling system active, check the air pressure reading on the pressure gauge and regulate the air pressure of the pump air cooling system to a pressure greater than the air regulator pressure setting. See plumbing schematic for air regulator setting.

During normal recirculation, the pump air cooling feature will activate when the pump motor temperature exceeds an internally programmed temperature.


14. TEMPERATURE READY DEAD BAND (DB) SIGNAL


The **Temperature Ready Dead Band Signal** is a feature for the Aquarius® D.I. Water Heating System that provides an external digital signal or dry contact signal to notify the user that the process fluid temperature is within a customer specified dead band range.

14.1. TEMPERATURE READY DEAD BAND SETUP

To access the **Temperature Ready Signal** screen, start with the **Main Menu** screen, then select **System Set Up**, next select **Options Settings**, and finally select **Temperature Ready Signal**. The **Temperature Ready Signal** screen will appear and is shown in Figure 14-1.

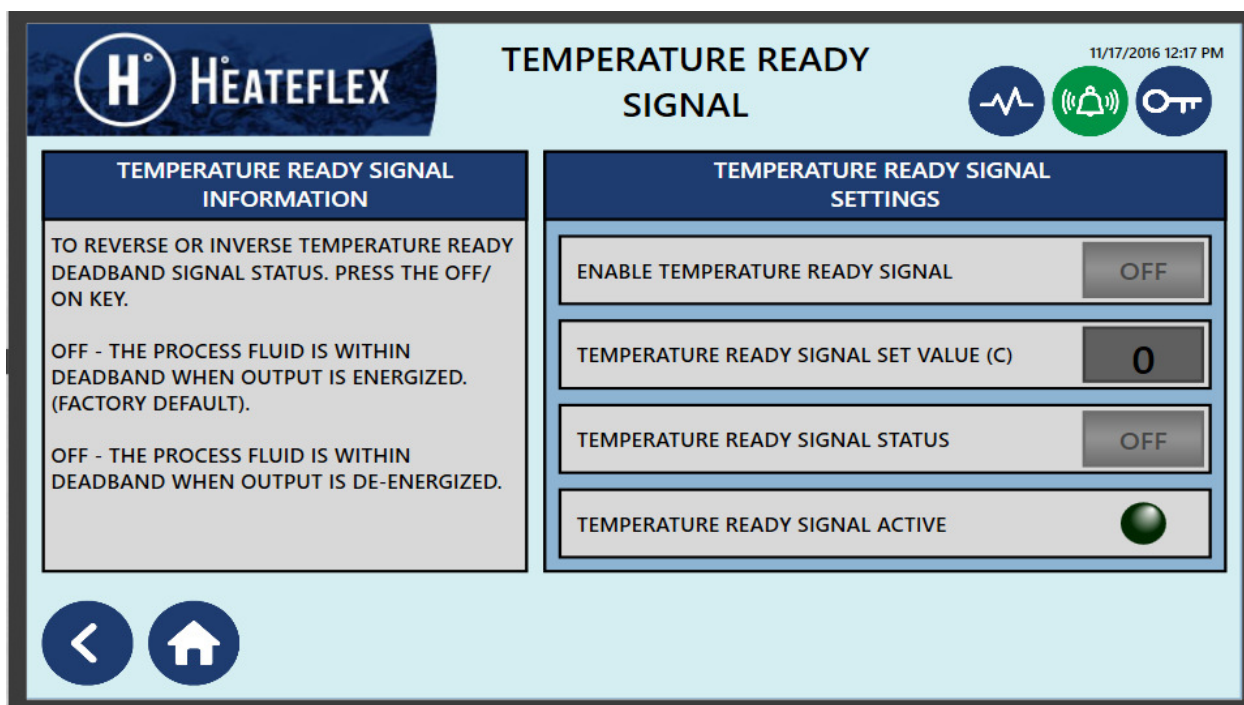


Figure 14-1: Temperature Ready Signal Screen





TEMPERATURE READY SIGNAL

11/17/2016 12:17 PM

TEMPERATURE READY SIGNAL
INFORMATION

TO REVERSE OR INVERSE TEMPERATURE READY DEADBAND SIGNAL STATUS. PRESS THE OFF/ ON KEY.

OFF - THE PROCESS FLUID IS WITHIN DEADBAND WHEN OUTPUT IS ENERGIZED. (FACTORY DEFAULT).

OFF - THE PROCESS FLUID IS WITHIN DEADBAND WHEN OUTPUT IS DE-ENERGIZED.

TEMPERATURE READY SIGNAL
SETTINGS

ENABLE TEMPERATURE READY SIGNAL

OFF

TEMPERATURE READY SIGNAL SET VALUE (C)



0

TEMPERATURE READY SIGNAL STATUS

OFF

TEMPERATURE READY SIGNAL ACTIVE

●

Refer to Table 14-1 for detailed information on the **Temperature Ready Dead Band Signal**.

Table 14-1: Temperature Ready Dead Band Signal

SIGNAL INVERSION			OFF (DEFAULT)		ON		SIGNAL INVERSION CAPABILITY
DISCRETE INTERFACE	POWER OFF	OPTION N/A	INACTIVE	ACTIVE	INACTIVE	ACTIVE	
Temperature Ready Dead Band Signal ²	0	Std.	1	0	0	1	Yes

NOTE:

1. 0 – Open Signal
1 – Closed Signal
2. Signal inversion is specific to the respective Communication Interface. Same signal types must be inverted on each respective communication interface.

Please note that the **PF3000** requires an authorized user to modify or change the “**Temperature Ready Signal Set Value**”, the “**Temperature Ready Signal Status**” and to enable the **Temperature Ready Dead Band Signal** feature.

To utilize the **Temperature Ready Dead Band Signal** feature, the “**Enable Temperature Ready Signal**” setting must be set to ON and a value must be entered into the “**Temperature Ready Signal Set Value**” setting as illustrated in Figure 14-1.

The Temperature Ready Dead Band Signal is Factory Defaulted to be normally open or de-energized when outside of the dead band (“**Temp. Ready Signal Status**” set to the OFF position). Once the process fluid temperature is within the dead band the Temperature Ready Dead Band Signal will close or become energized. Please note that the Temperature Ready Dead Band Signal may be inverted if desired. To invert this signal, set the “**Temp. Ready Signal Status**” setting to ON. Instructions on how to invert this signal is also detailed on the **Temperature Ready Signal** screen.

Table 14-2 details all the parameters that can be modified on this screen as well as the Factory Default settings or values.

Table 14-2: Temperature Ready DB Signal Parameters and Settings

PARAMETER NAME	SETTING RANGE	FACTORY DEFAULT
Enable Temperature Ready Signal	Off or On	Off
Temperature Ready Signal Set Value	0.1 to 10.0 °C	5.0 °C
Temperature Ready Signal Status	Off = The process fluid is within the Temperature Ready DB Signal Set Point when the output is energized. (Factory Default) On = The process fluid is within the Temperature Ready DB Signal Set Point when the output is de-energized.	Off
Temperature Ready Signal Active	No illumination = Inactive Illuminated Green = Active	-

14.2. TEMPERATURE READY DEAD BAND SIGNAL WIRING

The wiring detail listed in Table 13-3 is the “standard” configurations for Aquarius® D.I. Water Heating Systems. Please refer to the specific Electrical Schematic Diagram for more information.


Table 14-3: Temperature Ready Dead Band Signal Wiring Configuration

NUMBER	COLOR	STRIPE	FUNCTION
1	Brown	N/A	Signal Out
2	Blue	N/A	Common

15. TEMPERATURE SETPOINT OPTIONS

The Aquarius® D.I. Water Heating System has various ways of setting the Process Temperature Set Point, locally and remotely via Ethernet communication, Analog communication and a dry signal to toggle between two preset temperature set points for the **Secondary Process Temperature** feature. The **Temperature Set Point Options** is a screen to allow the user to select which Process Temperature Set Point to be active and access the Secondary Process Temperature Set Point Settings of the Aquarius® D.I. Water Heating System.

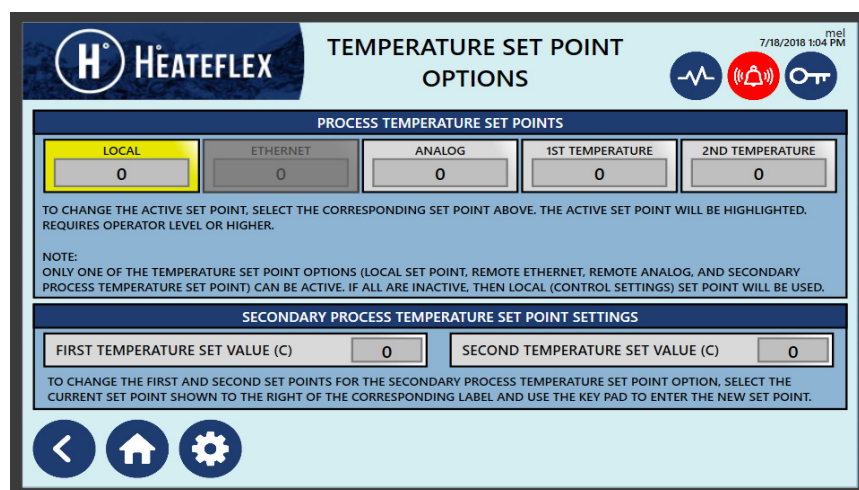Figure 15-1: Temperature Set Point Options Screen



Note: The appearance of the **Temperature Set Point Options** screen may vary depending on the Aquarius® D.I. Water Heating System options.

To access the **Temperature Set Point Options Screen**, start with the **Main Menu** screen, then select **System Set Up**, next select **Options Settings**, and finally select **Temperature Set Point Options**. The **Temperature Set Point Options** screen will appear.

On the **Temperature Set Point Options** Screen there are two sub-menus – **Process Temperature Set Points** and **Secondary Process Temperature Set Point Settings**. This is shown in **Error! Reference source not found.** The **Process Temperature Set Points** sub-menu displays set point values for Local, Ethernet, Analog, 1st Temperature, and 2nd Temperature. The active set point will be highlighted. To change the active set point, select the desired set point.

Please note that the **Remote Process Temperature Set Point** and/or the **Secondary Process Temperature Set Point** options cannot be operated at the same time, operation of these features is permitted to the use of one option at any one time.

15.1. SECONDARY PROCESS TEMPERATURE SET POINT

The **Secondary Process Temperature Set Point** feature is used to quickly change from a primary process temperature set point to a secondary process temperature set point using a remote dry contact signal. Below the **Process Temperature Set Points** is the **Secondary Process Temperature Set Points Settings** sub-menu. Here, the 1st and 2nd Temperature Set Values can be inputted. Table 15-1 details all the parameters that can be modified on this screen.

Table 15-1: Secondary Process Temp. Set Point Parameters and Settings

PARAMETER NAME	SETTING RANGE	FACTORY DEFAULT	Dry Contact Signal
Process Temperature Set Point Selection	Local, Ethernet, Analog, 1 st Temperature, 2 nd Temperature.	Local	-
First Temperature Set Value (Default)	0 to 95 °C (Integers Only)	0 °C	Open / "OFF"
Second Temperature Set Value	0 to 95 °C (Integers Only)	0 °C	Closed / "ON"

Please note that the **PF3000** requires a user with the proper to be logged in with in order to modify or change the "**First Temperature Set Value**", the "**Second Temperature Set Value**" parameters and enable the **Secondary Process Temperature Set Point** feature.

Enter the desired values for "**First Temperature Set Value**" and the "**Second Temperature Set Value**" parameters respectively.

To enable one of the **Secondary Process Temperature Set Point** feature, press on either the **1st Temperature** or **2nd Temperature** labels located on the **Process Temperature Set Points** section on the upper part of the **Temperature Set Point Options** screen. Either the **1st Temperature** or the **2nd Temperature** label will become illuminated yellow indicating that the **Secondary Process Temperature Set Point** feature is active which one will be dependent on the remote signal used to control which set point is used. Please note that this parameter needs to be enabled in order for the Aquarius® System to recognize the dry contact Signal. Please refer to the respective Electrical Schematic Drawing for actual connections.

Provide a dry contact signal to the Aquarius® indicating which temperature set point to initiate. The **“First Temperature Set Value”** is the default temperature set point parameter and requires no remote signal. To toggle or switch to the **“Second Temperature Set Value”** provide a closed or “ON” signal to the Aquarius® System. The **“First Temperature Set Value”** or **“Second Temperature Set Value”** on this screen will illuminate yellow indicating which temperature set point is active. In addition, the corresponding active temperature set point label will be indicated on the **System Status** screen as shown in Figure 5-1 when active.

16. ANALOG INTERFACE

The **Analog Interface** option is a communications feature for the Aquarius® D.I. Water Heating System. The **Analog Interface** allows the ability to remotely enter a “**Process Temperature Set Point**” and to monitor the temperature and flow rate of the Aquarius® D.I. Water Heating System.

16.1. ANALOG INTERFACE WIRING CONFIGURATION

The wiring detail listed in Table 15-3 is the “standard” configurations for Aquarius® D.I. Water Heating Systems. Please refer to the specific Electrical Schematic Diagram for more information.


Table 16-1: Analog Interface Wiring Configuration

NUMBER	COLOR	STRIPE	FUNCTION
1	White	N/A	Remote Set Point (+)
2	Brown	N/A	Remote Set Point (-)
3	Green	N/A	Ground
4	Yellow	N/A	Temperature Retransmit (+)
5	Grey	Brown	Temperature Retransmit (-)
6	Pink	N/A	Flow Retransmit (+)
7	Blue	N/A	Flow Retransmit (-)
8	Red	N/A	Not Used

16.2. ANALOG INTERFACE VALUES

To monitor and set up the Analog Interface parameters navigate to the **Analog Interface Signals** screen, **Main Menu > System Setup Menu > Option Settings > Analog Interface**. See Figure 16-1 below. From here the customer can monitor the analog signals (labeled Analog) that are being sent to and from the Aquarius unit as well as the temperature and flow values that they are being calculated as (labeled as Real). For example, if the Remote Process Temperature Set Point Range is set to 0.0°C for the **Low Scale** and to 100.0°C for the **High Scale** and the analog signal received is 12mA (shown in the box labeled **Analog**), the **Real** value calculated for the Remote Process Temperature Set Point is 50.0°C.

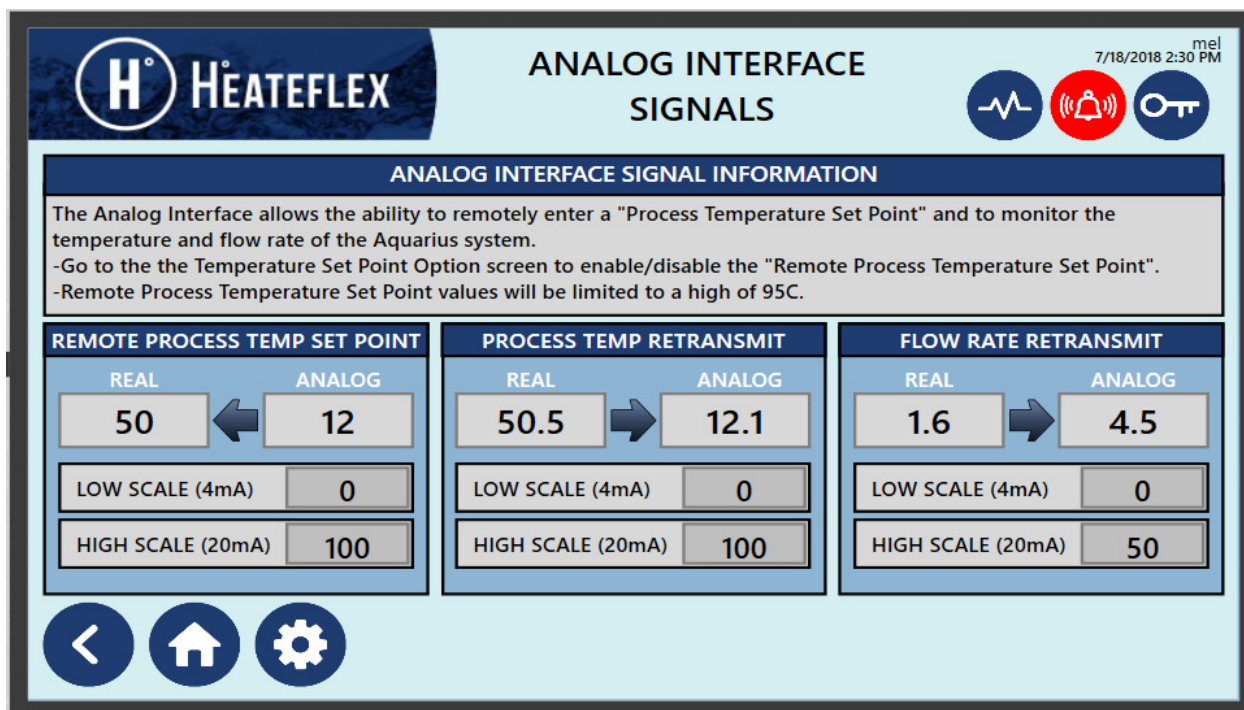Figure 16-1: Analog Interface Signals screen



16.3. ANALOG INTERFACE SETUP

To allow the customer more flexibility in the signal ranges, the user can define the 4-20mA range for the analog signals of their Aquarius System. To have access to these parameters the user must be logged in as a manager level or higher. Once logged in with appropriate user name, set a user defined range for the analog interface parameter the user must enter the **Low Scale** value (the value of the 4 mA signal) and the **High Scale** value (the value of the 20mA). Refer to Table 16-2 for all the analog signals and their value range. It is important that the **Low Scale** value be less than the **High Scale** value to avoid error.

Table 16-2: Analog Interface Value Ranges

ANALOG INTERFACE	SIGNAL	RANGE	DEFAULT VALUE	USER DEFINED
Remote Temperature Set Point ¹	Low Scale 4mA	0.0 to 200.0 °C	0 °C	
	High Scale 20mA	0.0 to 200.0 °C	100 °C	
Process Temperature Retransmit	Low Scale 4mA	0.0 to 200.0 °C	0 °C	
	High Scale 20mA	0.0 to 200.0 °C	100 °C	
Flow Rate Retransmit ¹	Low Scale 4mA	0.0 to 100.0 GPM	0.0 GPM	
	High Scale 20mA	0.0 to 100.0 GPM	50.0 GPM	

NOTE:

3. Remote Process Temperature Set Point will be limited to 95C if value calculated exceeds 95C unless otherwise specified.

To utilize the **Remote Process Temperature Set Point** feature, the “**Analog**” Process Temperature Set Point setting must be selected on the **Temperature Set Point Options** screen and a 4-20mA signal must be sent to the Aquarius® D.I. Water Heating System. Please note that the **Open Analog Alarm**, specifically the **Remote Temperature Set Point Alarm** will trigger if the **Analog** process temperature set point is active and no 4-20mA signal is present. Reference Section 15 for more information on **Temperature Set Point Options** for more information on selecting the Process Temperature Set Point.

17. DISCRETE INTERFACE

The **Discrete Interface** option is a communications feature for the Aquarius® D.I. Water Heating System. The **Discrete Interface** allows remote operation of the Aquarius® unit such as “**Remote Emergency Off (EMO)**”, “**Remote Stop (Standby)**”, “**Remote Alarm Reset**”, and “**Remote Purge**”. In addition the **Discrete Interface** also provides external digital signals for the **Purge Status** and for the status of “critical alarms” and/or “non-critical alarms”. Refer to Table 17-1 for more information on the **Discrete Interface** option.

The **Discrete Interface** package includes the following:

- **Remote Emergency Off (EMO)**
 - Allows the Aquarius® unit to be shut off from a remote location and/or from other equipment associated with the Aquarius® D.I. Water Heating System.
- **Remote Stop (Standby)**
 - Allows the user to “Stop” the Aquarius® and place the system into Standby mode, thus disabling the heaters from a remote location.
- **Remote Alarm Reset**
 - Allows the user to reset most of the Aquarius® alarms from a remote location.
- **Remote Purge**
 - Allows the user to initiate the Aquarius® **Purge** feature from a remote location (provided that the **Auto Purge** option is selected).
- **Purge Status**
 - Allows the user to monitor the Aquarius® D.I. Water Heating System **Purge** feature through an external signal to a remote location. (provided that the **Auto Purge** option is selected)
- **Critical Alarms Status**
 - Allows the user to monitor for any “critical alarms” from the Aquarius® D.I. Water Heating System through an external signal to a remote location.
- **Non-Critical Alarm Status**
 - Allows the user to monitor for any “non-critical alarms” from the Aquarius® D.I. Water Heating System through an external signal to a remote location.
- **Temperature Ready Dead Band**
 - An external signal that notifies the user that the process fluid temperature is within a customer specified dead band range. Reference Section 14 for more information.


17.1. DISCRETE INTERFACE SET UP


Signal Inversion is permitted on certain signals of the **Discrete Interface** and can be modified on the **Discrete Interface Signals** screen. To access the **Discrete Interface** screen, start with the **Main Menu > System Setup Menu > Option Settings**, and select **Discrete Interface**. The **Discrete Interface Signals** screen will appear.

To invert the signals for the Critical alarm or the Non Critical alarm, select the **OFF/ON** key to the left of the signal you would like to invert located in the **Discrete Interface Signal Settings** section.

Table 17-2 details all the settings that can be modified on this screen as well as the Factory Default settings.

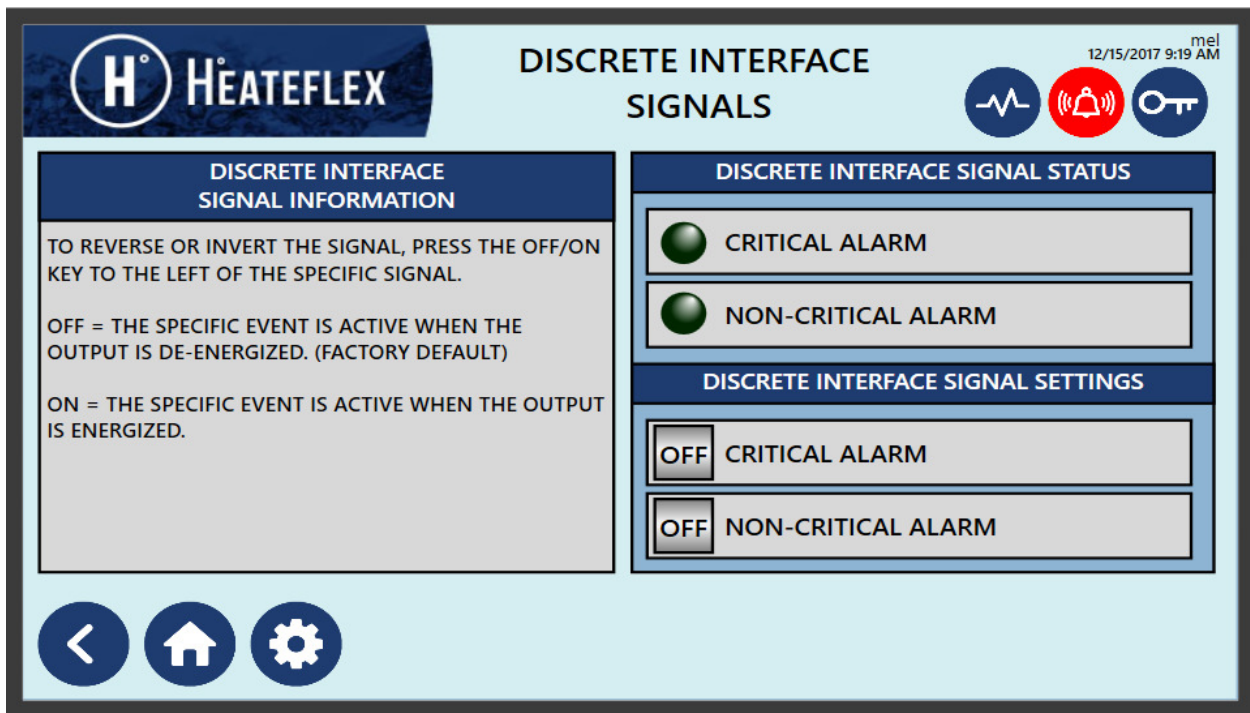


Figure 17-1: Discrete Interface Signals Screen





DISCRETE INTERFACE SIGNALS

12/15/2017 9:19 AM mel


DISCRETE INTERFACE SIGNAL INFORMATION

TO REVERSE OR INVERT THE SIGNAL, PRESS THE OFF/ON KEY TO THE LEFT OF THE SPECIFIC SIGNAL.


OFF = THE SPECIFIC EVENT IS ACTIVE WHEN THE OUTPUT IS DE-ENERGIZED. (FACTORY DEFAULT)

ON = THE SPECIFIC EVENT IS ACTIVE WHEN THE OUTPUT IS ENERGIZED.

DISCRETE INTERFACE SIGNAL STATUS



CRITICAL ALARM



NON-CRITICAL ALARM

DISCRETE INTERFACE SIGNAL SETTINGS

OFF

CRITICAL ALARM

OFF

NON-CRITICAL ALARM








Table 17-1: Discrete Interface

SIGNAL INVERSION			OFF (DEFAULT)		ON		SIGNAL INVERSION CAPABILITY
DISCRETE INTERFACE	POWER OFF	OPTION N/A	INACTIVE	ACTIVE	INACTIVE	ACTIVE	
Non-Critical Alarm Status ³	0	Std.	1	0	0	1	Yes
Critical Alarm Status ³	0	Std.	1	0	0	1	Yes
Purge Status ^{2, 6}	0	0	0	1	-	-	No
Remote Purge ²	-	-	0	1	-	-	-
Remote Emergency OFF (EMO)	-	-	1	0	-	-	-
Remote Alarm Reset ⁴	-	-	0	1	-	-	-
Remote Stop (Standby) ⁵	-	-	0	1	-	-	-
Temperature Ready Dead Band			See Section 14				

NOTE:

4. 0 – Open Signal
1 – Closed Signal
2. Available when specific option is selected.
3. Signal inversion is specific to the respective Communication interface. Same signal types must be inverted on each respective communication interface.
5. The “**Remote Alarm Reset**” will not reset the GFCI Alarm. The GFCI Alarm must be reset locally on the unit.
5. The **RUN** key on the System Status screen must be pressed first in order to utilize the “**Remote Stop**” feature.
6. **Purge Status** signal is sent through a relay and not through the PLC.

Table 17-2: Discrete Interface Settings

SETTING NAME	SETTING RANGE	FACTORY DEFAULT
Non-Critical Alarm Status	Off or On	Off
Critical Alarm Status	Off or On	Off

17.2. DISCRETE INTERFACE WIRING CONFIGURATION

The wiring detail listed in Table 17-3 is the “standard” configurations for Aquarius® D.I. Water Heating Systems. Please refer to the specific Electrical Schematic Diagram for more information.

Table 17-3: Discrete Interface Wiring Configuration

NUMBER	COLOR	STRIPE	FUNCTION
A	Brown	N/A	2 nd Pole EMO
C	Red	Blue	2 nd Pole EMO
E	Black	N/A	Remote EMO
G	Pink	N/A	Remote EMO
J	Green	N/A	Spare
L	Blue	N/A	Common
M	Orange	N/A	Common
N	Grey	Brown	Remote Purge Status (OUT)
O	Violet	N/A	Non-critical Alarm Status (OUT)
P	White	N/A	Critical Alarm Status (OUT)
R	Red	N/A	Remote Alarm Reset (IN)
S	Grey	N/A	Remote Purge Start/Stop (IN)
T	Yellow	N/A	Remote Standby/Active (IN)
U	Tan	N/A	Temperature Ready Dead Band

18. DRY CONTACT INTERFACE

The **Dry Contact Interface** option is a communications feature for the Aquarius® D.I. Water Heating System that allows the user to monitor the status of various conditions and alarms remotely. The **Dry Contact Interface** provides 15 dry contact relays for remote monitoring of the Aquarius® D.I. Water Heating System.

The standard **Dry Contact Interface** package includes the following:

- **Active mode**
- **Thermal Cut-Off Alarm**
- **High Limit Alarm**
- **Open Sensor Alarm** – Analog Sensors, Process Thermocouples, and High Limit Thermocouples
- **Low Level Alarm**
- **High Temperature Alarm**
- **Low Temperature Alarm**
- **High Flow Alarm**
- **Low Flow Alarm**
- **High Pressure Alarm**
- **Low Pressure Alarm**
- **Main Alarm** – Critical and Non-Critical Alarms
- **Water Leak Alarm***
- **GFCI Alarm**
- **Temperature Ready Dead Band Signal*** (reference Section 14)

* Represents optional features on the Aquarius® D.I. Water Heating System.

Refer to Table 18-1 for more information on the **Dry Contact Interface** option.

Table 18-1: Dry Contact Interface

SIGNAL INVERSION			OFF (DEFAULT)		ON		SIGNAL INVERSION CAPABILITY
DRY CONTACT INTERFACE	POWER OFF	OPTION N/A	INACTIVE	ACTIVE	INACTIVE	ACTIVE	
Active Mode	0	Std.	0	1	1	0	Yes
Thermal Cut-Off Alarm	0	Std.	1	0	0	1	Yes
High Limit Alarm	0	Std.	1	0	0	1	Yes
Open Sensor Alarm	0	Std.	1	0	0	1	Yes
Low Level Alarm	0	Std.	1	0	0	1	Yes
High Temperature Alarm	0	Std.	1	0	0	1	Yes
Low Temperature Alarm	0	Std.	1	0	0	1	Yes
High Flow Alarm	0	Std.	1	0	0	1	Yes
Low Flow Alarm	0	Std.	1	0	0	1	Yes
High Pressure Alarm	0	Std.	1	0	0	1	Yes
Low Pressure Alarm	0	Std.	1	0	0	1	Yes
Main Alarm	0	0	1	0	0	1	Yes
Water Leak Alarm ³	0	0	1	0	0	1	Yes
GFCI Alarm ³	0	0	1	0	0	1	Yes
Temperature Ready Dead Band Signal ³	0	0	0	1	1	0	Yes

NOTE:

6. 0 – Open Signal
1 – Closed Signal
7. Signal inversion is specific to the respective Communication Interface. Same signal types must be inverted on each respective communication interface.
8. Available when specific option is selected.

Signal Inversion is permitted on all of the signals on the **Dry Contact Interface** provided that the optional feature is available and can be modified on the **Dry Contact Interface** screen. To access the **Dry Contact Interface** screen, start with the **Main Menu > System Set Setup Menu > Option Settings**, and select **Dry Contact Interface**. The **Dry Contact Interface Signals** screen will appear as shown in Figure 18-1 and Figure 18-2. To move between the screens press the “>” (NEXT) or “<” (BACK) key respectively. To invert the signal go to the **Dry Contact Interface Signals #2** screen, use the **Dry Contact Interface Signals #1** screen and select the “>” (NEXT) key. Once at the **Dry Contact Interface Signals #2** screen (as shown in Figure 18-2), select the **OFF/ON** key to the left of the signal you would like to invert.

Aquarius® optional features that are not available will appear as recessed button as shown in Figure 18-2.

Figure 18-1: Dry Contact Interface Signals Screen #1

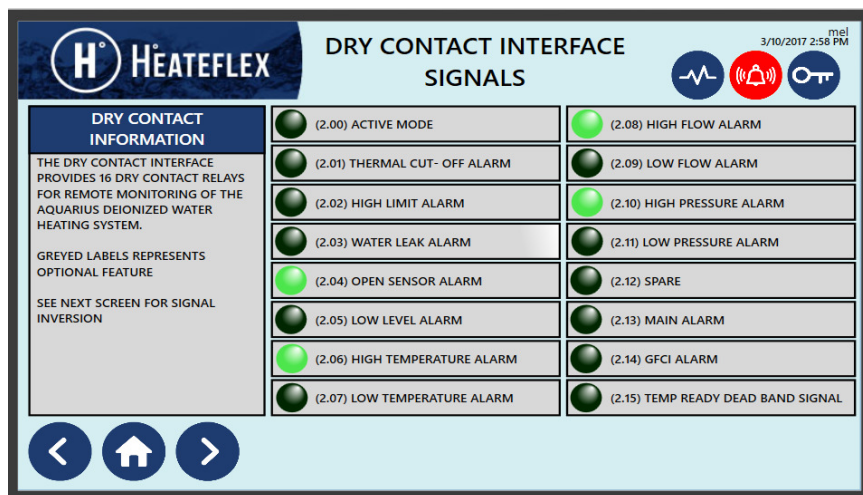


Figure 18-2: Dry Contact Interface Signals Screen #2

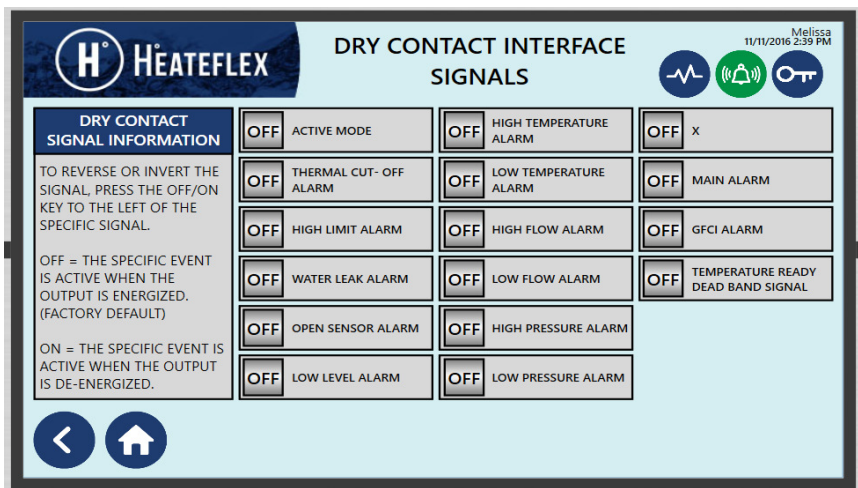


Table 18-2 details all the settings that can be modified on these screens as well as the Factory Default settings.

Table 18-2: Dry Contact Interface Settings

SETTING NAME	SETTING RANGE	FACTORY DEFAULT
Active Mode	Off or On	Off
Thermal Cut-Off Alarm	Off or On	Off
High Limit Alarm	Off or On	Off
Water Leak Alarm ²	Off or On	Off
Open Sensor Alarm	Off or On	Off
Low Level Alarm	Off or On	Off
High Temperature Alarm	Off or On	Off
Low Temperature Alarm	Off or On	Off
High Flow Alarm	Off or On	Off
Low Flow Alarm	Off or On	Off
High Pressure Alarm	Off or On	Off
Low Pressure Alarm	Off or On	Off
Main Alarm	Off or On	Off
GFCI Alarm	Off or On	Off
Temperature Ready Dead Band Signal ²	Off or On	Off

NOTE:

9. Signal inversion is specific to the respective Communication Interface. Same signal types must be inverted on each respective communication interface.
10. Available when specific option is selected.

The **Dry Contact Interface** settings for features that are optional on the Aquarius® D.I. Water Heating System will be disabled if the option is unavailable or not selected.

18.1. DRY CONTACT INTERFACE WIRING CONFIGURATION

The wiring detail listed in Table 18-3 is the “standard” configurations for Aquarius® D.I. Water Heating Systems. Please refer to the specific Electrical Schematic Diagram for more information.

Table 18-3: Dry Contact Interface Wiring Configuration

NUMBER	COLOR	STRIPE	FUNCTION
1	Brown	N/A	Spare
2	White	Grey	Door Open & EPO (Common)
3	Blue	Grey	Door Open
4	Brown	Grey	EPO
5	Black	Yellow	GFCI Alarm ¹
6	White	Yellow	Open Sensor Alarm
7	Blue	Yellow	Low Level Alarm
8	Brown	Yellow	Common
9	Black	Red	Main Alarm
10	White	Red	Water Leak Sensor Alarm ¹ (Critical)
11	Blue	Red	Drip Leak Sensor Alarm ¹ (Non-critical)
12	Brown	Red	Thermal Cut-Off Alarm
13	Black	N/A	Active Mode
14	White	N/A	Spare
15	Blue	N/A	Spare
16	Black	Grey	Temperature Ready Dead Band Signal ¹
17	Brown	Orange	High Limit Alarm
18	White	Orange	High Temperature Alarm
19	Black	Orange	Low Temperature Alarm
20	Black	Green	High Flow Alarm
21	White	Green	Low Flow Alarm
22	Blue	Green	High Pressure Alarm
23	Brown	Green	Low Pressure Alarm
24	Blue	Orange	Spare
25	Green	Yellow	Common

Note:


11. Available when specific option is selected.

19. CONTROLLER TROUBLESHOOTER

The **Controller Troubleshooter** is a feature for the Aquarius® D.I. Water Heating System that allows the user (of manager level or higher) to access the controller troubleshooter to check on the status of the Aquarius® D.I. Water Heating System's controller. To navigate to the **Controller Troubleshooter** screen go to **Main Menu > System Set Setup Menu > Controller Troubleshooter**. A user log in of Manager level or higher is required to access the Controller Troubleshooter.

The main screen of the Controller Troubleshooter consists of the Active Events tab, the Event Logs tab and the Exit key in the top right hand corner. If the controller does not have any errors, the **Active Events** tab will display a status of the NewPLC1 (the name of the PLC) as **Normal** for both the "Controller Event Status" and the "User Event Status" see Figure 19-1 below.

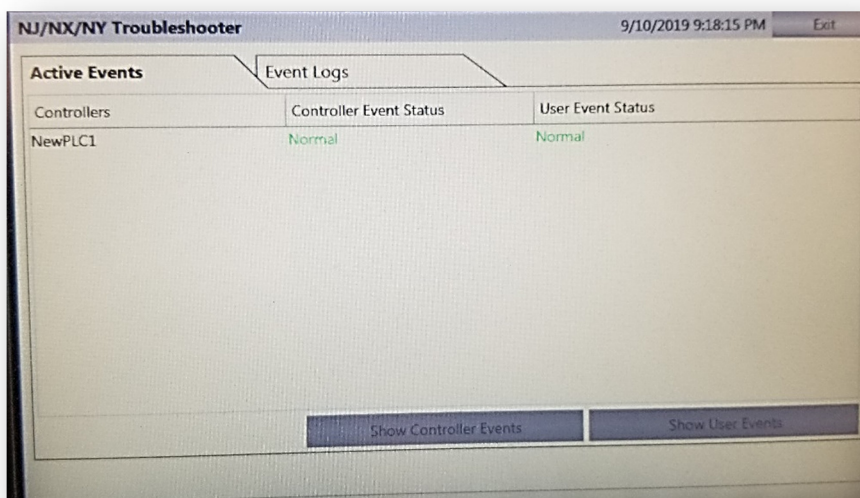
Figure 19-1: Controller Troubleshooter with no Errors



To exit out of the Controller Troubleshooter, select the Exit key at the top right corner of the screen. This will return the user back to the PF3000 controller area.

If for some reason the Aquarius unit is not being responsive or has an alarm that will not clear, the Active Events tab will display a status of “the NewPLC1 as **Error** for one or both “Controller Event Status” and the “User Event Status” see Figure 19-2 below. To acquire more detail as to what type of alarm / error is occurring, select and highlight the NewPLC1 in the Active Events tab then select the Show Controller Events.

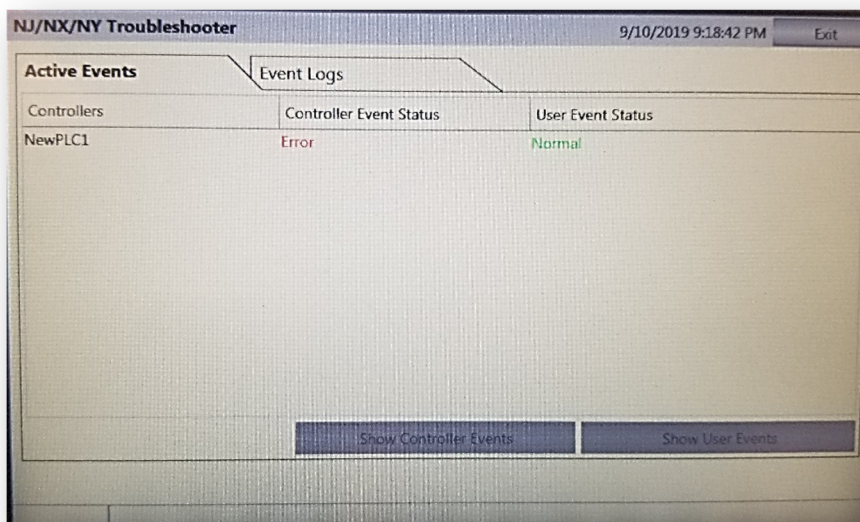Figure 19-2: Controller Troubleshooter with Errors



This will open a list of active errors, see Figure 19-3. It will show the Event Level (the severity of the fault), Event Source (the location of the fault), Event Code, and Event Name (description of the fault). If the error condition has been cleared the user may initiate an “Error Reset” by selecting the **Error Reset** key at the bottom of this screen. Once selected a popup screen (see Figure 19-5) will appear to allow the user to confirm the error reset. If all the error conditions are cleared the active events list should clear and the NewPLC1 should return to a Normal status.

To view details of the active errors, select and highlight the active error in question and select the **Show Detail** key. This will open another screen giving more detailed information on the error as seen in Figure 19-4.

Screen shots of select screens is also available of the Controller Troubleshooter. If the option is available, the Screen Shot key will be displayed on the lower left corner of the screen. When this is selected a png image file is created and saved to the USB installed in the touch screen. It is the same USB used to collect the data logging.

Figure 19-3: Controller Troubleshooter Active Events

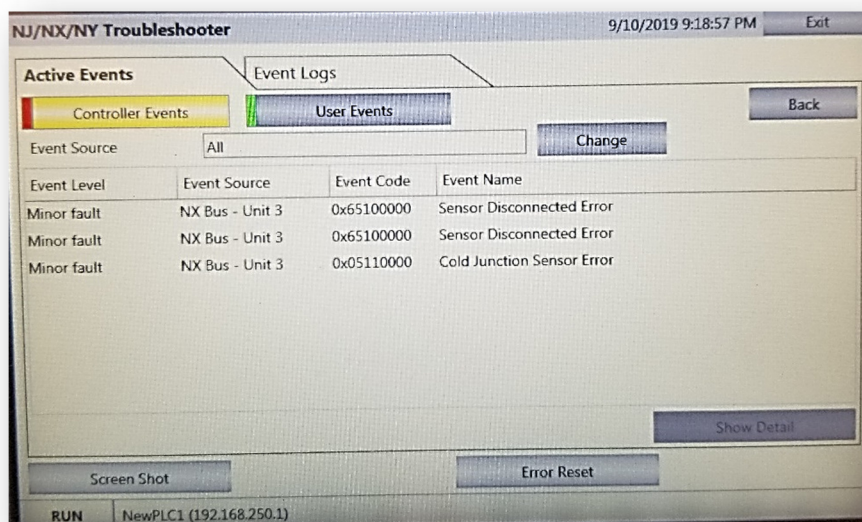


Figure 19-4: Controller Troubleshooter Active Events Detail

NJ/NX/NY Troubleshooter 9/10/2019 9:20:17 PM

Event Name	Safety Process Data Communications Timeout		Back
Event Code	0x80300000	Date/Time	6/2/2016 4:35:05 AM
Event Source	NX Bus - Unit 5		
Event Level	Minor fault		

Detailed Information

A communications timeout occurred in safety process data communications with a safety control unit.
[Cause]
(1) A setting is not correct.
The setting of the safety task period is too short.
(2) There is excessive noise.

Attached Info 1

Attached Info 2

Attached Info 3

Attached Info 4

Screen Shot

RUN NewPLC1 (192.168.250.1)

Figure 19-5: Controller Troubleshooter Reset Errors

NJ/NX/NY Troubleshooter 9/10/2019 9:20:17 PM

Active Events

Controller Events

Event Source

Event Level

Event

Minor fault

Minor fault

Minor fault

NX Bus

NX Bus

NX Bus

Message

Do you really want to reset all errors?

Yes

No

Screen Shot

Error Reset

RUN NewPLC1 (192.168.250.1)

20. SPECIFICATIONS

AQUARIUS[®] DEIONIZED WATER HEATING SYSTEM PF3000 CONTROLLER SPECIFICATIONS

Range:	Temperature: 0.0 to 95 °C Flow: Varies depending on model Pressure: 0.0 to 80 PSIG Resistivity: 0.0 to 20.0 Mega Ohms (Option)
Resolution:	Temperature: 0.1 Flow: 0.1 Pressure: 0.1 Resistivity: 0.1 (Option)
Execution Time:	5.0 ns
Processing Time:	70 ns
A/D Resolution:	1/8000
Displays:	7" STN Color Touch Screen, 800 x 480 Dots.
Communication:	Ethernet Provided
Standard Alarms:	Low & High Temperature, Low & High Flow, Low & High Pressure, Low Liquid Level, SCR Fault, Open Analog, High Limit T/C, Open High Limit T/C, Open Process T/C, Thermal Cut-Off, GFCI, and Low Battery.
Program Memory:	20K Steps, 40 Kwords
Battery Service Life:	5 years @ 25 °C
Sensors:	Temperature: Standard Type J Thermocouple Pressure: 4-20mA = 0-100 PSI, +12 VDC Powered Flow: 4-20mA Input, +5 VDC Powered Resistivity: 4-20mA Input, 0.01 Standard Cell Voltage: 4-20mA = 0 to 550 VAC
Control:	Power-To-Flow [®] Custom Algorithm with Power Reset Offset

Adjustment:	Cycle Rate: 1-2 Power Reset: 30-90 sec Dead Band: 1.0-2.0 °C Calibration Offset: Flow Rate: -2.0 °C to +4.0 °C Pressure: ±5.0 psi Voltage: ±20 VAC Temperature: ±10.0 °C
Operating Range:	0-55 °C, No corrosive gas
Storage Range:	-20 to 75 °C (Excluding battery)
Size (CPU):	3.54" x 3.54" x 3.54" (90 x 90 x 90 mm) (W x H x D)
Weight (CPU):	1.21lbf (550 g max)
Digital Inputs:	16 (Standard)
Analog Inputs:	4 (Standard)
Digital Outputs:	16 (Standard)
Analog Outputs:	0 (Standard)
Power:	24 VDC, 300 mA

21. LIST OF FIGURES

FIGURE 1-1: MAIN MENU SCREEN	5
FIGURE 2-1: TEN KEY WINDOW	6
FIGURE 2-2: FULL KEYBOARD	7
FIGURE 2-3: FULL KEYBOARD (SHIFT)	7
FIGURE 2-4: FUNCTION KEYS	9
FIGURE 3-1: LOGIN WINDOW	10
FIGURE 3-2: CLOSE UP OF ACTIVE USER NAME, DATE AND TIME	11
FIGURE 3-3: SYSTEM INFORMATION WITH ADD USERS HIGHLIGHTED	12
FIGURE 3-4: ADD USERS SCREEN.....	13
FIGURE 3-5: DELETE USER SCREEN.....	14
FIGURE 4-1: SYSTEM CLOCK SET UP SCREEN	15
FIGURE 5-1: SYSTEM STATUS SCREEN	19
FIGURE 5-2: SYSTEM STATUS SCREEN USER SELECTION KEYS.....	20
FIGURE 5-3: SYSTEM STATUS MENU SCREEN W/ AUTO PURGE SELECTED	20
FIGURE 5-4: SYSTEM STATUS MENU SCREEN W/ RESISTIVITY SELECTED	20
FIGURE 5-5: SYSTEM STATUS MENU SCREEN W/ RECIRCULATION SELECTED	20
FIGURE 6-1: SYSTEM SETUP MENU SCREEN	28
FIGURE 6-2: CONTROL SETTINGS SCREEN	29
FIGURE 6-3: ALARM SET POINTS SCREEN.....	31
FIGURE 6-4: OPTION SETTINGS SCREEN	33
FIGURE 6-5: SYSTEM CALIBRATION SCREEN	34
FIGURE 7-1: ALARM MENU SCREEN 1	37
FIGURE 7-2: TYPICAL ALARM DESCRIPTION SCREEN	38
FIGURE 7-3: TYPICAL ALARM TROUBLESHOOTING SCREEN	38
FIGURE 7-4: OPEN ANALOG ALARM SCREEN	41
FIGURE 7-5: HIGH LIMIT STATUS SCREEN	42
FIGURE 7-6: OPEN PROCESS THERMOCOUPLE SCREEN	44
FIGURE 7-7: GFCI ALARM SCREEN	45
FIGURE 7-8: CONTROLLER TROUBLESHOOTING SCREEN	47
FIGURE 7-9: RESISTIVITY ALARM TYPE SCREEN	48
FIGURE 8-1: ALARM HISTORY SCREEN	50
FIGURE 9-1: SYSTEM INFORMATION MENU SCREEN	51
FIGURE 9-2: SYSTEM INFORMATION SCREEN	52
FIGURE 9-3: SYSTEM SPECIFICATIONS SCREEN – ELECTRICAL	53
FIGURE 9-4: SYSTEM SPECIFICATIONS SCREEN – PLUMBING.....	54
FIGURE 9-5: SYSTEM SPECIFICATIONS SCREEN – CONNECTIONS	54
FIGURE 9-6: SYSTEM MAINTENANCE SCREEN.....	55
FIGURE 9-7: CONTACT INFORMATION SCREEN.....	56
FIGURE 10-1: TREND GRAPH SCREEN	57

FIGURE 11-1 – ETHERNET CONNECTIVITY FLOW CHART.....	60
FIGURE 11-2 – HOST OMRON PLC SAMPLE CODE FOR COMMUNICATING PLC TO PLC VIA ETHERNET	64
FIGURE 11-3: ETHERNET INTERFACE SCREEN	66
FIGURE 11-4: ETHERNET COMMUNICATIONS ALARMS 1 SCREEN	67
FIGURE 11-5: ETHERNET COMMUNICATIONS ALARMS 2 SCREEN	68
FIGURE 11-6: ETHERNET COMMUNICATIONS STATUS.....	68
FIGURE 11-7: ETHERNET COMMUNICATIONS VALUES SCREEN.....	69
FIGURE 11-8: ETHERNET COMMUNICATIONS SET POINTS SCREEN.....	69
FIGURE 11-9: ETHERNET COMMUNICATIONS SETTINGS SCREEN	70
FIGURE 11-10: ETHERNET SIGNALS ALARMS 1 SCREEN	71
FIGURE 11-11: ETHERNET SIGNALS ALARMS 2 SCREEN	72
FIGURE 11-12: ETHERNET SIGNALS STATUS SCREEN.....	72
FIGURE 11-13: ETHERNET WRITE STANDARD FEATURES SCREEN	73
FIGURE 11-14: ETHERNET WRITE OPTIONAL FEATURES SCREEN	74
FIGURE 11-15: CHANGE ETHERNET IP ADDRESS SCREEN.....	75
FIGURE 12-1: PURGE MODE SCREEN.....	77
FIGURE 13-1: SYSTEM STATUS SCREEN WITH RECIRCULATION MODE ACTIVE	78
FIGURE 13-2: RECIRCULATION MODE SCREEN	82
FIGURE 14-1: TEMPERATURE READY SIGNAL SCREEN.....	84
FIGURE 15-1: TEMPERATURE SET POINT OPTIONS SCREEN	87
FIGURE 16-1: ANALOG INTERFACE SIGNALS SCREEN.....	91
FIGURE 17-1: DISCRETE INTERFACE SIGNALS SCREEN	94
FIGURE 18-1: DRY CONTACT INTERFACE SIGNALS SCREEN #1.....	99
FIGURE 18-2: DRY CONTACT INTERFACE SIGNALS SCREEN #2.....	99
FIGURE 19-1: CONTROLLER TROUBLESHOOTER WITH NO ERRORS.....	102
FIGURE 19-2: CONTROLLER TROUBLESHOOTER WITH ERRORS.....	103
FIGURE 19-3: CONTROLLER TROUBLESHOOTER ACTIVE EVENTS.....	104
FIGURE 19-4: CONTROLLER TROUBLESHOOTER ACTIVE EVENTS DETAIL	105
FIGURE 19-5: CONTROLLER TROUBLESHOOTER RESET ERRORS.....	105

22. LIST OF TABLES

TABLE 2-1: SYSTEM SCREEN KEYS	8
TABLE 3-1: DEFAULT LOGIN USERNAME & PASSWORD.....	10
TABLE 5-1: SYSTEM STATUS MODES.....	21
TABLE 5-2: SYSTEM STATUS DISPLAY	23
TABLE 5-3: SYSTEM STATUS OPERATION KEYS	25
TABLE 6-1: CONTROL SETTINGS PARAMETERS AND RANGES	30
TABLE 6-2: ALARM SET POINT RANGES	32
TABLE 6-3: PLUMBING AND MINIMUM/MAXIMUM FLOW RATES.....	32
TABLE 6-4: SYSTEM CALIBRATION RANGES	35
TABLE 7-1: ALARM DESCRIPTION AND TROUBLESHOOTING	39
TABLE 10-1: VARIABLES OF RECORDED DATA	58
TABLE 11-1: ETHERNET IP ADDRESSES	61
TABLE 11-2: ETHERNET SYSTEM VALUES, SETTINGS AND SET POINTS	62
TABLE 11-3: ETHERNET SIGNAL STATUS AND ALARMS.....	63
TABLE 11-4: ETHERNET SYSTEM KEYS.....	64
TABLE 11-5: DATA STRUCTURE FOR CIP_READ.....	65
TABLE 11-6: DATA STRUCTURE FOR CIP_WRITE	65
TABLE 12-1: AUTO PURGE PARAMETERS	76
TABLE 13-1: RECIRCULATION MODES.....	79
TABLE 13-2: RECIRCULATION PARAMETERS	80
TABLE 13-3: RECIRCULATION SIGNAL	80
TABLE 14-1: TEMPERATURE READY DEAD BAND SIGNAL	85
TABLE 14-2: TEMPERATURE READY DB SIGNAL PARAMETERS AND SETTINGS.....	86
TABLE 14-3: TEMPERATURE READY DEAD BAND SIGNAL WIRING CONFIGURATION ..	86
TABLE 15-1: SECONDARY PROCESS TEMP. SET POINT PARAMETERS AND SETTINGS	88
TABLE 16-3: ANALOG INTERFACE WIRING CONFIGURATION	90
TABLE 16-1: ANALOG INTERFACE VALUE RANGES	92
TABLE 17-1: DISCRETE INTERFACE	95
TABLE 17-2: DISCRETE INTERFACE SETTINGS.....	95
TABLE 17-3: DISCRETE INTERFACE WIRING CONFIGURATION	96
TABLE 18-1: DRY CONTACT INTERFACE	98
TABLE 18-2: DRY CONTACT INTERFACE SETTINGS.....	100
TABLE 18-3: DRY CONTACT INTERFACE WIRING CONFIGURATION	101

23. MANUAL REVISIONS

Revision	Description	Program Files
00 RELEASED 7/15/19	Master PLC program for PF3000 (DI2). Add User feature, Change IP Address and Data Structure for Ethernet Interface	DI2_PLC_MASTER_R00
01	Modified instructions in section 4 for Date and Time Change	DI2_PLC_MASTER_R03